

Asbestos removal


**GOOD PRACTICE GUIDELINES
FOR LICENSED AND UNLICENSED
ASBESTOS REMOVALISTS AND
OTHER PCBUS**

April 2026



Te Kāwanatanga o Aotearoa
New Zealand Government

WORKSAFE
Mahi Haumarū Aotearoa



**These guidelines provide good practice advice
for PCBUs that carry out licensed and unlicensed
asbestos removal work.**

ACKNOWLEDGEMENTS

WorkSafe New Zealand would like to acknowledge and thank the stakeholders who contributed to the development of this guidance. WorkSafe would like to specifically thank SQN Consulting Ltd and PRO Environmental Services Ltd for their assistance with providing photos.

Some diagrams have been adapted from diagram originals provided by HSE.

Asbestos removal

KEY POINTS

- Buildings built before 1 January 2000 are likely to contain asbestos-containing materials (ACMs). For buildings built after 1 January 2000, the risk of asbestos material being present is lower.
- The removal of asbestos is covered by the Health and Safety at Work (Asbestos) Regulations 2016, the Health and Safety at Work (General Risk and Workplace Management) Regulations 2016, and the Health and Safety at Work Act 2015.
- There are different classes of asbestos removal. Each class has different regulatory requirements depending on how much asbestos material is being removed and the friability of the asbestos material being removed.
- Businesses involved in the removal of asbestos must ensure the health and safety of their workers and any other people that could be put at risk by the work that they do.
- These guidelines do not cover removal of asbestos from contaminated land. For more information, see [New Zealand Guidelines for Assessing and Managing Asbestos in Soil](#)

NOTE TO READERS

Use of 'must' and 'should'

The words 'must' and 'should' indicate whether:

- an action is required by law, or
- is a recommended practice or approach.

TERM	DEFINITION
Must	Legal requirement that must be complied with
Should	Recommended practice or approach. Alternative approaches may be adopted, if those provide for equivalent or greater levels of safety.

Key terms

A list of technical words, terms, and abbreviations used in these guidelines can be found in the glossary at the end of these guidelines. The glossary explains the meaning of each technical word, term, or abbreviation.

Lists

Lists of examples used in these guidelines are not complete lists. They may list some examples, but not all possible examples.

Images

Images used in these guidelines are a guide only. Images are not intended to provide technical specifications.

CONTENTS

1.0	About these guidelines	12
1.1	What are these guidelines about?	13
1.2	Who should read these guidelines?	13
1.3	Where to find other information about asbestos and asbestos management	14
1.4	The Health and Safety at Work Act 2015 (HSWA)	15
1.5	The Health and Safety at Work (Asbestos) Regulations 2016	15
1.6	Health and Safety at Work (General Risk and Workplace Management) Regulations 2016 (The GRWM Regulations)	16

2.0	Unlicensed asbestos removal	17
2.1	What is unlicensed asbestos removal?	18
2.2	Measuring non-flat surfaces	19

3.0	Licensed asbestos removal	20
3.1	What is licensed asbestos removal?	21
3.2	Classes of asbestos removal licences	21
3.3	Changes to friability and classification of removal work	22
3.4	Who can hold an asbestos removal licence?	23
3.5	Asbestos removal licence register	23

4.0	Removal of asbestos-containing dust (ACD)	24
4.1	Licence requirements for removing ACD	25
4.2	What is minor contamination?	26

5.0	Training and instruction	28
5.1	Workers must have the right training and information	29
5.2	Qualifications for asbestos removal workers	29
5.3	Instructing asbestos removal workers	30
5.4	Training records for asbestos removal workers	30

6.0	Supervising licensed asbestos removal work	31
6.1	Workers must have appropriate supervision	32
6.2	Class A asbestos removal supervision	32
6.3	Class B asbestos removal supervision	32

7.0	Asbestos removal control plan (ARCP)	35
7.1	What is an ARCP?	36
7.2	Who is responsible for preparing an ARCP?	36
7.3	Working with assessors during planning	37
7.4	Who needs access to the ARCP?	37
7.5	Notifying WorkSafe about licensed asbestos removal work	38
7.6	Limited circumstances where removal work may start immediately	39

8.0	Indicate the asbestos removal area	40
8.1	Removal areas must be clearly indicated	41
8.2	Using warning signs	41
8.3	Creating a buffer zone around the asbestos removal area	42

9.0	Asbestos removal enclosures	43
9.1	The purpose of an enclosure	44
9.2	Definition and use	44
9.3	When is an enclosure required?	45

9.4	Planning for enclosures	47
9.5	Enclosure design and main features	47
9.6	Enclosure extraction (negative pressure)	49
9.7	Enclosure access	51
9.8	Viewing panels	55
9.9	Occupied buildings	56
9.10	Securing external enclosures and scaffolding	56
9.11	Site preparation	57
9.12	Asbestos enclosure construction	58
9.13	Air extraction equipment	60
9.14	Testing, monitoring, and maintenance	66
9.15	Dismantling and disposal of enclosures	70
9.16	Emergency procedures	71

10.0 Air monitoring **72**

10.1	What is air monitoring?	73
10.2	When is air monitoring required?	74
10.3	Who can do air monitoring?	74
10.4	How often should air monitoring be done?	75
10.5	Assessing air monitoring results	75
10.6	Action to take if asbestos fibres are exceeded	76
10.7	Communicating air monitoring results	77
10.8	When the workplace is a home	77

11.0 Controlled removal and repair techniques **78**

11.1	Choosing an asbestos stripping technique	79
11.2	General good practice for stripping	80
11.3	Controlled wetting by injection	81

11.4	Controlled wetting by spraying	84
11.5	Dry stripping with control at source	87
11.6	Uncontrolled dry stripping	91
11.7	Managing other risks during asbestos removal work	91
11.8	Removing asbestos waste from the enclosure	93
11.9	Site cleaning and preparation for four-stage clearance	94
11.10	Approval of methods for managing risks associated with asbestos	96

12.0 Tools and equipment 97

12.1	Selecting the right tools and equipment	98
12.2	Prohibited tools and equipment	98
12.3	Controlled tools and equipment	98
12.4	Equipment inspection and maintenance	99
12.5	Industrial vacuum cleaners	99
12.6	Vacuum cleaner filters	100
12.7	Maintaining vacuum cleaners	100
12.8	Transporting vacuum cleaners	100

13.0 Clearance inspections 101

13.1	What are clearance inspections and who can do them?	102
13.2	How to find a licensed asbestos assessor	103
13.3	What does the inspection process involve?	103
13.4	Surface testing	103
13.5	Air monitoring	104
13.6	Wet enclosures or work areas	104
13.7	Using sealant	104
13.8	Clearance certificates	105

14.0 Containment and disposal of asbestos waste 106

14.1	Proper handling, containment, transport, and disposal of asbestos waste	107
14.2	Double bagging asbestos waste	107
14.3	Polythene sheeting	108
14.4	Asbestos waste drums or bins	108
14.5	Asbestos skips, vehicle trays, and similar containers	109
14.6	Removing asbestos waste from the asbestos removal area	110
14.7	Storing asbestos waste	110
14.8	Asbestos waste removal plan	110
14.9	Transporting asbestos waste	110

15.0 Personal decontamination 112

15.1	Personal decontamination helps prevent the spread of asbestos	113
15.2	Entering an enclosure or work area	113
15.3	Three stages of personal decontamination for licenced removal work	114
15.4	Preliminary decontamination (Stage 2)	114
15.5	Set-up requirements for three-stage airlocks	119
15.6	Final decontamination in a DCU (Stage 3)	119
15.7	Set-up requirements for DCUs	121
15.8	Connecting DCUs to services	123
15.9	DCU signage	123
15.10	Inspection and cleaning of DCUs	124
15.11	Maintenance of DCUs	124
15.12	Equipment testing	125
15.13	Training in decontamination procedures	125
15.14	Monitoring of the decontamination process	125
15.15	Emergency procedures for DCU failure	126

16.0 Decontamination of tools, vehicles, machinery or mobile plant **127**

- 16.1 Decontamination of equipment helps prevent the spread of asbestos 128
- 16.2 Decontaminating tools 128
- 16.3 Decontaminating vehicles, machinery or mobile plant 129

17.0 Personal protective equipment (PPE) **130**

- 17.1 PPE and RPE is essential for asbestos removal work 131
- 17.2 General PPE information 131
- 17.3 Coveralls 134
- 17.4 Gloves 136
- 17.5 Protective footwear 136
- 17.6 Respiratory protective equipment (RPE) 138

18.0 Health monitoring **145**

- 18.1 Purpose of health monitoring 146
- 18.2 Who does health monitoring apply to? 146
- 18.3 Who is responsible for making sure health monitoring is conducted? 146
- 18.4 Informing workers about health monitoring 147
- 18.5 Components of health monitoring 147
- 18.6 When health monitoring occurs 148
- 18.7 The people who carry out health monitoring 148
- 18.8 Paying for health monitoring 148
- 18.9 Information for the occupational health practitioner 148
- 18.10 Health monitoring report details 148
- 18.11 Who is entitled to the health monitoring report? 149
- 18.12 Storing and sharing health monitoring reports 149

19.0	Exposure monitoring	150
19.1	The purpose of exposure monitoring	151
19.2	When and how exposure monitoring should be done for removal work	151
19.3	Exposure monitoring for other health risks	152

appendices

Appendix 1: Asbestos removal control plan template	154
Appendix 2: Asbestos levels associated with asbestos activities	169
Appendix 3: Design criteria for asbestos decontamination units (DCUs)	171
Appendix 4: Decontamination processes	174
Appendix 5: Asbestos removal area handover form	179
Appendix 6: Glossary	180

tables

1	Examples of unlicensed asbestos removal work	18
2	Licensed and unlicensed asbestos removal	22
3	Examples of when method of removal may change asbestos friability	22
4	Licence requirements for different ACD removal scenarios	25
5	ACD removal example 1	26
6	ACD removal example 2	26
7	ACD removal example 3	27
8	ACD removal example 4	27
9	ACD removal example 5	27
10	ACD removal example 6	27
11	Required certificates for licensed asbestos removal workers	29
12	Examples of considerations for supervising Class B asbestos removal work	33
13	Examples of removalists and assessors working together	37
14	WorkSafe notification details for licensed asbestos removal work	38
15	Steps to help with site preparation and pre-cleaning	57
16	Factors to consider when constructing an enclosure	58
17	Main characteristics of a good NPU	63
18	When to perform air monitoring	74
19	Who can carry out air monitoring	74
20	Class A asbestos removal static air monitoring actions (outside enclosure)	76
21	Good practice for asbestos stripping	80
22	Key factors for effective wetting of asbestos	81
23	Comparison of multi-point and single-point injection systems	82
24	Application methods for different types of asbestos materials	84
25	Control measures for risks from wetting agents	86
26	Control measures when plant stays operating during asbestos removal	92
27	Who can carry out clearance inspections	102
28	Actions for each step of the four-stage inspection clearance process	103
29	Three stages of a transit facility, or three-stage airlock	119
30	Requirements for service connections	123
31	Daily and weekly checklist for DCUs	124
32	DCU equipment that should be checked, by who, and how often	125
33	Types of PPE commonly used when working on or near asbestos	132
34	What to consider when choosing suitable disposable coveralls	135
35	What to consider when choosing suitable disposable gloves	136
36	What to consider when choosing suitable protective footwear	137
37	Types of positive-pressure respirators	140
38	Classifications of RPE filters	141
39	Summary of pre-use checks when wearing RPE	143
40	Components of a full asbestos medical for health monitoring	147
41	Health monitoring calendar for licensed asbestos removal workers	148
42	Recipients of the health monitoring report	149

figures

1	Example of solid barrier fence	42
2	Enclosure with three-stage airlock	45
3	Removal work without an enclosure	46
4	Schematic diagram of the main components of an enclosure	47
5	Example of a Class A enclosure inside a building	48
6	An NPU	50
7	Example of a DCU attached directly to an enclosure	51
8	Example of an airlock used in transiting	52
9	Typical three-stage baglock design to remove waste from an enclosure	52
10	Combined airlock/baglock setup (limited space)	53
11	Airlock/baglock setup for transiting with limited space	53
12	Airlock/baglock setup for transiting with sufficient space	54
13	Example of airlock and baglock	54
14	Examples of viewing panels	55
15	Flap arrangements for airlocks	60
16	Ideal NPU position	61
17	Good airflow management in buildings of different shapes	62
18	Example of POOR airflow management in a building	63
19	The main characteristics of a good extract ventilation system	64
20	An enclosure being smoke tested	67
21	Needle board multi-point injection system for thin asbestos layers	82
22	Controlled multi-point injection delivery through a network of fine needles	83
23	Spraying AIB ceiling tiles	85
24	Multi-point spray system	86
25	Example of glove bag setup with HEPA vacuum	89
26	Type H vacuum cleaner	94
27	Final cleaning before Class A clearance	96
28	Air sampling during clearance (viewed through a vision panel)	104
29	Asbestos waste double bagged and sealed with a goose-neck twist	108
30	Examples of asbestos waste being removed	109
31	Three stages of personal decontamination	114
32	DCU directly attached to the enclosure	115
33	diagram of a three-stage airlock and transit area	116
34	Preliminary decontamination - exiting the enclosure (right to left)	117
35	Inside view of three stage airlock with preliminary decontamination materials	118
36	Example of preliminary decontamination area when no enclosure present	118
37	General layout of a DCU	120
38	Full decontamination in the DCU - exiting the enclosure (right to left)	121
39	Example of mobile DCU facilities	122
40	Example of notice on DCU	123
41	Coveralls	135
42	Gumboots (left) and disposable shoe covers covering gumboots (right)	137
43	Examples of respirators suitable for lower risk asbestos work	139
44	Examples of respirators suitable for higher-risk asbestos work	140
45	Full-face, positive-pressure demand air-line respirator	140
46	Negative-pressure seal check procedure	142
47	Positive-pressure seal check procedure	142

1.0

About these guidelines

IN THIS SECTION:

- 1.1** What are these guidelines about?
- 1.2** Who should read these guidelines?
- 1.3** Where to find other information about asbestos and asbestos management
- 1.4** The Health and Safety at Work Act 2015 (HSWA)
- 1.5** The Health and Safety at Work (Asbestos) Regulations 2016
- 1.6** Health and Safety at Work (General Risk and Workplace Management) Regulations 2016 (The GRWM Regulations)

Asbestos can harm people's health if it is not removed safely. These guidelines help asbestos removalists to manage risks related to asbestos removal and comply with relevant regulations.

1.1 What are these guidelines about?

These guidelines provide good practice advice for the safe removal of asbestos from buildings and workplaces.

These guidelines will help PCBUs that conduct asbestos removal (called removalists in these guidelines) to comply with:

- the Health and Safety at Work Act 2015 (HSWA)
- the Health and Safety at Work (Asbestos) Regulations 2016
- the Health and Safety at Work (General Risk and Workplace Management) Regulations 2016

These guidelines do not cover removal of asbestos from contaminated land. For more information, see [New Zealand Guidelines for Assessing and Managing Asbestos in Soil](#)

1.2 Who should read these guidelines?

These guidelines are for any PCBUs that carry out asbestos removal. There are two main types of asbestos removalist:

- licensed asbestos removalists:
 - those licensed to remove friable and non-friable asbestos (a Class A licence)
 - those licensed to remove non-friable asbestos (a Class B licence)
- unlicensed asbestos removalists:
 - those who remove restricted quantities of non-friable asbestos as part of other work they do (for example, some tradespeople).

For details on who can remove different types and quantities of asbestos, see [Section 2.0: Unlicensed asbestos removal](#) and [Section 3.0: Licensed asbestos removal](#)

Friable and non-friable asbestos

Asbestos can be classified into two categories based on its condition:

- **Friable asbestos** is flaky or powdery. It can be crumbled or reduced to a powder without much pressure. Friable asbestos can easily release fibres into the air. Friable asbestos is sometimes referred to as Class A asbestos.
- **Non-friable asbestos** usually has asbestos fibres bonded into another material such as cement. Non-friable asbestos is less likely to release asbestos fibres into the air unless it is disturbed or has started to deteriorate. Non-friable asbestos is sometimes referred to as Class B asbestos.

For more information about asbestos types, see WorkSafe's webpages:

- [Asbestos in Aotearoa New Zealand](#)
- [Asbestos in the home](#)

These guidelines may also help PCBUs working in other parts of the asbestos management contracting chain including:

- PCBUs that own, lease, or manage a building that has or could have asbestos in it
- PCBUs that do asbestos surveys
- PCBUs that do asbestos assessments (assessors)
- building surveyors.

These guidelines are not intended for people who are not a PCBU (such as homeowners and residential tenants).

1.3 Where to find other information about asbestos and asbestos management

This guide focuses specifically on good practice for removing asbestos from buildings and workplaces. There is guidance available for other aspects of the management of asbestos.

This guide should be read in conjunction with:

- [Asbestos in New Zealand](#) - information about what asbestos is, the risks of asbestos and why it should be managed
- [Managing asbestos in your building or workplace](#) - guidelines for PCBUs about how to manage asbestos in their building or workplace (including when to engage an asbestos surveyor to assist with this)
- [Protective clothing and equipment for working with or near asbestos](#) - guidance for PCBUs that carry out any work where there is a risk of exposure to asbestos fibres
- [Conducting asbestos surveys - good practice guidelines](#)
- [Asbestos assessments - good practice guidelines](#)
- [Asbestos in the home](#) - information for homeowners about how to manage asbestos in their home, and how to engage asbestos professionals for the safe management and removal of asbestos
- [The Health and Safety at Work \(Asbestos\) Regulations 2016 - interpretive guidelines](#)
- [New Zealand Guidelines for Assessing and Managing Asbestos in Soil](#)

1.4 The Health and Safety at Work Act 2015 (HSWA)

HSWA is the primary work health and safety legislation in New Zealand. HSWA applies to all work and workplaces unless specifically excluded.

Primary duty of care

All PCBUs (including removalists) have a primary duty of care under HSWA. The primary duty of care means that PCBUs must make sure, so far as is reasonably practicable, the health and safety of:

- any workers that are influenced by their business (for example, their own workers, workers of other PCBUs, contractors, subcontractors, and apprentices)
- other people that could be put at risk by their work (for example, tenants, visitors, customers, and passers-by).

For removalists, this duty includes any risks a worksite may create while they have control over it for asbestos removal (from the start to the end of the removal process, not just while asbestos is actively being removed).

More information about the primary duty of care (and other duties under HSWA) is available on the WorkSafe website [Introduction to the Health and Safety at Work Act 2015 - special guide](#)

Overlapping duties

When working with other asbestos professionals in a contracting chain (such as with building owners, surveyors and assessors) removalists are likely to have overlapping duties. Sometimes, multiple PCBUs share the same health and safety duties for an activity. This is called overlapping duties.

Under HSWA, where there are overlapping duties, all PCBUs involved must, so far as is reasonably practicable:

- consult each other
- cooperate with each other
- coordinate their activities.

This is to make sure that all workers across all the PCBUs, (and other people) are not put at risk before, during, and after the asbestos removal process.

For more information about managing overlapping duties, see WorkSafe's webpage [Overlapping duties](#)

More information about managing risk in a contracting chain, see WorkSafe's webpage [PCBUs working together: advice when contracting](#)

1.5 The Health and Safety at Work (Asbestos) Regulations 2016

The Health and Safety at Work (Asbestos) Regulations 2016 specify how to manage asbestos risks. Complying with regulations made under HSWA is mandatory.

Removalists have specific duties under the Asbestos Regulations. They cover (for example) requirements for:

- licensing requirements for removalists
- training and supervision
- asbestos removal control plans (ARCPs)
- notifying WorkSafe and others about removal work
- signage
- controlling access to removal areas

- decontamination
- disposal of asbestos waste and used personal protective equipment (PPE)
- clearance inspections and certificates
- air monitoring.

For a detailed explanation of the asbestos regulations, see [The Health and Safety at Work \(Asbestos\) Regulations 2016 – interpretive guidelines](#)

1.6 Health and Safety at Work (General Risk and Workplace Management) Regulations 2016 (The GRWM Regulations)

The General Risk and Workplace Management Regulations covers general requirements for all workplaces and more specific requirements for high-risk work which includes asbestos removal. They cover (for example) requirements for:

- managing risks associated with substances hazardous to health
- PPE
- training
- exposure monitoring
- health monitoring.

For a detailed explanation of the GRWM Regulations, see:

- [General risk and workplace management – part 1](#)
- [General risk and workplace management – part 2](#)

2.0

Unlicensed asbestos removal

IN THIS SECTION:

- 2.1 What is unlicensed asbestos removal?
- 2.2 Measuring non-flat surfaces

Unlicensed asbestos removal can still expose people to harmful asbestos fibres. It is important to manage the risks effectively and follow good practice.

2.1 What is unlicensed asbestos removal?

Unlicensed asbestos removal involves the removal of up to **10m²** of **non-friable** asbestos. Unlicensed asbestos removal can be carried out by an asbestos removalist or another tradesperson (such as plumbers, electricians, or roofers).

For asbestos removal to be unlicensed, **all** the following apply:

- only non-friable asbestos or asbestos-contaminated dust may be removed (up to 10m²)
- the 10m² restriction applies cumulatively to the whole asbestos removal project for the site.

Important: These requirements cannot be avoided by dividing a large site into sectors of 10m² or less and removing asbestos from each sector.

If it is unclear whether the area of asbestos material to be removed is over or under 10m², the area should be carefully measured.

Removal of more than 10m² of non-asbestos material must be carried out by a licensed asbestos removalist.

Removal of any amount of friable asbestos requires a Class A licence.

See [Section 3.0: Licensed asbestos removal](#) for more information.

Table 1 shows examples of unlicensed asbestos removal work.

EXAMPLE	LICENCE CLASS REQUIRED
Removing a single non-friable asbestos cement sheet (area 2m ²) to install an air conditioner	Licence is not required because the area of ACM is 10m ² or less and is non-friable
Self-employed person has been engaged to remove a non-friable asbestos cement eave (1.6m ² in total) to provide access for pipes	Licence is not required because the area of ACM is 10m ² or less

TABLE 1:
Examples of unlicensed asbestos removal work

Recommended techniques for unlicensed asbestos removal

Unlicensed asbestos removal must still follow all applicable requirements of the Asbestos Regulations and HSWA, and removal must be done in accordance with good practices for safe removal of non-friable asbestos.

PCBUs must make sure they have the right skills and experience to conduct unlicensed removal in accordance with the regulations.

For detailed information on techniques for removing non-friable asbestos that does not need a licence see [non-friable asbestos removal safe work practices](#)

2.2 Measuring non-flat surfaces

Many objects containing asbestos are not flat. For these objects, it is acceptable to calculate the overall dimensions of the object's surface. It is acceptable to ignore surface texture and holes when measuring asbestos.

How to apply the 10m² rule to curved or uneven surfaces (such as asbestos piping)

Measure the external surface area of the pipe. This can be worked out by multiplying the outside circumference of the pipe by its length. This equals the surface area in square metres.

Calculate the external surface area of a pipe using this equation:

$$\frac{10(\text{m}^2)}{\pi \times \text{diameter (m)}} = \text{Max length (m)} \quad \text{No licence required}$$

Example 1: For a 100mm (0.1m) pipe, 10m in length

$$3.14 \times 0.1\text{m} \times 10\text{m} = 3.14\text{m}^2 \quad \text{No licence required}$$

For a 250mm (0.25m) pipe 15m in length

$$3.14 \times 0.25\text{m} \times 15\text{m} = 11.77\text{m}^2 \quad \text{Licence required}$$

Example 2: Maximum length of 100mm (0.1m) pipe that can be removed without a licence

$$\frac{10(\text{m}^2)}{3.14 \times 0.1 \text{ (m)}} = 31.84\text{m}^2 \quad \text{Licence required}$$

Maximum length of 250mm (0.25m) pipe that can be removed without a licence

$$\frac{10(\text{m}^2)}{3.14 \times 0.25 \text{ (m)}} = 12.73\text{m}^2 \quad \text{Licence required}$$

3.0 Licensed asbestos removal

IN THIS SECTION:

- 3.1 What is licensed asbestos removal?
- 3.2 Classes of asbestos removal licences
- 3.3 Changes to friability and classification of removal work
- 3.4 Who can hold an asbestos removal licence?
- 3.5 Asbestos removal licence register

Licensed asbestos removal involves higher-risk work that must be carried out by appropriately trained and authorised removalists.

3.1 What is licensed asbestos removal?

Licensed asbestos removal is the controlled and regulated activity of removing asbestos-containing material (ACM) from buildings or workplaces. Specific licences are required based on the type and amount of asbestos being removed.

3.2 Classes of asbestos removal licences

There are two types of licences available for conducting licensed asbestos removal.

Class A asbestos removal licences

A **Class A** asbestos removal licence permits the removal of any type or amount of asbestos and asbestos-contaminated dust or debris (ACD).

A **Class A** asbestos removal licence is required for the removal of ACD unless the ACD is:

- associated with and generated during Class B asbestos removal work, excluding ACD that was present before the work started
- a 'minor contamination' not associated with friable or non-friable asbestos removal. See [Section 4.2: What is minor contamination?](#) for more information.

Class B asbestos removal licences

A **Class B** asbestos removal licence permits the removal of:

- any amount of non-friable asbestos
- ACD associated with and generated during the removal of non-friable asbestos or ACM, excluding ACD that was present before the work started.

Table 2 shows the licence required depending on the type and quantity of asbestos material being removed.

TYPE OF LICENCE	WHAT ASBESTOS CAN BE REMOVED?
Class A	Any type or quantity of asbestos material, including: <ul style="list-style-type: none"> - any amount of friable asbestos material - any amount of ACD - any amount of non-friable asbestos material.
Class B	<ul style="list-style-type: none"> - Any amount of non-friable asbestos material. - ACD associated with and generated during the removal of non-friable asbestos or ACM. - This excludes ACD that was present before the work started.
No licence required	<ul style="list-style-type: none"> - Up to and including 10m² of non-friable asbestos material, cumulatively over the whole course of the removal project for the site. - Asbestos-contaminated dust (ACD) associated with and generated during removal of 10m² or less of non-friable asbestos material. - This excludes ACD that was present before the work started.

TABLE 2:
Licensed and
unlicensed
asbestos removal

Examples include:

- Class B licensed asbestos removalist contracted by a building owner PCBU to remove 12m² of non-friable asbestos cement sheets from a factory toilet block.
- Class A licensed asbestos removalist contracted by a building owner PCBU to remove 0.5m² of friable asbestos lagging from a pipe.

3.3 Changes to friability and classification of removal work

In most cases the friable and non-friable status of asbestos is determined by the condition of the asbestos before it is disturbed for removal.

However, in some cases the classification of friability of the asbestos can change based on the method of removal used. Table 3 outlines examples of where the method of removal may change the friability and therefore the conditions under which it can or must be removed

PRODUCT TYPE AND ORIGINAL FRIABILITY	CAN BE TREATED AS NON-FRIABLE AND BE REMOVED UNDER CLASS B CONDITIONS IF:	MUST BE TREATED AS FRIABLE AND REMOVED UNDER CLASS A CONDITIONS IF:
Hot water cylinder with internal asbestos insulation Friable	Removed and disposed of as a complete unit and the asbestos inside remains fully contained	Cylinder is opened up or broken down in any way for removal or disposal
Fire door with AIB core Friable	Removed and disposed of as a complete unit and the asbestos inside remains fully contained	The core of the door is exposed in any way during removal or disposal. This includes where removed screws or hardware expose the core
Asbestos-containing paper backing attached to a non-asbestos vinyl Friable	Removed and disposed of as one piece with no disturbance to the paper backing (this will typically be limited to small rooms as the piece will need to fit through the door opening)	The paper backing is cut, torn or in any other way disturbed or separated from the vinyl it is attached to enable removal or disposal
Asbestos-containing vinyl flooring (the asbestos is present in the vinyl matrix itself) Non-friable	Removed and disposed of as a single piece and no asbestos-containing adhesive is left behind that cannot be removed by solvent (this will typically be limited to small rooms as the piece will need to fit through the door opening)	The vinyl is cut or torn to enable removal, or if any remaining asbestos-containing adhesive requires power tools to remove

PRODUCT TYPE AND ORIGINAL FRIABILITY	CAN BE TREATED AS NON-FRIABLE AND BE REMOVED UNDER CLASS B CONDITIONS IF:	MUST BE TREATED AS FRIABLE AND REMOVED UNDER CLASS A CONDITIONS IF:
Asbestos rope inside a chimney Friable	Chimney removed and disposed of as one piece with no disturbance to the rope	The chimney needs to be broken down into pieces to enable removal and disposal
Textured coating Non-friable	Removed and disposed of while still attached to the substrate without disturbing the textured coating (this will typically be limited to small rooms as the piece will need to fit through the door opening)	The textured coating is disturbed via manual or mechanical scraping/lifting or cutting through the ceiling/wall
'Popcorn' ceiling coating Friable	Removed and disposed of while still attached to the substrate without disturbing the textured coating (this will typically be limited to small rooms as the piece will need to fit through the door opening)	The ceiling surface is disturbed via manual or mechanical scraping/lifting or cutting through the ceiling

TABLE 3: Examples of when method of removal may change asbestos friability

See [Section 11: Controlled removal and repair techniques](#) for more detailed information on some of the above removal techniques.

Any removal work that requires controls associated with friable asbestos removal should be treated as Class A asbestos removal work and only be done by a Class A asbestos removalist and subject to Class A asbestos clearance undertaken by an independent licensed asbestos assessor.

3.4 Who can hold an asbestos removal licence?

Only PCBUs can apply for and hold a Class A or Class B asbestos removal licence. WorkSafe administers Class A and B asbestos removal licences.

For more information about asbestos licensing, see WorkSafe's webpage [Asbestos licensing](#)

3.5 Asbestos removal licence register

WorkSafe keeps a register of every currently licensed, cancelled and expired asbestos removalist. The register includes:

- the licence holder name
- licence status
- licence number
- licence class
- licence expiry date
- nominated supervisor name(s).

For more information, see WorkSafe's website [Asbestos licence holder registers](#)

4.0

Removal of asbestos-containing dust (ACD)

IN THIS SECTION:

- 4.1 Licence requirements for removing ACD
- 4.2 What is minor contamination?

Removal of ACD is treated separately under the regulations to friable and non-friable asbestos removal.

4.1 Licence requirements for removing ACD

Asbestos-contaminated dust or debris (ACD) means dust or debris that has settled within a workplace or home and is, or is assumed to be, contaminated with asbestos.

Removal of asbestos containing dust (ACD) is treated separately under the regulations to friable (Class A) and non-friable (Class B) asbestos removal. Regulatory requirements for the removal of ACD depends on how the ADC was created and how much is present.

ACD must be removed by a Class A asbestos removalist **unless** it is:

- associated with non-friable asbestos removal, or
- a ‘minor contamination’ **not** associated with friable or non-friable asbestos removal.

See Table 4, further explanations and examples below.

	ACD ASSOCIATED WITH REMOVAL (any amount)	CONTAMINATION (that is not minor and not associated with removal)	MINOR CONTAMINATION (not associated with removal)
ADC comes from a friable source	Class A	Class A	Class B
ADC comes from a non-friable source	Class B	Class A	Class B
ADC source was originally non-friable, but condition has deteriorated to become friable	Class A	Class A	Class B

TABLE 4: Licence requirements for different ACD removal scenarios

ACD associated with removal of non-friable asbestos

ACD associated with removal of non-friable asbestos means ACD generated by or **discovered during** asbestos removal activities. These activities include site set up/pre clean and non-friable asbestos removal. For example: when removing an asbestos cement roof and settled ACD is discovered after lifting roof material (this can be dealt with under the Class B licence).

ACD associated with removal of asbestos that was originally non-friable but condition has deteriorated to become friable

Where accumulated quantities of ACD have been generated by a non-friable asbestos source, and there is a sufficient quantity of ACD that it is identifiable before work has started, it should be assumed that the nature of the source material has changed due to deterioration or damage (accidental or due to an event such as fire). The source material should be reclassified as friable, and the removal of it, and the ACD generated by it, must be undertaken by a Class A removalist.

ACD not associated with removal

ACD not associated with removal includes where historically asbestos material was or might have been present. In this scenario ACD must be seen as a stand alone asbestos contamination and, unless a minor contamination, must be removed by a Class A removalist.

4.2 What is minor contamination?

There is no legal definition of minor contamination. To determine whether a contamination of ACD is a minor contamination, the asbestos removalist or competent person will need to carry out a risk assessment.

Relevant considerations include:

- the time it would take for a person to carry out the clean-up job
- the size, area and extent of the contamination
- the number of workers and persons who will be or are likely to be involved in or exposed to the work
- the complexity of the work being undertaken
- the knowledge and skills required to complete the work safely
- the risks associated with the work and the complexity of the risk control measures.

The amount of ACD cannot exceed what would, in other circumstances, be associated with safely removing 10m² or less of non-friable asbestos.

Example 1: Removing a minor ACD contamination from a small area, such as an electrical box lined with Bakelite

Time to clean up	10 minutes for one worker
Area	Small
Distribution	No further spread of ACD to adjoining areas
Rick of exposure	Very low
Class B licensed removalist required	

TABLE 5:
ACD removal example 1

Example 2: Minor contamination after uncontrolled drilling into an asbestos cement wall/ceiling

Time to clean up	10 minutes for one worker
Area	Small
Distribution	No further spread of ACD to adjoining areas
Rick of exposure	Very low
Class B licensed removalist required	

TABLE 6:
ACD removal example 2

Example 3: Minor ACD contamination generated by isolated accidental damage to a structure containing non-friable ACM

Time to clean up	One hour for one worker
Area	Medium
Distribution	Minimal spread of ACD to adjoining areas
Risk of exposure	Low to medium
Class B licensed removalist required	

TABLE 7:
ACD removal example 3

Example 4: A warehouse has surfaces covered in ACD. The ACD has come from the asbestos cement roof which has since been enclosed with a false ceiling

Time to clean up	Clean-up will take four hours for one person
Area	Medium to large area
Distribution	ACD on a number of different surfaces in adjoining areas
Risk of exposure	Medium to high
Class A licensed removalist required	

TABLE 8:
ACD removal example 4

Example 5: A house asbestos cement roof has been cleaned using high-pressure water, leaving dried ACD spread over a large area

Time to clean up	Clean-up will take two days for one person
Area	Medium to large area
Distribution	ACD on a number of different surfaces in adjoining areas
Risk of exposure	High to very high
Class A licensed removalist required	

TABLE 9:
ACD removal example 5

Example 6: Fire damaged asbestos cement product (turned into Class A due to becoming friable after fire damage)

Time to clean up	Clean-up will take 1/2 day for four people
Area	Medium to large area (thermally induced shattering)
Distribution	ACD on a number of different surfaces in adjoining areas
Risk of exposure	High to very high
Class A licensed removalist required	

TABLE 10:
ACD removal example 6

5.0 Training and instruction

IN THIS SECTION:

- 5.1 Workers must have the right training and information
- 5.2 Qualifications for asbestos removal workers
- 5.3 Instructing asbestos removal workers
- 5.4 Training records for asbestos removal workers

Asbestos removal workers must be suitably trained and qualified to do the job safely. Provide clear instructions and make sure they are competent before any removal work begins.

5.1 Workers must have the right training and information

PCBUs must make sure that workers engaged in asbestos removal work or carrying out asbestos-related work, are trained in the identification and safe handling of, and suitable control measures for, removal of asbestos and ACM.

WorkSafe strongly recommends regular refresher training for all people working with asbestos.

5.2 Qualifications for asbestos removal workers

Licensed asbestos removalists must make sure all their workers have the correct/relevant certificate for the class of licensed asbestos removal work to be done.

Table 11 shows required certificates for licensed asbestos removal workers.

CLASS OF LICENSED ASBESTOS REMOVAL	WHAT CERTIFICATE IS REQUIRED?
Class A	Unit Standard 29766: For undertaking Class A work
Class B	Unit Standard 29765: For undertaking Class B work

TABLE 11:
Required certificates for licensed asbestos removal workers

Workers who do less than a combined four weeks of Class B asbestos removal work a year (12-month period) do not have to meet the Class B requirements in Table 11. The four weeks counts across all jobs and removalists they may work for in that year.

A worker with the Unit Standard for Class A removal cannot undertake Class B removal work unless they also hold the Class B unit standard.

These qualification requirements apply to all asbestos removal workers, including fixed term contract workers and temporary labour hire workers.

5.3 Instructing asbestos removal workers

The licensed asbestos removalist must give appropriate instructions to workers carrying out licensed asbestos removal work. The instructions must be specific for the:

- location and type of workplace where the work is done
- the work to be carried out.

Get this information from the asbestos removal control plan (ARCP) for the site. For more information, see [Section 7.0: Asbestos removal control plan \(ARCP\)](#)

Before the start of each asbestos removal job, instruct workers on:

- the nature of the hazards and risks of asbestos
- how asbestos can affect a person's health
- the risks from exposure to airborne asbestos
- the control measures in place for that job
- the methods and equipment to use for the job
- choosing, using, and caring for PPE and respiratory protective equipment (RPE)
- decontamination procedures
- waste disposal procedures
- emergency procedures
- the importance of health monitoring and exposure monitoring
- any other requirements from other laws, if applicable.

5.4 Training records for asbestos removal workers

A licensed asbestos removalist must keep a training record for each worker who does licensed asbestos removal work for them. These records must be:

- kept while each worker is carrying out licensed asbestos removal work
- retained for five years after the worker has stopped carrying out licensed asbestos removal work for the removalist
- readily accessible at the asbestos removal area and available for inspection by a health and safety inspector.

Note: Records can be kept in hardcopy versions or electronically.

6.0

Supervising licensed asbestos removal work

IN THIS SECTION:

- 6.1 Workers must have appropriate supervision
- 6.2 Class A asbestos removal supervision
- 6.3 Class B asbestos removal supervision

Class A and Class B licensed asbestos removal work must be supervised by a nominated supervisor.

6.1 Workers must have appropriate supervision

Licensed asbestos removal work must be supervised by a supervisor nominated on the licence of the removalist undertaking the work. The licence must cover the type of asbestos work being done.

For information on applying for a licence, see WorkSafe's webpage [Apply for an asbestos removal or assessor licence](#) including:

- nominate a supervisor for licensed asbestos removal work
- qualifications to supervise licensed asbestos removal work
- experience to supervise licensed asbestos removal work.

6.2 Class A asbestos removal supervision

For asbestos removal work that requires a Class A licence, the nominated supervisor must be present at the asbestos removal area whenever the work is carried out. This includes during:

- asbestos removal area set up
- enclosure erection
- asbestos removal
- clearance inspection
- site demobilisation after clearance inspection.

6.3 Class B asbestos removal supervision

If the asbestos removal work requires a Class B licence, the nominated supervisor must be in the vicinity and readily available. The work must still be supervised effectively.

It is important to consider these factors when deciding whether to be there:

- the workers' competence and experience
- the work being carried out and the risks involved, what might go wrong, and the ability of the workers to immediately recognise and remedy risk
- how the supervisor can be contacted and be readily available to return to the removal area.

Table 12 below shows more examples of factors to consider when deciding whether to be on-site.

FACTOR	WHAT TO CONSIDER
Worker competence and experience	Assess the skill level and experience of the workers performing the removal work. More experienced workers may require less direct supervision.
Nature of the work and risks involved	Evaluate the specific tasks and associated risks. Higher risk activities are more likely to require the supervisor to be present to make sure asbestos removal is carried out safely.
Potential issues and response	Consider potential problems that could arise during the removal process and the workers' ability to recognise and address these issues promptly.
Communication and availability	Make sure the supervisor is easily contactable and can return to the site quickly if needed.

TABLE 12:
Examples of considerations for supervising Class B asbestos removal work

Example 1: Class B supervision

The supervisor is supervising workers that are competent, reliable and experienced in the type of removal being carried out. The supervisor decides that they need to check on the workers periodically during the day, but otherwise they will be working in a different part of the building. The workers are instructed to contact the supervisor by phone immediately if anything unexpected occurs, or if removal is not going according to plan. In these cases, the supervisor will return to the removal area.

Example 2: Class B supervision

The supervisor is supervising workers that are still training and are inexperienced. In this case, direct supervision is always needed.

What does 'in the vicinity' and 'readily available' mean?

'In the vicinity' means in the general area nearby, in person. The exact meaning depends on the situation and must be considered with the definition of 'readily available'.

A supervisor is not 'in the vicinity' if they are:

- only available remotely
- not able to reach the workplace in a reasonable period.

'Readily available' means able to be reached quickly and easily. The exact meaning will depend on the situation and must be considered alongside the definition of 'in the vicinity'.

A supervisor is not 'readily available' if they:

- can only be reached through a one-way channel (like a text message or email)
- cannot easily access the site due to obstacles
- cannot be reliably reached due to issues with their method of contact/travel. For example, commuting across a busy urban centre during rush-hour traffic.

When considering 'in the vicinity' and 'readily available', it is important to factor in scale and complexity of the removal. For example, asbestos cement cladding on a garage which is relatively simple to remove versus multiple non-friable ACMs across a school refurbishment project, with vulnerable people present.

When workers are recently trained, the licence holder may wish to ensure the supervisor is always on site to oversee proportionately more of the workers' activities.

Example 1

If an incident occurred on a Class B licensed asbestos removal site (such as a cut needing minor first aid or the breakdown of a piece of equipment with competent removalist workers), the nominated supervisor is contactable by phone and able to arrive in person at the workplace within 30 minutes of being notified, WorkSafe would likely regard them as 'in the vicinity' **and** 'readily available'.

Example 2

If the same incident occurred with recently trained removalist workers, and the nominated supervisor is away from site, contactable by phone and able to return to the site within 15 minutes of being notified that support is needed, WorkSafe would likely regard them as 'in the vicinity' **and** 'readily available'.

Example 3

If there are two licensed class B jobs happening at the same time but they are 30 minutes apart in light traffic, and both are supervised by the same person, managing a minor issue at one site might be tricky due to the distance. If a serious problem happens at the other site during busy traffic, it will take the supervisor longer to get there. In such a case, WorkSafe would likely regard the supervisor **not** to be 'in the vicinity and readily available' to manage the problem.

7.0

Asbestos removal control plan (ARCP)

IN THIS SECTION:

- 7.1 What is an ARCP?
- 7.2 Who is responsible for preparing an ARCP?
- 7.3 Working with assessors during planning
- 7.4 Who needs access to the ARCP?
- 7.5 Notifying WorkSafe about licensed asbestos removal work
- 7.6 Limited circumstances where removal work may start immediately

Use an ARCP to manage risks and protect workers and other people when removing asbestos that requires a licence.

7.1 What is an ARCP?

An ARCP is a document that identifies the specific control measures that will be used to make sure that workers and other people are not put at risk during licensed asbestos removal.

An ARCP can help to plan an asbestos removal job effectively and make sure that asbestos material is removed safely.

Include the following details in asbestos removal control plans:

- how the removal will be done, including the method, tools, equipment, and personal protective equipment to use
- information from an asbestos demolition/refurbishment survey - the asbestos to be removed, its location, type, and condition
- a description of the asbestos removal area and any air monitoring points
- how the asbestos waste will be transported and disposed of.

While ARCPs are required only for licensed asbestos removal work, they can also be useful for planning unlicensed asbestos removal work, especially when being done near sensitive areas such as schools or hospitals.

Note: While the structure of the ARCP can be generic, each plan must address the specific requirements of each job.

A template ARCP is provided in Appendix 1.

7.2 Who is responsible for preparing an ARCP?

A licensed asbestos removalist must prepare an asbestos removal control plan (ARCP) for any licensed asbestos removal work they are commissioned to do.

It is important the removalist prepares the ARCP before the removal work starts.

When preparing it, the removalist is responsible for consulting with:

- the PCBU that commissioned the work
- any PCBUs that manage or control workplaces that may be affected by the asbestos removal work
- workers and their representatives
- the assessor that will be doing air monitoring and site clearance.

If the licensed asbestos removal work is being carried out at a home, the removalist should also consult with the person who commissioned the removal work and the owner or occupier of the home (if different).

If, after work has started, the scope of work changes or other factors mean the way the work will be done has to change, the ARCP should be updated in consultation with the commissioning PCBU. Any changes should be communicated to the same people listed above.

7.3 Working with assessors during planning

While removalists and assessors must remain independent of each other and work for the commissioning PCBU, they still need to work together to manage overlapping duties and to support each other to comply with their respective duties. This is particularly important during planning and creating the ARCP. Examples of where the removalist should engage with the assessor include:

WORK ACTIVITY	EXAMPLES WHERE REMOVALIST AND ASSESSOR SHOULD WORK TOGETHER
Pre-removal site visit	<p>With the assessor do a walk through of the removal site during scoping and before planning. This can help assessors identify and deal with potential issues, avoiding unnecessary delays in completing the clearance.</p> <p>A walk through will also give assessors a better idea of how long they may need for the visual inspection and air monitoring during four-stage clearance.</p> <p>See Section 13: Clearance inspections for more information.</p>
Asbestos removal control plan (ARCP) development	<p>Consult with assessors in the following areas of the ARCP:</p> <ul style="list-style-type: none"> - roles and responsibilities - timelines for task completion - emergency procedures - decisions on positioning of monitoring equipment and positioning or viewing panels in enclosures - when deciding when or how to do personal air monitoring - use and availability of decontamination facilities - expectations for dealing with remedial cleaning or failed clearances - how the clearance inspection records, and clearance certificates will be provided/delivered.
During removal work	<p>Agree with the assessor how they will make results of air monitoring available to the removalist and their workers – especially if the respirable asbestos fibre levels are found to be too high. This must be communicated to the commissioning PCBU and the removalist immediately so additional control measures can be put in place, or work stopped.</p> <p>See Section 10.6: Action to take if asbestos fibres are exceeded for more information.</p> <p>The assessor and the removalist must also cooperate during any incident response.</p>

TABLE 13: Examples of Removalists and Assessors working together

For more information about maintaining independence between removalists and assessors see [Section 2.4: Independence and conflicts of interest in the Asbestos assessments – good practice guidelines](#)

7.4 Who needs access to the ARCP?

Once the ARCP is prepared, the removalist must provide a copy of it to the person who commissioned the licensed asbestos removal work.

A copy of the ARCP must be kept for two years after the work is completed. If there is an incident that needs to be notified to WorkSafe, the ARCP must be kept for five years.

The ARCP must be readily accessible on site for the duration of the removal work and available for the following to read:

- any PCBU at the workplace
- workers and their representatives
- the occupants of the home (if relevant)
- WorkSafe as the regulator (under HSWA).

7.5 Notifying WorkSafe about licensed asbestos removal work

The licensed asbestos removalist must notify WorkSafe in writing at least five days before the licensed asbestos removal work starts.

This information must be included in the notification.

ITEM	DESCRIPTION
1	The name, licence number, and business contact details of the licensed asbestos removalist
2	The name and business contact details of the supervisor of the licensed asbestos removal work
3	The name of the asbestos assessor engaged to carry out a clearance inspection and issue a clearance certificate for the work
4	The name and contact details of the person for whom the work is to be carried out
5	The name (including registered business or company name) of the PCBU with management or control of the workplace where the asbestos is to be removed, including its address and the kind of workplace
6	If the workplace is large, the specific location in the workplace of the asbestos removal
7	The date of the notice
8	The date on which the asbestos removal work is to start and the estimated duration of the work
9	Whether the asbestos to be removed is friable or non-friable
10	If the asbestos to be removed is friable, how the area of removal will be enclosed
11	The estimated quantity of asbestos to be removed and the means of transport and disposal of the asbestos waste
12	The number of workers who are to carry out the asbestos removal work
13	A summary of the training for each worker carrying out the asbestos removal work

TABLE 14:
WorkSafe notification
details for licensed
asbestos removal work

The [Notification of Licensed Asbestos Removal form](#) is available from WorkSafe's website.

Send any updates/changes to the notification to asbestos@worksafe.govt.nz as soon as they arise.

7.6 Limited circumstances where removal work may start immediately

Removal work may start immediately in either of these limited circumstances:

- a sudden, unexpected event (such as equipment failure, fire, or flood) that may expose people to respirable asbestos fibres, or creates a risk of exposure (such as a burst pipe lagged with asbestos)
- an unexpected breakdown of an essential service (such as gas, water, sewage, or telecommunications services) that needs urgent repair to keep the service running.

If this happens, the licensed asbestos removalist:

1. Must immediately notify WorkSafe by telephone and in writing within 24 hours after the verbal notice was provided.
2. Immediately notify WorkSafe at the email address asbestos@worksafe.govt.nz

8.0

Indicate the asbestos removal area

IN THIS SECTION:

- 8.1 Removal areas must be clearly indicated
- 8.2 Using warning signs
- 8.3 Creating a buffer zone around the asbestos removal area

Warning signs and barriers are essential to clearly identify that asbestos removal is underway and protect people from exposure.

8.1 Removal areas must be clearly indicated

Asbestos removal area covers all the areas in which asbestos removal work is carried out and includes:

- decontamination facilities
- enclosures or areas from where asbestos is being removed
- transit routes
- any other area specified in ARCP.

The asbestos removal area should be clearly indicated. Use clear signage and appropriate barriers to prevent unauthorised access. For removal being carried out without an enclosure this should be done using a solid barrier or fence surrounding the immediate removal area.

A secondary buffer zone should be created in the general area to further restrict unauthorised people from getting near the enclosure or asbestos removal area especially in sensitive locations such as schools or hospitals and in occupied buildings.

Responsibilities for the security and access control to the asbestos removal site should be specified in the ARCP.

The asbestos removalist should consider not only the risk associated with asbestos removal, but also the general risks related to the work and work environment.

8.2 Using warning signs

Warning signs must be used to indicate that asbestos removal work is taking place. They effectively alert workers, visitors, and the public to the presence of asbestos and the associated risks.

When placing warning signs to indicate the asbestos removal area, think about:

- **Placement:** Place warning signs at all main entry points to the asbestos removal area.
- **Visibility:** Make sure that signs are weatherproof and securely positioned in prominent locations, so they are easy to see.
- **Compliance with standards:** Signs should comply with *NZS/AS 1319 Safety signs for the occupational environment*, covering aspects such as size, illumination, location, and maintenance.
- **Regulations:** Any signs used must comply with any applicable safe work instrument.

8.3 Creating a buffer zone around the asbestos removal area

Barriers should be used to physically isolate the general area surrounding the asbestos removal area and, if necessary, an enclosure (a buffer zone). They can help control access to the asbestos removal area and prevent unauthorised access.

Types of barriers:

- **Fixed barriers:** Solid barriers such as fencing should be used to keep unauthorized people away from friable asbestos removal work areas and enclosures.
- **Tape barriers:** For work involving the removal of non-friable asbestos over a brief period, a tape barrier may be sufficient to keep people at a safe distance.

The placement of barriers should be based on an assessment of the physical environment and the level of risk at the asbestos removal site.

Factors to consider when placing barriers:

- **Friability of asbestos material:** Friable asbestos will need to be fenced off using a solid barrier.
- **Activity levels:** Consider the activity around the asbestos removal area, including workers, visitors, and the public, to assess the risk of exposure to asbestos.
- **Likelihood of interference from the public:** consider the proximity of the work to busy public areas, schools, and other locations where the work may draw the attention of the public. In these scenarios solid barriers rather than tape should be used to prevent access.
- **Existing barriers:** Use existing barriers such as walls and doors where possible.



FIGURE 1:
Example of solid barrier fence

9.0

Asbestos removal enclosures

IN THIS SECTION:

- 9.1 The purpose of an enclosure
- 9.2 Definition and use
- 9.3 When is an enclosure required?
- 9.4 Planning for enclosures
- 9.5 Enclosure design and main features
- 9.6 Enclosure extraction (negative pressure)
- 9.7 Enclosure access
- 9.8 Viewing panels
- 9.9 Occupied buildings
- 9.10 Securing external enclosures and scaffolding
- 9.11 Site preparation
- 9.12 Asbestos enclosure construction
- 9.13 Air extraction equipment
- 9.14 Testing, monitoring, and maintenance
- 9.15 Dismantling and disposal of enclosures
- 9.16 Emergency procedures

Enclosures help contain asbestos during removal to prevent the spread of fibres. It is essential to understand their set up and management.

9.1 The purpose of an enclosure

Enclosures are an important control measure during asbestos removal work. They are normally required to:

- prevent the spread of asbestos
- prevent other people (employees and others) from being exposed to asbestos.

This section explains the function and purpose of enclosures and gives practical advice on their design, construction, and use during work with asbestos.

9.2 Definition and use

An enclosure is a physical barrier around the asbestos work area designed to contain asbestos dust and waste resulting from the work, preventing the spread of asbestos materials to the surrounding environment.

Access to the enclosure is controlled through entrance and exit openings called airlocks (Figure 2). Airlocks control the movement of workers, waste, and equipment in and out of the work area and enable the preliminary decontamination of workers, equipment, and waste items on exiting the unit.

The enclosure and airlocks must, so far as is reasonably practicable, be:

- airtight
- under negative pressure, unless glove bags are used for Class A asbestos removal [Section 11.5: Dry stripping with control at source](#)
- tested for leaks if used for removing friable asbestos.



FIGURE 2:
Enclosure with
three-stage airlock

Enclosures, by design and function, will lead to increased amounts of dust and debris inside the enclosure area. Anyone entering or working inside an enclosure must wear suitable protective clothing and RPE and must thoroughly decontaminate themselves on leaving the enclosure.

For more information, see [Section 15.0: Personal decontamination](#) and [Section 17.0: Personal protective equipment \(PPE\)](#)

Enclosures must be constructed before any Class A asbestos removal work starts, including placing injection needles.

9.3 When is an enclosure required?

Class A removal work will almost always require an enclosure including:

- when removing asbestos thermal insulation (such as boiler and pipe insulation, and sprayed asbestos applied for fire protection, anti-condensation, and acoustic control)
- when removing AIB products such as ceiling tiles or panels or boards containing asbestos.

Using an enclosure for Class A removal work should be the default procedure to use and any exception will need to be clearly justified. See *When enclosure may not be required* below.

There are situations where enclosures should also be considered for Class B or unlicensed work, including:

- where asbestos cement sheets are being removed, and there is a lot of breakage and fine debris being created
- the work is happening close to occupied or sensitive areas.

Enclosures may also be necessary as a secondary containment option in situations where a primary control such as glove bags are in use but there is significant risk to other people near the work area if the control should fail. In these situations, the enclosure provides protection against potential contamination of the area if the primary control fails.

When enclosures may not be required

Class A enclosures may not be reasonably practicable in all instances, for example when:

- the location is extremely remote, and the asbestos or ACM is present in open space
- the work is at height and an enclosure is not practical due to the height or complexity of the structure (such as pipework in the open air at a high level), or its exposure to severe weather conditions
- there are practical difficulties in obtaining an effective seal on the structures, such as soffits around building roofs
- the work involves cleaning up minor contamination or external contamination especially in emergency scenarios

If an enclosure is not used for Class A asbestos removal, additional control measures need to be put in place to prevent any contamination of the surrounding area or exposure to other people. Examples of other control measures include:

- enhanced dust suppression methods e.g. misting cannons or low-pressure water spraying
- enhanced work area zoning including respirator zone and buffer zone with strict access control
- strict direct supervision of the asbestos removal workers

The effectiveness of additional control measures must be checked by ongoing air monitoring in close proximity to active removal work

Although the licenced assessor might decide that clearance air monitoring and surface testing may not be possible or necessary, a Class A clearance inspection must still be undertaken with clear justification for Stage 3 omission recorded by the licenced assessor.

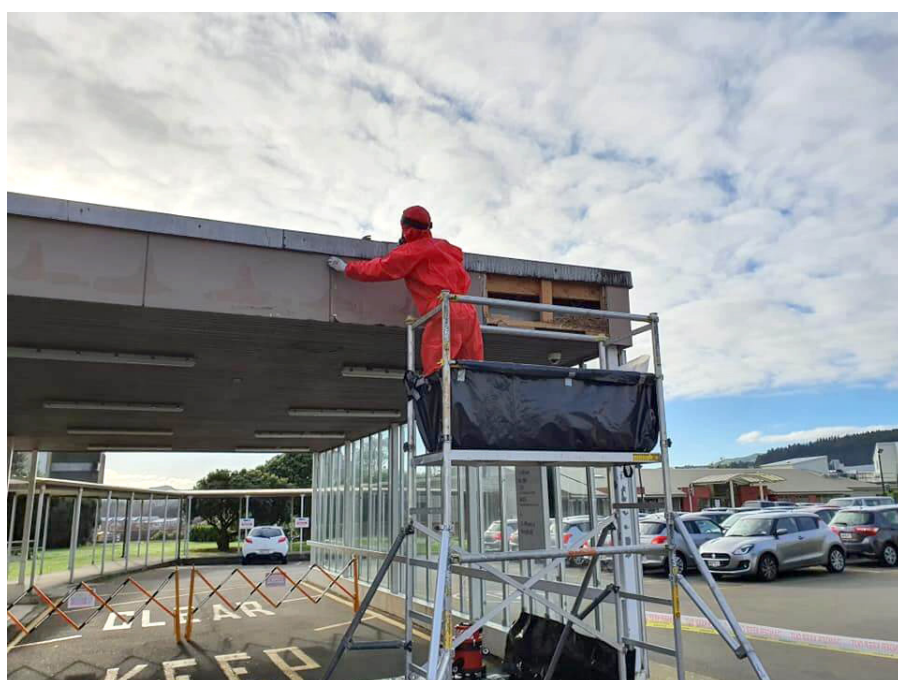


FIGURE 3:
Removal work
without an enclosure

9.4 Planning for enclosures

Enclosures are a key feature in the risk management of asbestos removal. Plans for how enclosures will be constructed and used should be considered as early as possible in the planning process.

Enclosures can be used in many different situations and conditions. While there are common features to most enclosures, they will need to be designed specifically for the circumstances of the individual job. Factors to consider when planning an enclosure include:

- clearance of the work area
- removal of mobile or portable items
- the need for a pre-clean
- the size and shape of the work area
- the enclosure being as airtight as possible
- plant being switched off (such as boilers) after communication with the client
- creating sufficient and uniform negative pressure (without short circuiting) within the enclosure and airlocks
- ensuring sufficient air movement through the enclosure
- allowing for safe and easy access for workers, equipment and waste
- making sure the enclosure will be robust for the conditions
- security, and prevention of damage to the enclosure
- provision of viewing panels
- actions to take in an emergency
- the need for fire prevention materials (such as fireproof polythene).

The following may also need to be considered:

- additional controls if the work is happening in an occupied building
- securing external enclosures.

9.5 Enclosure design and main features

Figure 4 shows the main components of a typical asbestos removal enclosure.



FIGURE 4: Schematic diagram of the main components of an enclosure

Enclosure size

When designing the enclosure consider the following:

- the location of the asbestos to be removed and access requirements
- make sure it is big enough for the work activity, for example:
 - the number of workers involved
 - the size and shape of the items or materials to be removed
 - the space needed for any plant or equipment to be used. Examples include lengths of pipework and plant such as scissor lifts or platforms.
 - avoid oversized enclosures, as these will increase the spread of asbestos and the size of the area to be cleaned and increase ventilation requirements.

Using existing structures as part of an enclosure

Enclosures can make use of parts of the existing building structure or be self-supporting temporary structures purpose-built around the asbestos working area. Existing rooms or walls, ceilings and floors can be used to provide part or all of an enclosure.

The surfaces of the enclosure should be smooth and solid. If any existing surface is unsuitable, such as rough, damaged, or brittle surfaces, it should be pre-cleaned and then lined with material such as polythene sheeting.

The integrity of the enclosure must, so far as is reasonably practicable, be maintained and tested for leaks as work progresses. For example, when AIB ceiling tiles are removed opening the ceiling void, the void will become part of the enclosure and will need to be smoke tested, and the area volume included in the ventilation calculation. If these areas are sealed back again as work progresses, they will need to be cleaned and subject to clearance procedures.



FIGURE 5:
Example of a
Class A enclosure
inside a building

Sealing the enclosure

The enclosure should be effectively sealed and be as airtight as possible:

- seal all joints and corners (particularly in purpose-built structures)
- seal all windows, doors, ventilation grilles, airbricks, inlets, and exhausts
- seal any gaps or holes around pipes, ducts, conduits, structural or other items (including inside cupboards or units) that pass through to adjoining rooms or floors

All leaks should be identified and sealed.

Openings or gaps, or holes should be sealed using a combination of materials such as tape, sealing compounds such as expanding foam, and waterproof sheeting. If complete sealing is not possible, additional controls should be used. These can include mini-enclosures within large enclosures, glove bags, and enhanced negative pressure.

Using sealants and foams

Certain foams and adhesives can produce high concentrations of harmful vapours when used in very confined spaces, or on hot pipework. Follow the product's safe use instructions. The risks of using foam and sealants should be considered in the overall risk assessment and appropriate controls and protective equipment should be used.

Foam should be trimmed to size after setting.

If any foam or sealant is to remain after the removal work is done, check that it will not interfere with any fire safety regulations.

9.6 Enclosure extraction (negative pressure)

Creating a negative pressure environment inside the enclosure provides an additional control in case there are accidental leaks. However, air extraction should not be treated as an alternative to a well-sealed enclosure. Negative pressure also helps to control air movement when workers are entering or exiting the enclosure.

There should be sufficient negative pressure (mechanical extract ventilation) within the enclosure and the pressure should be as uniform as possible throughout the unit.

The pressure differential will depend on:

- the extracted air rate from the enclosure
- the physical size and shape of the structure
- the extent of leakage (the effectiveness of the sealing)
- external weather conditions, such as a change in wind direction which can positively pressurise an enclosure.

For more information, see [Section 9.13: Air extraction equipment](#)

Large work areas

It may be difficult to achieve good, uniform negative pressure for extremely large enclosures. Consider sub-dividing a large space into a number of smaller enclosures. For example:

- where the work area consists of a series of rooms (such as in office blocks or hotels)
- where large extensive plant or long stretches of pipework are to be stripped of asbestos.

Air movement

Air movement in the enclosure should be designed to make sure that there is uniform airflow as far as reasonably practicable in all areas. NPUs (negative pressure units) and supplementary air inlets should be located where they will achieve good flow and avoid dead spots. For more information, see [Section 9.13: Air extraction equipment](#)



FIGURE 6:
An NPU

Air movement should be checked during the smoke test (checking that smoke is cleared efficiently from all areas of the enclosure) and by using smoke tubes and/or differential pressure monitors.

In situations where negative pressure is difficult to achieve, over-extraction may be used to compensate but the extraction level should not damage the integrity of the enclosure.

If the removal process involves opening other parts or sections of the premises, such as when removing ceiling tiles or dividing walls, the ventilation rate should be calculated based on the final enclosure volume, which includes the initial area and the ceiling void.

9.7 Enclosure access

Design all enclosures with access points for workers, plant, equipment, and asbestos waste removal, which prevent dust escaping into the general environment.

Ideally, asbestos workers should enter the enclosure directly from the decontamination unit (DCU) (Figure 7).



FIGURE 7:
Example of a DCU
attached directly
to an enclosure

Where the DCU cannot be attached directly to the enclosure, a transiting system is required. In transiting systems, workers will enter the enclosure through a three-stage **airlock** (Figure 8). Any transiting area between an airlock or bag lock and a DCU should be clearly marked and must be included within the scope of the clearance assessment.



FIGURE 8:
Example of an airlock used in transiting

Airlocks and baglocks

Enclosures should be designed and constructed with separate systems for asbestos waste removal. A system similar to the worker transit facility (airlock) can be used for the removal of waste asbestos from the enclosure (called a baglock).

This illustration shows the design of the baglock system.

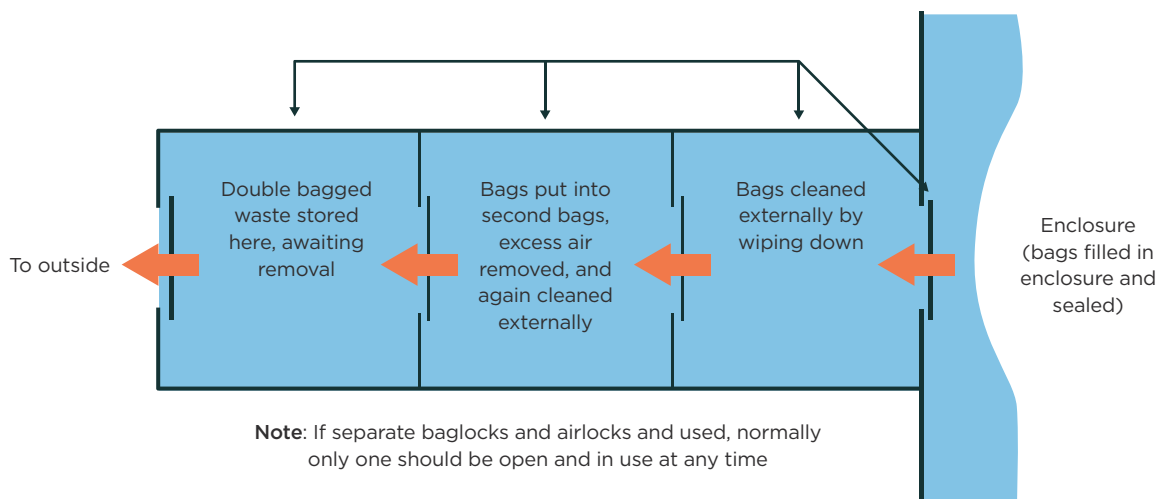


FIGURE 9: Typical three-stage baglock design to remove waste from an enclosure

Where it is not possible to have separate airlock and baglock systems, a hybrid arrangement can be used.

The design of the hybrid system will depend on whether the DCU is connected directly to the enclosure or whether a three-stage transiting airlock is involved.

These illustrations show the various options for setting up airlocks and baglocks.

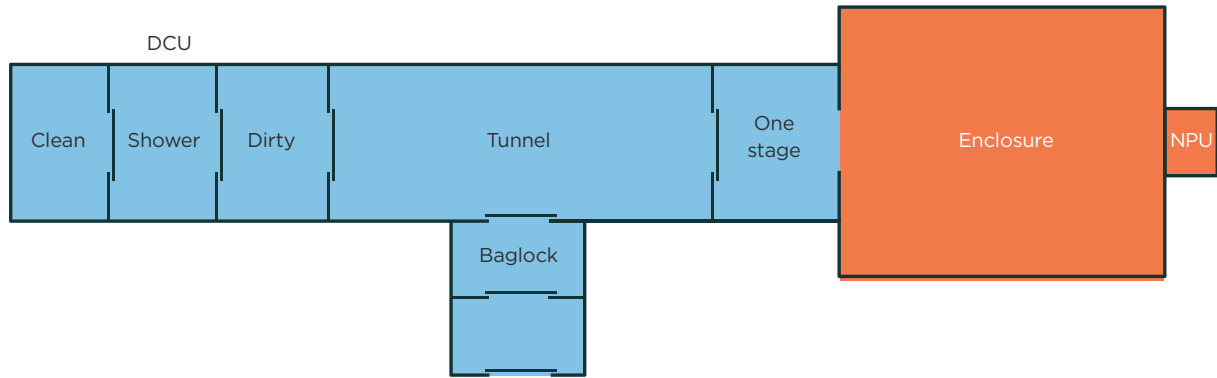


FIGURE 10: Combined airlock/baglock setup (limited space)

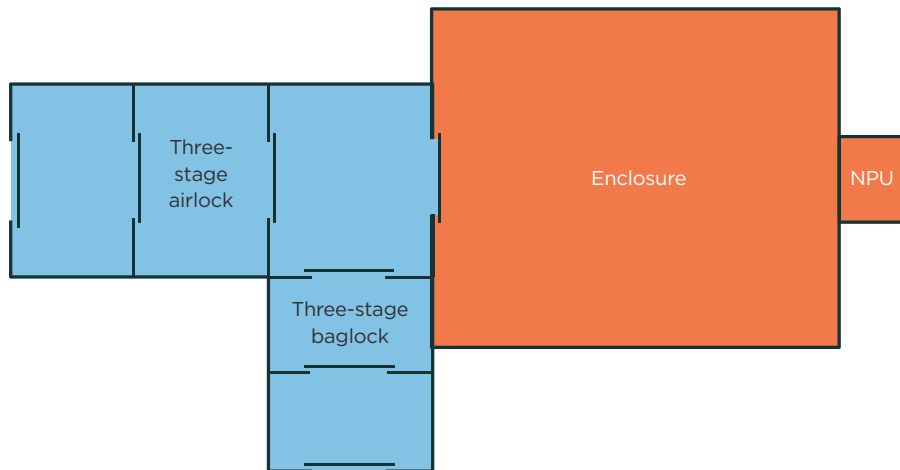


FIGURE 11: Airlock/baglock setup for transiting with limited space

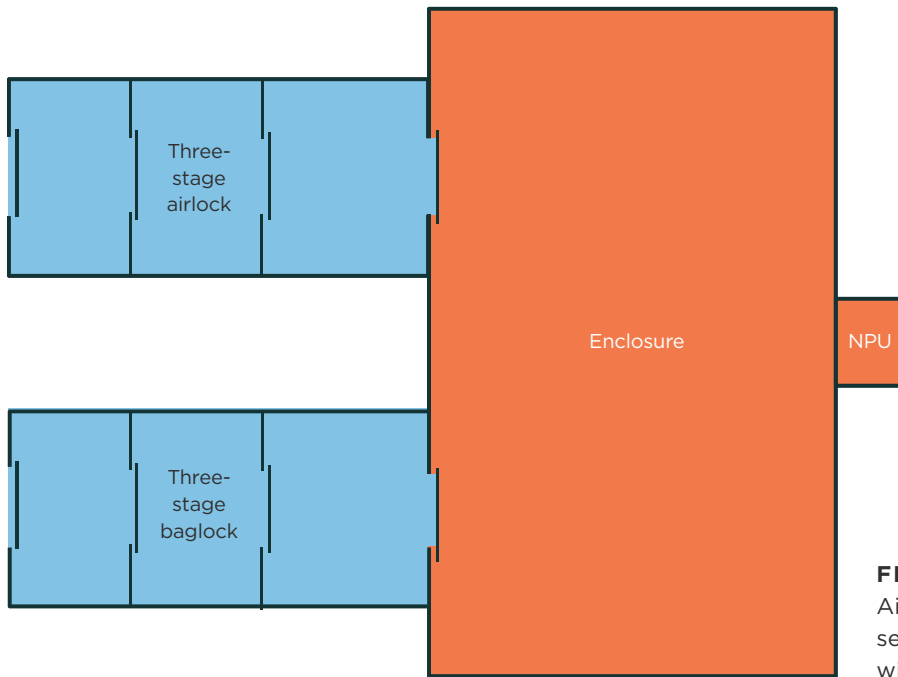


FIGURE 12:
Airlock/baglock
setup for transiting
with sufficient space



FIGURE 13:
Example of airlock
and baglock

9.8 Viewing panels

Clear viewing panels should be included in the walls of the enclosure so the site supervisor can see what is going on inside without having to enter (Figure 14). This helps make sure the method detailed in the ARCP is being followed. The number and location of these panels will depend on the location, size, and complexity of the enclosure.



FIGURE 14: Examples of viewing panels

Viewing panels should be used in the inner stage of airlock and baglock. Where viewing panels are impractical, alternative methods to observe and monitor progress within the enclosure should be used such as CCTV, or web-based cameras placed at appropriate locations.

Examples of situations where cameras might be needed instead of viewing panels include:

- underground locations
- multiple-floor buildings
- existing buildings where panels cannot be installed
- where the work location inside the enclosure is obscured or far away from the viewing panels.

Cameras should be covered in protective sheeting to prevent them becoming contaminated.

For details on constructing viewing panels, see [Section 9.12: Asbestos enclosure construction](#)

9.9 Occupied buildings

If other parts of the building will be occupied during asbestos removal, additional control measures will be needed to make sure the building's occupants remain safe and the enclosure is not compromised.

For example:

- If possible, plan to do the asbestos removal work during periods when the area will be unoccupied (such as after office hours).
- Consider greater isolation of the asbestos removal area. For example:
 - consider using a hoarding to form a barrier between the asbestos removal area and the adjoining occupied areas
 - erect a plastic-lined barrier within this hoarding and reserve a buffer area between the hoarding and occupied areas
 - erect platforms and fixed scaffolding during the early stages of the work
 - erect these structures on the outside of the enclosure.
- Do daily visual inspections and airborne sampling outside the enclosure to confirm the effectiveness of the enclosure ([Section 9.14: Testing, monitoring, and maintenance](#)).
- Make sure enclosures do not obscure or block any fire exits. If this is unavoidable, alternative arrangements must be made and clearly communicated to the building occupants and asbestos removal workers.
- Check that existing mechanical air movement (such as heating, or air conditioning) within the building will not compromise the negative pressure inside the enclosure, and also that process emissions are not drawn into the enclosure.
- Check that the movement of any lifts will not cause changes in air pressure that could affect the negative air pressure inside the enclosure.
- Make sure existing ventilation systems cannot be contaminated through inappropriate siting of NPU discharges near to ventilation intakes.

Protect existing fittings and furniture from contamination

All moveable items should be removed from the asbestos removal area before asbestos removal work begins. Where removing items from the enclosure is not possible:

- items should be moved as far away as possible from the immediate asbestos removal area and covered with two layers of plastic sheeting, with a minimum overlap of 300mm between the layers. Both layers should be double taped
- cover all non-moveable items such as fixtures and fittings with plastic sheeting and seal the joints
- protect floors with at least one layer of woven plastic to prevent penetration during the asbestos removal work. The joints should be lapped by 300mm and sealed with double-sided tape and duct tape.

9.10 Securing external enclosures and scaffolding

Secure enclosures properly to prevent them toppling or falling over. This is particularly important for external units which can be subject to changing weather conditions.

Attach enclosures securely to the building or scaffolding. Consider the security of the enclosure to make sure unauthorised people/members of the public cannot enter.

Seek advice from a competent person (such as a Chartered Professional Engineer) to verify the design and construction of the enclosure where it may be subject to adverse environmental conditions such as earthquake, wind and/or snow – unless there is sufficient information provided in the manufacturer's specifications.

Scaffolding must meet the relevant standards for construction. For more information about safe scaffolding see [Scaffolding in New Zealand](#)

9.11 Site preparation

Before any preparation and construction work begins:

- assess what PPE and RPE will be required for the initial preparation work and construction of the enclosure and make it available to workers
- make sure the DCU is set up and operational.

Table 15 includes steps that may help with site preparation and pre-cleaning.

PREPARATION STEP	DETAILS
Inspect the proposed work area	<p>The inspection area should include:</p> <ul style="list-style-type: none"> - the planned enclosure area - surrounding areas such as transit and waste routes - the area next to the enclosure location. <p>Inspect these areas to identify:</p> <ul style="list-style-type: none"> - areas that will need pre-cleaning - where sheeting may be needed - items that can be removed - any factors that may affect clearance certification.
Pre-clean if any asbestos is found	<p>If minor asbestos debris or dust is present, do a pre-clean before constructing the enclosure. Loose material should be cleaned up using appropriate methods such as:</p> <ul style="list-style-type: none"> - type H vacuuming - surface wiping - temporary encapsulation (PVA, tape, or cling film) - spray wetting - bagging. <p>Non-asbestos dust and debris should be disposed of as normal waste. Otherwise, it will be treated as hazardous waste once work starts.</p> <p>In cases of significant contamination (such as after a fire), where the enclosure cannot encompass all the material, loose visible asbestos dust, debris, and other items should be removed before constructing the enclosure.</p> <p>For more information about asbestos containing dust and debris see Section 4.0 Removal of asbestos-containing dust (ACD)</p>
Remove all movable or portable items	<p>Remove all mobile or portable items from the work area. Remaining items such as plant or electrical equipment should be pre-cleaned, covered with polythene sheeting, and securely taped to prevent contamination.</p>
Seal plant with flues	<p>Flues in boilers or similar equipment inside the enclosure should be sealed to prevent asbestos spread.</p>
Consider and plan for any live plant	<p>Avoid including live operating plant within an enclosure if possible. If unavoidable, consider factors such as live plant ventilation, and emergency access to live plant.</p>
Protect hard-to-decontaminate areas	<p>Pre-clean as much as possible, then protect areas that will be difficult to decontaminate (such as earth floors, or behind radiators/pipes) or areas that are likely to generate dust during cleaning (such as concrete)</p>

TABLE 15: Steps to help with site preparation and pre-cleaning

9.12 Asbestos enclosure construction

The enclosure should be designed and constructed in a way to prevent disturbance of asbestos materials until construction is finished. This is especially important in areas with extensive contamination on floors or other surfaces.

Construction and composition of the enclosure will depend on things such as:

- use of the existing building structure
- job duration
- work location.

Existing structures may reduce potential leaks but could present ventilation and access issues. Most enclosures are temporary, self-supporting units made with a frame securely fixed to sheeting material.

Table 16 lists factors to consider when constructing an enclosure.

FACTORS INFLUENCING ENCLOSURE CONSTRUCTION	DETAILS
Sealing openings	All openings (vents, doors, windows, holes, etc.) must be sealed to prevent asbestos fibre escape.
Polythene sheeting material	Polythene sheeting is commonly used due to its flexibility, imperviousness, and ease of erection. As a minimum, 200-500 microns opaque sheeting should be used.
Fire hazard considerations	In fire-prone areas, fire-retardant polythene should be used.
Alternative materials for strength	In exposed locations, reinforced PVC sheets or solid barriers (such as panels or wooden boards lined with polythene) may be used for added strength.
Timber framework	Timber dimensions should provide adequate fixing and support. For internal work, 50mm x 50mm clean timber is typically sufficient. Secure sheeting to the timber using staples, tape, and spray tack.
External sheeting on timber framework	If sheeting is attached to the outside of the timber, protect the timber (for example, tape it up) or thoroughly decontaminate it after use to prevent asbestos fibre retention.
Internal sheeting on timber framework	If sheeting is attached inside the timber, it will require reinforcement: additional timber, staples taped over, continuous fabric tape at timber/polythene contact, and increased framework support.
Scaffold framework	Scaffold frameworks with internally fixed boards or proprietary metal/plastic frameworks can be used if rigidly connected or properly designed to be free-standing. For scaffold frameworks, sheeting should be fixed inside the framework. For timber frameworks, sheeting can be attached either inside or outside, with considerations for contamination and strength.

TABLE 16: Factors to consider when constructing an enclosure

Sealing joints

All joints in the sheeting material should be sealed. Where adhesive tape is used to seal joints on polythene sheeting, apply it to both sides of the joint. Vinyl tape is suitable where an enclosure is to be used for a relatively short period. For longer-term use, use fabric-based tape (such as 75mm width polycloth).

Viewing panels

The enclosure should contain enough viewing panels (and/or CCTV or webcam systems) to allow all parts of the enclosure to be visible from the outside. The clear plastic panels should be inserted into the sheeting during construction.

Panels should be taped on both sides. Panel size should be at least 600mm x 300mm unless it is impractical. Panels should be located at a convenient height for viewing (usually about 1.5m from the floor surface).

For more information, see [Section 9.8: Viewing panels](#)

Airlocks and baglocks

Airlocks and baglocks should be as big as possible to allow the necessary changing, cleaning and transfer activities for workers and waste items and bags. The airlocks and baglocks should be at least 1m x 1m x 2m (height). They will have to be bigger in situations where larger items of waste, such as sections of piping, ducting or board, are being removed.

Where space is restricted in one direction, such as along a corridor, the airlocks and baglocks should be extended in the other direction (for example, 0.8m x 2m x 2m). Separate airlocks and baglocks should be used where space allows.

Airlocks need to be constructed with access openings between each compartment which prevent asbestos dust passing from one compartment to the next. This can be done by:

- cutting vertical slits in the sheeting and fixing polythene sheets across the opening
- reinforcing the vertical opening at the top
- placing the vertical sheet on the enclosure side of the partition with an adequate overlap so that air can move inwards, but outward air movement is restricted
- weighing down the bottom of the inner flaps with timber, a metal bar, or a length of chain. This will allow flexibility in all directions to improve control of airflow
- fitting the outer compartment with a further vertical sheet (a security sheet on the outside) which is used to cover over the entrance at the end of the shift. It should be taped back onto the roof area when the airlock is being used.



FIGURE 15:
Flap arrangements
for airlocks

Floors

Cover floors with thick watertight material, such as polythene unless the existing floor has a waterproof surface which can be thoroughly cleaned after asbestos removal work is completed. Polythene can become slippery. If polythene is used, consider covering it with hardboard, or similar material to minimise this risk. Where hardboard or similar materials are used, they will need to be disposed of as asbestos waste afterwards.

9.13 Air extraction equipment

It is typically not possible to make an enclosure completely airtight, so there is always a risk of contaminated air escaping. To manage this risk, mechanical extract ventilation should be used to maintain the air pressure inside the enclosure slightly below atmospheric pressure (known as negative pressure).

This makes sure that the airflow through any leaks in the enclosure will be inwards rather than outwards, keeping asbestos dust contained within the enclosure.

This is normally done by allowing clean air to be drawn into the enclosure through the airlock with the help of an air extraction unit (called an NPU) pulling air out somewhere else in the enclosure.

Extraction units need to be able to be turned on and off from outside the enclosure. Switches should be clearly identified. When workers are not on site, reasonable steps need to be taken to prevent the enclosure and extraction units from being tampered with.


When to use air extraction equipment

Air extraction systems should be turned on before work starts, and be left running continuously throughout the removal work, including when workers are not on site.

If it is not reasonably practicable to leave the system running continuously during normal workdays, it should be left on during breaks and for at least one hour at the end of each shift to clear the enclosure of airborne dust. During these times, access points to the enclosure should be closed and sealed. Automatic time-delay switches can be used for this purpose.

POSITIONING OF NPUS

NPUs should be located opposite the airlocks. Figure 16 shows the ideal position. However, the exact location will depend on the layout and shape of the enclosure and the accessibility, and the suitability of walls for setting up equipment.

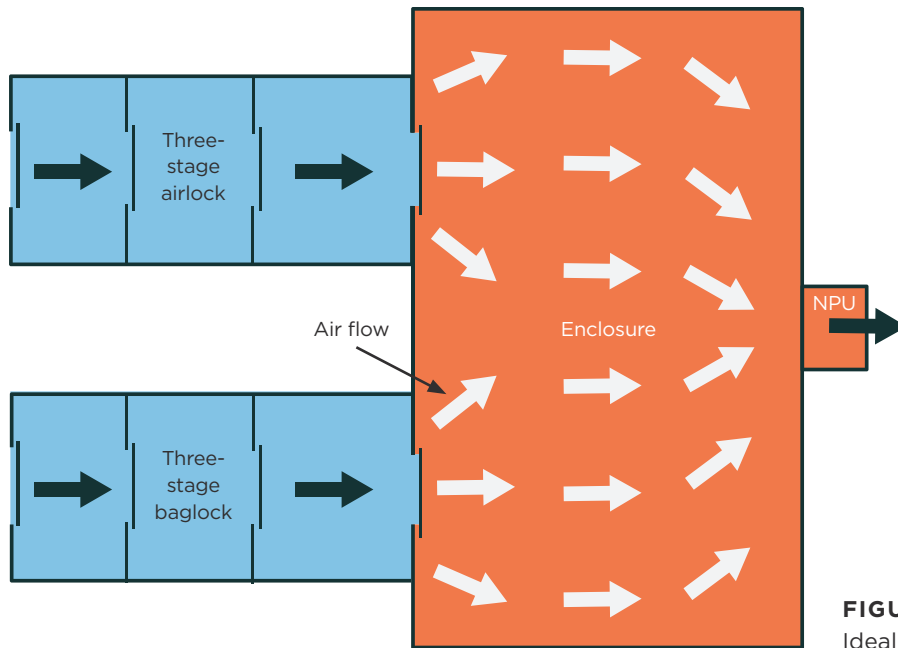

NPUs should be positioned so the airflow passes through most of the enclosure. Avoid setting up NPUs near to the air intake area as this will limit the airflow to that immediate area. Ducting within the enclosure can be used if the NPU cannot be placed directly in the best location.

Figures 17 and 18 show examples of good and poor airflow management.

NPUs should normally be located outside the enclosure with only the pre-filter visible from the inside. If flexible ducting is required inside the enclosure, the pre-filter will also be inside the enclosure. Any damage to the ducting could allow the pre-filter to be bypassed. Flexible ducting should be protected and regularly inspected to make sure there is no damage.

Larger or more complex enclosure set ups may require additional air inlets than just the airlock. PCBUs should consider taking advice from an appropriately qualified ventilation expert when deciding where to position additional intakes and NPUs. Any additional air inlets should have filtration (pre-filter) in them and be sealed if the enclosure is left overnight with the NPUs turned off.

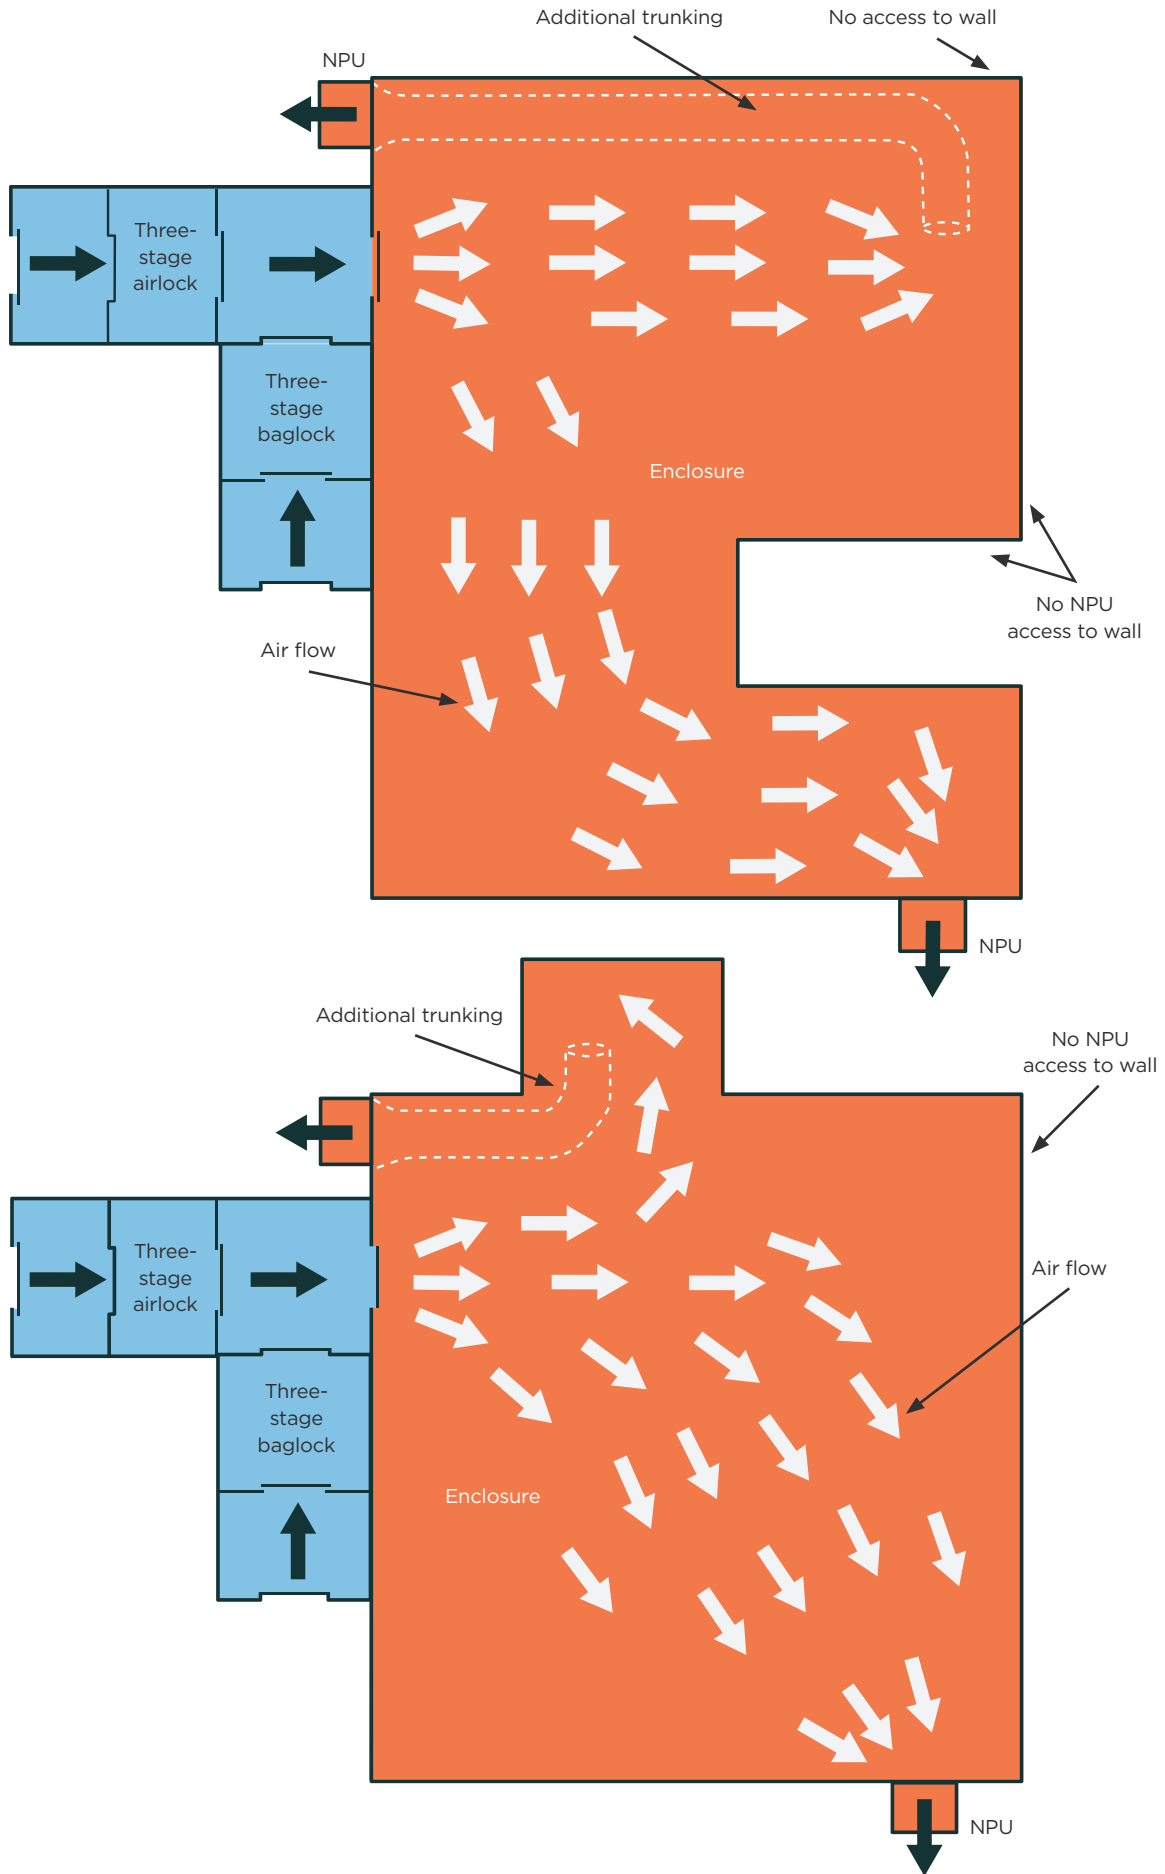


FIGURE 17: Good airflow management in buildings of different shapes

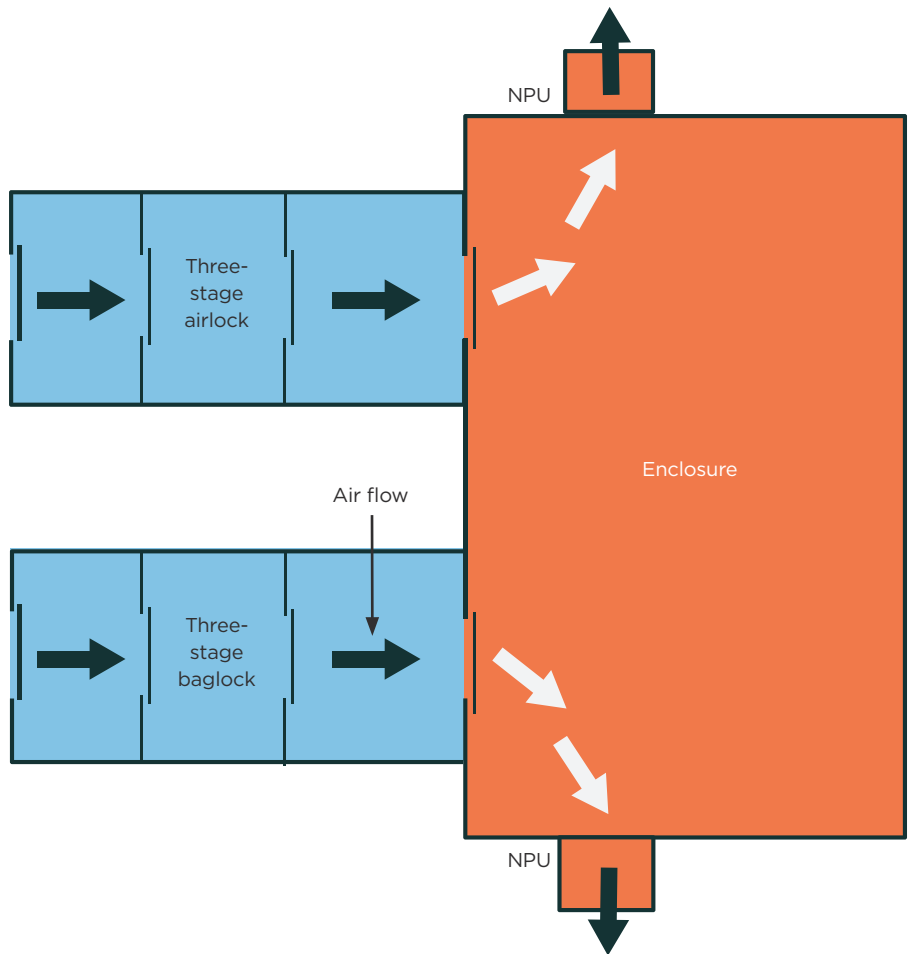


FIGURE 18:
Example of POOR
airflow management
in a building

Required features of NPUs

Extract ventilation (NPUs) should be provided by a purpose-built unit incorporating a fan and suitable filters.

Table 17 shows the main characteristics of an NPU for asbestos removal.

CHARACTERISTIC	REQUIREMENTS
Filtration	<ul style="list-style-type: none"> - The system must incorporate a HEPA filter with at least 99.995% efficiency. - The HEPA filter must be installed on the negative pressure side of the fan and sealed to prevent leakage. - To extend its lifespan, a coarse pre-filter and possibly a second high-efficiency filter must be included. - The unit must be tested altogether to make sure at least 99.995% efficiency.
Fan performance	<ul style="list-style-type: none"> - The fan must run for extended periods and sustain its rated airflow against resistance from filters, ducting, and wind pressure. - Allow for airflow losses due to ducting: 0.05-0.07m³/s (100-150 CFM) per 6m length. - A centrifugal fan is recommended. - Typical fan sizes range from 0.084-2.36m³/s (200-5000 CFM).
Construction	<ul style="list-style-type: none"> - The system must be built for continuous operation and withstand wear and tear, transportation, and rough handling.
Reverse flow damper	<ul style="list-style-type: none"> - A damper or similar device must be installed to prevent reverse airflow due to fan failure or wind conditions. - Reverse airflow could create positive pressure, leading to unfiltered air leakage.

CHARACTERISTIC	REQUIREMENTS
Indication of flow	<ul style="list-style-type: none"> - An airflow indicator (manometer or similar device) must be installed. - A visual or audible warning should alert for low airflow (for example, due to filter blockage). - Low airflow is defined as falling below the unit's specified output, linked to the minimum eight air changes per hour (see Calculating ventilation rates, below) - The manometer reading should be checked at the start of each shift.
Discharge ducting	<ul style="list-style-type: none"> - Extracted air must be safely discharged outside, away from air intakes, windows, and occupied areas. - Preferably discharge away from building sides or obstructions to avoid back pressure in high winds. - The length and diameter of the ducting depend on the extractor type and exhaust outlet diameter.

TABLE 17: Main characteristics of a good NPU

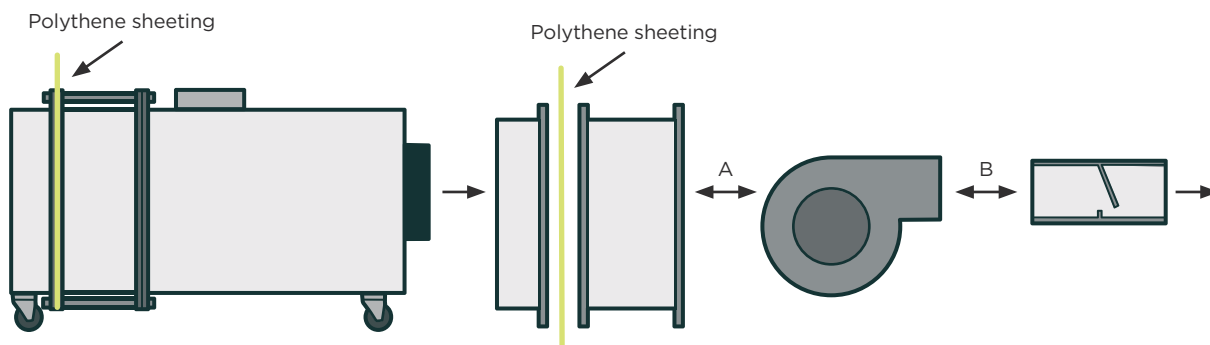
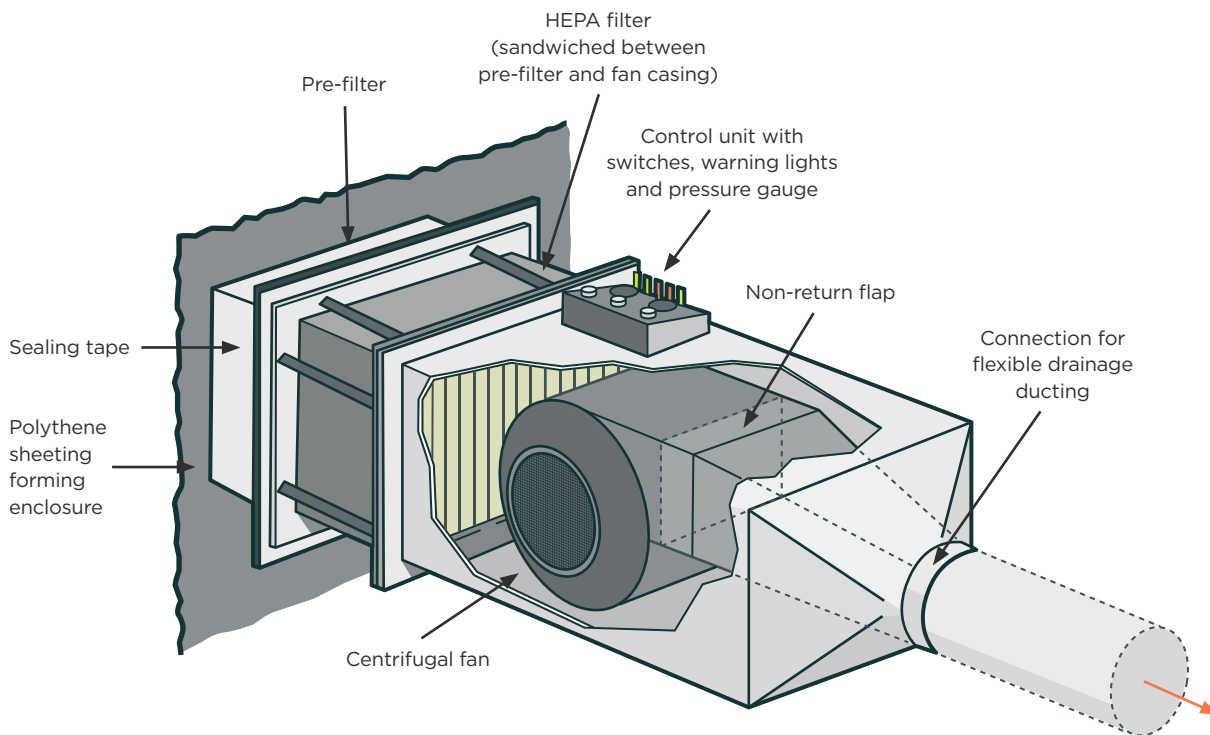


FIGURE 19: The main characteristics of a good extract ventilation system

Filter replacement

Pre-filters may need to be replaced during a job. The pre-filters should be accessible from inside the enclosure without disturbing the HEPA filter. When the pre-filter is being replaced the fan should be turned off and removal work should stop.

Replacement of the final high efficiency filter is more complex and will require special precautions. The whole NPU should be removed from the enclosure and replaced. Filter replacement would subsequently be carried out by a competent trained person wearing adequate PPE under controlled (ventilated) conditions elsewhere.

After replacement of the HEPA filter, the NPU should be DOP (dispersed oil particulate) tested to make sure that the filter is correctly installed and sealed.

Calculating ventilation rates

The rate of ventilation required to achieve the right level of negative pressure within the enclosure will depend on several factors:

- the extract flow rate
- the extent of leakage from the unit
- the volume of the enclosure and the volume of the airlock and baglock.
- allowances for reduced airflow due to the filters and ducting
- external influences (such as wind pressures).

The ventilation rate selected on the unit will only be a guide to the negative pressure within the enclosure because the actual pressure will depend on these factors.

The exact ventilation requirements will vary between set-ups and should be determined on a case-by-case basis. A minimum flow rate of 0.2m³/s for each 100m³ of enclosed volume should be used. This is equivalent to approximately eight air changes per hour in the enclosure.

Where there are difficulties in getting an effective seal, over-extraction can be used to compensate. Extraction rates should not be excessive as this can cause damage to the integrity of the enclosure (such as causing the walls to collapse inwards).

In very large enclosures, maintaining internal negative pressure may be difficult. In these cases, the work areas should be divided into multiple smaller enclosures. For more information, see [Section 9.5: Enclosure design and main features](#)

Example: Method using smoke to check for an adequate ventilation rate

Assuming eight air changes an hour is required, measure the time smoke from a smoke machine takes to clear the area after it is turned off.

Since 60mins/8 = 7.5 mins, the smoke should take about 7 mins 30 sec to clear.

Anything quicker than 7 mins 30 sec will be greater than the best practice threshold. If the smoke takes longer than 7mins 30 sec to clear, the ventilation rate is not high enough.

Note: If the removal process involves opening other parts or sections of the premises, such as when removing ceiling tiles or dividing walls, the ventilation rate should be calculated based on the total enclosure volume, which includes the initial area and the ceiling void.

9.14 Testing, monitoring, and maintenance

For friable asbestos removal, the enclosure should be regularly tested and systematically monitored by the licensed removalist to make sure it is functioning correctly. Checks should include:

Before work starts:

- a visual inspection
- smoke test.

Before each shift:

- a visual inspection
- checking the NPU pressure gauge.

If the building is occupied:

- daily checks with smoke tubes and pressure testing inside the enclosure
- additional daily air sampling:
 - in the vicinity of the enclosure
 - near weak spots (such as sealed joints)
 - near airlocks and NPU discharge point(s).

In other situations (such as unoccupied buildings), the same tests should be done soon after work starts and then periodically.

Recording testing, monitoring and maintenance activity

Procedures for testing and monitoring should be clearly documented. It should include the required frequency of inspections.

Nominate a trained and competent person to be responsible for:

- making sure testing and monitoring is done at the agreed intervals
- recording the results of inspections, monitoring and maintenance in a logbook.

All tests, test results, monitoring, and maintenance activity should be recorded, and the records should be readily accessible, for example by:

- recording details in a logbook that is always kept onsite and accessible
- recording details electronically in a way that can be accessed without difficulty.

Managers or supervisors should inspect records frequently to make sure procedures are being followed.

Visual inspection

Before removal work starts and before each shift, the enclosure should be visually inspected to make sure that it has been constructed correctly and that it is effectively sealed. For example, the following should be checked:

- seals
- airlocks
- joints
- the fitting of sheeting around irregular objects such as pipes, pipe trays, and conduits.

Using smoke to test for leaks

Before removal work starts, the enclosure should be tested by releasing smoke from a smoke generator inside the enclosure with the air extraction equipment switched off (Figure 18). Escaping smoke indicates leaks which need to be dealt with, as far as possible.



FIGURE 20:
An enclosure being
smoke tested

Once the enclosure is full of smoke, all external areas should be checked for the presence of smoke. This should include any less obvious locations where smoke could emerge such as:

- any floors above and below
- through cavity walls.

Smoke tests should be witnessed by an independent licenced asbestos assessor to ensure impartiality of the testing.

Leaks may not always be easy to spot. Smoke may take some time to emerge such as in complex buildings, or where enclosure walls have multiple folds and pleating. The visual check should be done over a sufficient period to allow any smoke to become detectable.

Even minor leaks can result in significant contamination of adjacent areas.

Minor leaks can be detected by shining a torch beam along the area being checked. Minor releases of smoke will be shown up across the beam of light.

Consider doing smoke tests daily if the risk assessment shows it is needed. For example, when there will be occupants in other parts of the building, or where the work is being done near areas such as schools or childcare centres.

Using smoke to test airflow

Smoke can also be used to assess airflow inside the enclosure. After leak testing is complete, turn the air extraction equipment back on and look to see how the smoke clears. Areas where smoke remains concentrated or is slower to clear can indicate dead spots where additional extraction may be needed.

Testing air extraction equipment

Once the smoke has been cleared and any leaks eliminated as much as possible, the enclosure needs to be further tested to make sure there is slight negative pressure being maintained when the extraction equipment is running. If negative pressure is achieved the airlock flaps should be lifted by the airflow through the system and the enclosure walls will bow inwards ensuring that any residual leaks are inwards.

Any additional leak testing can be performed externally using smoke tubes, while the air extraction equipment is running, noting any smoke sucked inside. Smoke tube testing should be carried out around the seals and joins to make sure they are effective.

Checking differential pressure monitors

Before each shift, differential pressure monitor gauges should be checked to make sure negative pressure is being maintained inside the enclosure. They help make sure that air is not leaking out into the building.

A pressure difference of 5 Pascals or more (0.5mm water gauge) is usually enough to prevent air from escaping.

The person nominated to check differential pressure monitors should be trained on how to check monitors and interpret readings correctly.

External factors can affect air pressure, such as:

- wind and drafts (from open doors/windows) which can affect readings by changing air pressure inside the enclosure
- varying pressure between different parts of the enclosure.

Note: Using a differential pressure monitor does not remove the need for smoke testing.

Daily inspections and maintenance

At the start of every shift (especially for occupied buildings), a visual check should be done to make sure:

- there are no breaches in the enclosure
- the enclosure sides are pulled inwards (showing negative pressure is maintained)
- the NPU is functioning correctly. Check the NPU pressure gauge to confirm airflow is adequate
- the enclosure walls remain taut
- the airlock flaps are positioned correctly.

Smoke tests should be done daily if the risk assessment requires it.

Viewing panels

Viewing panels should be checked frequently and cleaned as necessary to make sure it is easy to see in the enclosure.

Airborne dust adhering to viewing panels can indicate excessive dust generation within the enclosure. If they need to be cleaned regularly, this may indicate poor or ineffective stripping techniques.

Air monitoring

Air monitoring is used to confirm that control measures are working effectively.

For example:

- that the enclosure, airlocks, and air extraction equipment are working effectively
- that no asbestos has spread outside the enclosure.

Air monitoring is required for all Class A asbestos removal and may be needed for some Class B removal work.

For Class A removal work:

- air monitoring must be done by an independent licensed asbestos assessor
- air monitoring must be done during the removal work and next to any negative pressure enclosure
- the licenced assessor may require air monitoring before the work starts if they think the air might have asbestos fibres at levels higher than trace amounts.

For more information on air monitoring see [Section 10.0: Air monitoring](#)

Testing and maintaining air extraction equipment

Workers in charge of operating and maintaining air extraction plants must be trained on how to operate the system correctly. A competent person needs to properly install and inspect the system before use to make sure it is in good condition and correctly assembled.

Set up a maintenance schedule that includes instructions on what to do if the unit fails or does not meet specified performance, for example by stopping work and replacing the equipment.

Air extraction equipment must be examined and tested at least every six months by a trained and competent person. This process typically involves:

- thorough decontamination
- dismantling of the equipment
- a detailed visual inspection to confirm all components are in good working order
- replacing all filters unless there is no significant loss of airflow.

The performance of the unit should be checked after reassembly to make sure the airflow through the unit and the pressure drop across the HEPA filter still meets the manufacturer's specification.

Where the airflow has dropped below its design capacity (for example, a 2000 CFM unit is only achieving 1500 CFM), this should be clearly marked on the unit itself and the lower figure used in ventilation calculations.

A record of all inspections, examination, maintenance, and any defects related to air extraction units must be kept available for inspection.

9.15 Dismantling and disposal of enclosures

After the asbestos removal work has finished, and clearance inspection stages 1 to 3 have been completed (see [Section 13.0: Clearance inspections](#)), the enclosure can be dismantled.

Exposure risks during dismantling

Dismantling the enclosure should be done carefully and methodically. Workers should regularly check for any hidden asbestos that may be uncovered during dismantling. Asbestos fibres can remain trapped in parts of the enclosure such as between polythene sheets or other crevices or corners. Workers should wear PPE, including coveralls and half-masks while dismantling.

Polythene sheeting removal

To reduce the risk of releasing asbestos fibres from polythene sheeting during dismantling workers should:

- spray the polythene sheeting with PVA sealant
- carefully remove, roll or fold, and place sheeting in waste bags immediately
- dispose of sheeting as asbestos waste – do not reuse sheeting.

Dealing with contamination

If contamination is found during dismantling, further decontamination must be done, and the visual inspection and air sampling (see [Section 13.0: Clearance inspections](#)) must be repeated.

Negative pressure unit (NPU)

Make sure the NPU is sealed before transport. It can either be taken to the next job or sent for decontamination if needed. Do not send equipment for maintenance unless it has been decontaminated first.

Cleaning access equipment

To make it easier to clean access equipment afterwards, prepare and protect access equipment from contamination before taking it into the enclosure.

For example:

- cap scaffold tube ends
- cover boards with polythene (unless it creates a slipping hazard)
- protect working parts of mobile equipment working platforms (MEWPs) with robust, adjustable sheeting (make sure to allow for exhaust gas dispersion).

Decontaminate all exposed items before site clearance.

Final inspection

After removing all equipment, partial enclosures, or protective sheeting the independent licenced assessor will conduct a final visual inspection as a stage of their clearance inspection. For more information see [Section 6.3 of the Asbestos assessments – good practice guidelines](#)

Reassurance sampling

Reassurance sampling may be done post-certification to confirm no residual asbestos risk. This is not part of the formal clearance but may be needed for inaccessible crevices, complex equipment, or porous materials. See [Asbestos assessments – good practice guidelines](#)

Site clearance without an enclosure

The licenced assessor should follow the normal Class A clearance inspection process with adjustments: perform a preliminary check of site condition, thorough visual inspection, and decide on what Stage 3 steps of the clearance inspection (surface testing air monitoring) are required based on the circumstances.

See [Asbestos assessments – good practice guidelines](#)

9.16 Emergency procedures

Responding to incidents or injuries

Removal work often involves working at height or in confined spaces within enclosures. These types of work activities carry their own risks that must be controlled. Emergency procedures for evacuating ill or injured workers from enclosures must be planned and these details should be included in the removal plan.

An adequate number of workers should be trained on how to provide appropriate first aid without unnecessarily exposing themselves or others to asbestos.

For example:

- if the victim can be moved safely, they should be taken outside the enclosure
- follow safe procedures for removal of a victim's respirator.

Decontamination should be performed as much as possible, by vacuuming themselves, the victim, and sponging down RPE and boots. However, evacuation of a seriously ill or injured person should not be delayed by overcomplicated decontamination efforts.

Safety of emergency responders

Removalists must include procedures in emergency plans about the potential presence of asbestos to warn emergency responders in advance, so they can prepare for related hazards. Spare disposable protective clothing and RPE should be available for emergency responders who lack their own equipment.

In cases where emergency responders have had to administer treatment inside the enclosure, they should decontaminate themselves in the DCU afterward.

Evacuation procedures

Workers should be familiar with emergency evacuation procedures for the premises where they are working. This should be covered in the site induction and include:

- location of fire alarms and fire extinguishers
- making sure alarms can be heard from inside the enclosure
- location of emergency exits and escape routes
- emergency access to and from the enclosure.

In an emergency requiring evacuation, prioritise leaving the premises, but do not let decontamination delay escape. Leaving the premises first must come first.

If RPE inhibits escape (for example limits the field of vision), it should be removed inside the enclosure. After reaching safety, PPE and RPE should be decontaminated as much as possible.

10.0

Air monitoring

IN THIS SECTION:

- 10.1 What is air monitoring?
- 10.2 When is air monitoring required?
- 10.3 Who can do air monitoring?
- 10.4 How often should air monitoring be done?
- 10.5 Assessing air monitoring results
- 10.6 Action to take if asbestos fibres are exceeded
- 10.7 Communicating air monitoring results
- 10.8 When the workplace is a home

Use air monitoring to measure airborne asbestos levels to help check if control measures are working effectively.

10.1 What is air monitoring?

Air monitoring is a process of measuring the concentration of airborne asbestos fibres to evaluate the effectiveness of asbestos removal control measures.

The purpose of air monitoring is to show:

- that control measures (such as wet stripping) are effective and being properly used
- that the RPE worn is sufficient to provide adequate protection (in addition to primary control measures).

Other reasons for carrying out air monitoring include:

- benchmark monitoring before asbestos removal starts
- during Stage 3 of the four-stage clearance procedure (see [Section 13.0: Clearance inspections](#))
- leak sampling to check the ongoing integrity of the enclosure (see [Section 13.0: Clearance inspections](#))
- reassurance air sampling after removal work has been completed.

There are two main ways to do air monitoring:

- static monitoring where monitoring stations are in specific areas inside and outside of an enclosure (including near transiting routes)
- personal air monitoring where workers wear portable air monitoring devices.

The data from personal air monitoring devices may be used to inform worker exposure data as well ([Section 19.0: Exposure monitoring](#)).

Static air monitoring results cannot be used for worker exposure monitoring.

10.2 When is air monitoring required?

Air monitoring is required in certain situations, as shown in Table 18.

FOR CLASS A LICENSED ASBESTOS REMOVAL WORK	FOR CLASS B ASBESTOS REMOVAL AND UNLICENSED ASBESTOS REMOVAL
<p>Air monitoring must be done:</p> <ul style="list-style-type: none"> - immediately before Class A asbestos removal work starts (if the licensed asbestos assessor determines it is likely the air contains respirable asbestos fibres in concentrations greater than trace level) - during Class A asbestos removal work - during Stage 3 of the clearance inspection unless no enclosure is in place and Stage 3 is not feasible . 	<p>Air monitoring is not required but may be carried out to check if the asbestos removalist is:</p> <ul style="list-style-type: none"> - complying with their duty to eliminate or minimise exposure to airborne asbestos - not exceeding the airborne contamination standard for asbestos. <p>Air monitoring should also be considered if the asbestos removal work is being done in, or next to a public location.</p>

TABLE 18: When to perform air monitoring

10.3 Who can do air monitoring?

Air monitoring can be carried out by specific people, as shown in Table 19.

FOR CLASS A ASBESTOS REMOVAL WORK	FOR CLASS B OR UNLICENSED ASBESTOS REMOVAL WORK
<ul style="list-style-type: none"> - An independent licensed asbestos assessor. 	<ul style="list-style-type: none"> - a licensed asbestos assessor, or - a competent person.

TABLE 19: Who can carry out air monitoring

For detailed information on what makes an assessor independent, see [Asbestos assessments – good practice guidelines](#)

A **competent person** is a person who has relevant industry experience, skills, and knowledge. They must also hold either of the following qualifications:

- a certificate from a training course, specified by WorkSafe for asbestos assessor work
- a tertiary qualification in occupational health and safety, occupational hygiene, science, or environmental health.

For detailed information, see [Section 2.0: The role of an assessor in the Asbestos assessments – good practice guidelines](#)

10.4 How often should air monitoring be done?

Class A air monitoring should be done once work starts and continue throughout the duration of the work until the clearance inspection is started. It should be used to confirm that control measures such as dust suppression, enclosure, airlocks, and air extraction equipment are working effectively, and no asbestos has spread outside the enclosure/work area.

The requirement for monitoring and its extent will depend on the nature of the work and location. The licensed asbestos assessor will decide the best air monitoring strategy for the work.

Class A air monitoring in the vicinity of the NPU discharge outlet(s) is necessary where it vents inside the building. This is particularly important if it has been necessary to replace the NPU during the operation. NPUs should always vent to outside the building wherever possible. Venting inside a building creates additional risk for any building occupants especially if a fault occurs. Venting inside a building should be done in exceptional circumstances only

The frequency of air monitoring during Class B removal is to be decided by the assessor based on site specific risk assessment and/or requirements of the commissioning PCBU.

For detailed information, see [Section 4.0: Asbestos assessments – good practice guidelines](#)

Developing an air monitoring plan

The asbestos assessor will develop a plan to make sure that the correct monitoring is done at the correct times, and that monitoring will test a representative range of jobs and work methods (see [Section 4.0: Asbestos assessments – good practice guidelines](#)).

Occupational exposures can vary from day to day and even throughout a shift. The plan should take account of the range of circumstances and conditions that can occur. For example, different:

- asbestos types
- work methods
- work areas, or transit routes
- work durations.

Air sampling results should be used to inform and modify control measures as necessary.

10.5 Assessing air monitoring results

The asbestos assessor should interpret the results and provide advice if any action needs to be taken, particularly if results show that respirable asbestos fibre levels are exceeding prescribed action levels.

For more information on assessing monitoring results, see see [Section 4.4: Asbestos assessments – good practice guidelines](#)

Data from personal air monitoring can be included in exposure data for the worker who was wearing that monitoring device. For more information, see [Section 19.2: When and how exposure monitoring should be done for removal work](#)

10.6 Action to take if asbestos fibres are exceeded

During Class A removal work, if the results of static air monitoring outside the enclosure show that respirable asbestos fibre levels exceed the prescribed action levels, the licensed asbestos removalist must take immediate action.

Table 20 below summarises the prescribed action level and actions for Class A asbestos removal static air monitoring (outside of enclosures).

ACTION LEVEL	CONTROL	IMMEDIATE ACTION
< 0.01 fibres/ml (trace level)	No new control measures are necessary	Continue with existing measures.
≥ 0.01 fibres/ml but < 0.02 fibres/ml	1. Investigate	Investigate the cause.
	2. Implement	Put controls in place to prevent exposure.
	3. Prevent	Prevent further fibre release.
≥0.02 fibres/ml	1. Stop	Order all asbestos removal work to stop straight away.
	2. Notify	Notify WorkSafe as a notifiable incident as soon as possible. Include the results of the air monitoring.
	3. Investigate	As soon as possible: 1. Determine the cause of the high fibre levels. 2. Conduct a thorough visual inspection of the enclosure (if used) and associated equipment in consultation with all asbestos workers. 3. Review controls.
	4. Put controls in place to prevent exposure and further asbestos fibre release	As soon as possible: 1. Extend the isolated/barricaded area around the work area/enclosure so far as is reasonably practicable (until fibre levels are at or below 0.01 fibres/ml). 2. Wet-wipe and vacuum the surrounding area, seal any identified leaks (for example, with expandable foam or tape). 3. Smoke test the enclosure until it is satisfactorily sealed.
	5. Conduct further air monitoring	Do not re-start until fibre levels are at or below 0.01 fibres/ml.
	6. Retain records for five years	

TABLE 20: Class A asbestos removal static air monitoring actions (outside enclosure)

If asbestos fibre levels exceed 0.1 f/ml for any other type of work (Class B, unlicensed, asbestos-related) the results must also be shared with the parties listed in [Sections 10.7](#) or [10.8](#)

10.7 Communicating air monitoring results

For Class A asbestos removal, the PCBU who commissions the licensed asbestos removal work must make sure air monitoring results are given to:

- workers at the workplace
- worker representatives
- PCBUs at the workplace (including the licensed asbestos removalist)
- other people at the workplace
- other people living or working in the vicinity of the workplace if it is likely they may be affected by the contamination (so far as is reasonably practicable).

10.8 When the workplace is a home

If the workplace is a home, the licensed asbestos removalist must make sure the results of the air monitoring are given to:

- the PCBU who commissioned the work, such as the landlord or property management company
- workers at the workplace
- worker representatives
- PCBUs in relation to the workplace
- the occupier of the home
- the owner of the home (if not the occupier)
- other people at the workplace.

11.0

Controlled removal and repair techniques

IN THIS SECTION:

- 11.1 Choosing an asbestos stripping technique
- 11.2 General good practice for stripping
- 11.3 Controlled wetting by injection
- 11.4 Controlled wetting by spraying
- 11.5 Dry stripping with control at source
- 11.6 Uncontrolled dry stripping
- 11.7 Managing other risks during asbestos removal work
- 11.8 Removing asbestos waste from the enclosure
- 11.9 Site cleaning and preparation for four-stage clearance
- 11.10 Approval of methods for managing risks associated with Asbestos

Controlled techniques help minimise risk during removal and repair of asbestos and asbestos-containing materials (ACMs).

This section focuses mainly on stripping methods for friable asbestos. Information sheets outlining approved methods for the removal of various [non-friable asbestos removal safe work practices](#)

This guide does not cover asbestos in soil. For detailed information about remediation or removal of asbestos in soil see [New Zealand Guidelines for Assessing and Managing Asbestos in Soil](#)

11.1 Choosing an asbestos stripping technique

There are two main types of controlled stripping techniques:

- controlled wet stripping
- dry stripping with control at source.

For more information on using these methods safely, see [Sections 11.3: Controlled wet stripping](#) through to [Section 11.5: Dry stripping with control at source](#)

There are several factors to consider before deciding what stripping technique, or combination of techniques, to use. These should be detailed in the risk assessment and ARCP).

Factors to consider include:

- the requirement to minimise the amount of fibres generated at the point where asbestos is being stripped:
 - choose the stripping method (or combination of methods) to cause the least amount of disturbance
 - minimise disturbance in the enclosure to keep air concentrations lower, help keep workers safer and make later decontamination easier
- the type of asbestos being removed
- any coatings applied to the asbestos (this can affect how easy it is to wet the asbestos)
- how the asbestos is attached (for example, screws, nails, clips, or glue)
- what the asbestos is attached to (for example, asbestos applied onto a bituminous layer). This can affect the ease of removal
- what the most appropriate wetting method is for the type of product (spray or injection, or both)
- the location of the asbestos and ACM and the nature of the work area, such as accessibility and environmental conditions.
- the need to prevent the escape of asbestos fibres from the enclosure to the general environment.

In addition to the requirement to keep exposure to asbestos as low as reasonably practicable, removalists need to make sure their chosen stripping method does not create other risks. For example, the:

- presence of live electrical equipment may prevent, or restrict, the use of controlled wet stripping
- presence of chemicals may present a direct risk to the workers or prevent the use of controlled wet stripping techniques
- use of wetting agents may create a risk of slips. This is particularly important when working at height.

See [Section 11.7: Managing other risks during asbestos removal work](#) for more information.

11.2 General good practice for stripping

Table 21 below shows general good practice for stripping asbestos.

GOOD PRACTICE	DETAILS
Worker training	Provide adequate training, including refresher training, on controlled stripping techniques. Site supervisors require more detailed training to oversee work effectively.
Site supervision	Maintain close supervision to make sure control measures and safe work methods are followed. Use viewing panels in enclosures to monitor workers.
Maintenance of equipment	Regularly maintain all equipment to make sure it operates effectively throughout the work.
Waste control	Use good waste management practices, such as clearing waste as work progresses to maintain a safe and controlled environment.
Avoid breakage wherever possible	Always attempt to remove asbestos and ACM (such as AIB) without breaking it. Where breakage is the only option, use wetting on exposed surfaces to prevent dust being created. Use shadow vacuuming as well.
Removing nailed boards	Spray any unpainted surfaces first then place heavy-duty tape over the areas where there are nails and carefully ease the board away from the wall using a crowbar (or similar) without breaking the board. Once a nail has been exposed between the board and other surface, if possible, cut the nail.
Locating hidden nails or screws	Use magnets to locate screws or nails which have been hidden by paint or other coatings. If the nails or screws cannot be easily found use the method for removing glued boards.
Removing glued boards	If the boards cannot be easily lifted without breaking, then scribing and breaking can be used. This should only be used if other safer methods will not work as there can be significant fibre release. Use wetting and shadow vacuuming to minimise fibre release.

TABLE 21: Good practice for asbestos stripping

This section focuses mainly on stripping methods for friable asbestos. Information sheets outlining approved methods for the removal of various [non-friable asbestos removal safe work practices](#)

Using wetting agents

The amount of asbestos fibre released during removal can be reduced by soaking or wetting the asbestos with water or a wetting agent. Wetting agents contain additional chemicals to help penetrate ACM (such as an added surfactant). Even though some types of asbestos can be wetted just with water, wetting

agents should always be used, as a mixture of asbestos types may be present. Some wetting agents can also ease removal by loosening the binding agents within the ACM.

Wetting agents should always be used according to the manufacturer's instructions.

PPE, including RPE, should always be used when injecting or applying wetting agents.

Asbestos stripping workers should receive specific and detailed training in the use of controlled wet stripping techniques, and in the problems which may be encountered.

Wetting agents can be applied by injection or spraying. For more information on these techniques, see [Section 11.3: Controlled wetting by injection](#) and [Section 11.4: Controlled wetting by spraying](#)

The asbestos should be wetted all the way through to reduce fibre levels as much as possible. Table 22 lists important factors to make sure wetting is effective.

FACTORS FOR WETTING	DETAILS
Allow enough time for the wetting agent to thoroughly penetrate the ACM	<p>The time taken will depend on the type of ACM being injected:</p> <ul style="list-style-type: none"> - More porous and less dense materials, such as sprayed asbestos coatings, become saturated more quickly. - Denser and less porous materials such as hand applied pipe lagging and high calcium silicate pipe lagging may take longer. - Some materials may be removed after only 3-4 hours soaking, while others may require up to 24 hours. - With some ACMs, there is a visible colour change when adequate wetting has been achieved. - The degree of penetration and wetting should be checked by visual examination before attempting removal. <p>If the wetting agent is being used to suppress fibre release during preparation for injection, only a few minutes may be necessary.</p>
Avoid over-wetting	<p>Over wetting may cause:</p> <ul style="list-style-type: none"> - wetting agent to seep out of cracks in the asbestos - asbestos coating or lagging to become sodden, causing the asbestos to fall off under its own weight.
Check for signs that it is safe to start removal	<ul style="list-style-type: none"> - With some ACMs, there is a visible colour change when adequate wetting has been achieved. - Lagging should be of a dough-like consistency when adequately wetted. - Take small samples to check the degree of penetration and wetting. <p>When wetting by injection:</p> <ul style="list-style-type: none"> - take samples from areas further away from the pump, near the last group of needles - during testing use shadow vacuuming in case any dry patches are found - any dry patches should be sprayed immediately and then re-injected.

TABLE 22: Key factors for effective wetting of asbestos

Workers carrying out the wetting should have sufficient training and experience to judge when it is safe to begin removal. Supervisors should be available to provide advice or confirmation if needed.

11.3 Controlled wetting by injection

Injection techniques can be used when the outer surface of the asbestos is sealed, covered, or coated and the skin will prevent loss of fluid. It is particularly useful for friable insulation and coatings, such as boiler lagging or limpet.

Injection and preparation for injection should be done after the enclosure has been built and smoke tested. PPE and RPE should be worn.

When using wet injection, consider the following:

- what injection system to use
- needle type and size
- needle placement
- flow rate of wetting agent
- surface thickness to be injected.

Choose the right injection system

Injection systems come in two basic forms: multi and single point. Table 23 explains the differences between them.

MULTI-POINT SYSTEM	SINGLE-POINT INJECTION
<p>Multi-point systems have a number of needles connected together and are connected to a common injection pump:</p> <ul style="list-style-type: none"> - hedgehogs (where the needles are grouped together on a flat board) can be used for flat surfaces (Figure 21) - string of needles, usually set 10–15cm apart and linked by tubing from the injection pump can be wrapped around the item containing asbestos (Figure 22). <p>Needles in this system can be fitted with individual flow control valves which allows adjustment to make sure the appropriate volume of fluid is delivered to each needle.</p>	<p>Single-point injection systems (such as needle guns) deliver wetting agent to single small areas each time:</p> <ul style="list-style-type: none"> - they can be useful for inaccessible areas, where it is difficult to set up a multi-point unit - single-point injection systems should only be used when multi-point systems cannot be used.

TABLE 23: Comparison of multi-point and single-point injection systems

Needle type and size

Injection needles are available in many sizes and designs. The specification of the needle will depend on the characteristics of the asbestos and ACM, particularly thickness, shape, and condition.

Thin coatings or insulation (1 cm or less), such as a sprayed coating, require needles with holes at the tip, or long, angled needles. This allows the needle to be pushed into and flat with the thin coating (Figure 21). These angled needles help the lateral movement of the wetting agent.

Thick coatings or insulation require long needles with holes along their length, sufficient to penetrate the full depth of the insulation. The holes should face the substrate.

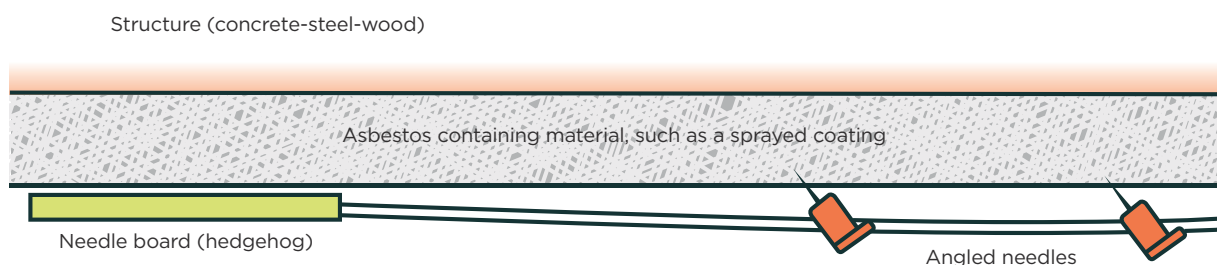


FIGURE 21: Needle board multi-point injection system for thin asbestos layers

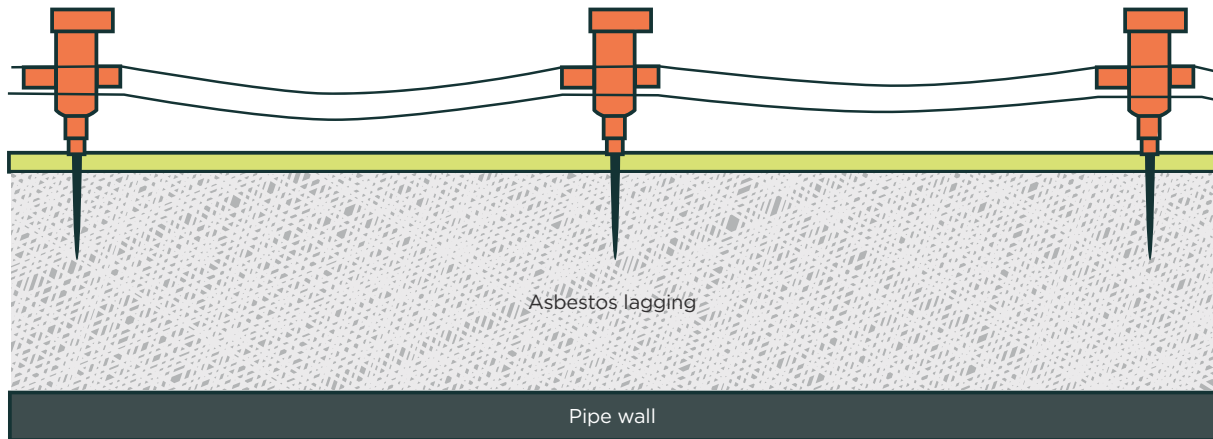


FIGURE 22: Controlled multi-point injection delivery through a network of fine needles

Needle placement

Once the needles have been selected, consider carefully where to place them:

- If needles are placed too far apart, dry patches may occur.
- The greater the number of needles, the more likely it is that uniform penetration will be achieved.
- Where reasonably practicable, place needles on the top side so gravity helps move the wetting agent through the asbestos.
- Horizontal pipes should have needles running along the top of the pipe, spaced 10-15cm apart (Figures 21 and 22), allowing the wetting solution to diffuse down from the top of the lagging.
- Large diameter pipes may need additional runs of needles, again towards the top of the horizontal pipe.
- Vertical pipes should have needles placed horizontally around the top of the pipe, allowing wetting solution to diffuse as a wet band down the lagging. They should not spiral down the pipe.
- Tall vertical pipes may need additional horizontal rings of needles every 1-2m.

Flow rate of wetting agent

Wet injection techniques should be operated at a low pressure (under 50psi) to make sure controlled, uniform wetting of asbestos and ACM. Capillary action aids penetration, with gravity assisting downward flow. Higher pressure may cause the wetting agent to follow paths of least resistance, leading to uneven wetting.

Penetrating dense or thick surfaces

For lagging covered with a cement-like layer (typically 6mm thick), holes may need to be drilled to allow needle access by either:

- using hand drills and shadow vacuuming
- drilling using a low-speed drill with a cowl around the bit and fitted with LEV.

If pipe or vessel lagging is covered in metal cladding, carefully remove it to expose the lagging. If the lagging is damaged, use airless sprays and shadow vacuuming while removing the cladding. Make sure casings that can be drilled are fully wet before continuing.

Some surfaces (such as lagging on some industrial plant) may be so thick that thorough wetting cannot be achieved in one attempt. In these cases, wetting should be done progressively:

- remove any outer layers (such as metal cladding)
- inject the material using the longest needles available, or liberally spray with a wetting agent
- allow the agent to soak into the outer layer of the lagging.
- once the outer material is wetted, carefully remove it until the material is starting to look dry again.
- re-inject or re-spray and repeat the process.

Injecting damaged ACM

Injection may disturb or break damaged asbestos. If damage is minor, use a generous amount of wetting agent. If there is a risk asbestos may fall off, or there is obvious cracking, wrap the material in impervious sheeting, tape it, and inject carefully.

Insulation that has internal cracks or varying porosity can make even wetting difficult. Position needles carefully for cracked areas and adjust flow rates for materials with variable porosity.

11.4 Controlled wetting by spraying

Spray wetting can be used in the following applications:

- where the ACM is unsealed and porous (such as thin, sprayed coatings)
- where the ACM is thin (less than 1cm thick)
- in preparation for injecting (such as before the injection of damaged pipe lagging)
- for the removal of AIB
- for asbestos textiles, including blankets and rope seals
- when used with glove bags
- when removing asbestos debris
- when working on asbestos cement.

The method of application will vary depending on the type of material.

Table 24 shows examples of how different asbestos materials are applied.

PRODUCT OR SURFACE TO BE WETTED	APPLICATION METHOD
Unsealed sprayed coatings	<ul style="list-style-type: none"> - Use a wide-angled and fine spray. - The spray should be moved continuously back and forth across the surface, avoiding disturbance. - The number of spraying passes required will depend on the material.
Unpainted AIB boards and tiles	<ul style="list-style-type: none"> - Vacuum unpainted surfaces to remove all dust and debris, then spray as described for unsealed sprayed coatings. - Once they are thoroughly wet, carefully remove by unscrewing while shadow vacuuming.
Painted IB boards and tiles	<ul style="list-style-type: none"> - Where the unpainted surface is not accessible, remove a single tile or board by unscrewing while using shadow vacuuming. A magnet can be used to locate screws hidden by paint. - Vacuum the unpainted top surface and spray it. - Once access is available to the upper surfaces of the surrounding boards or tiles, vacuum and spray them - Wetting the upper surfaces of ceiling tiles can be done using long metal tubes with holes along their length. The metal tubes can be laid on the surface of the AIB and the wetting agent fed through in a controlled manner.

PRODUCT OR SURFACE TO BE WETTED	APPLICATION METHOD
Insulating blankets, ropes, and quilts	<ul style="list-style-type: none"> - Spray wetting agents over all accessible surfaces
Hard plastered or coated surfaces	<ul style="list-style-type: none"> - These surfaces are typically impermeable to sprayed wetting agents or direct injection. - Pre-drilling holes under controlled conditions followed by injection can be used (see Section 11.3: Controlled wetting by injection). - Alternatively, remove this material by carefully cracking it while applying a fine spray: <ul style="list-style-type: none"> - Once cracks appear, the spray can be directed along the cracks to aid wetting. - The material should then be carefully removed without further breakage. Shadow vacuuming can also be used in some circumstances. - Because this material does not readily soak up wetting agent, there may be some spilling of the agent. Polythene sheeting or a suitable container should be placed under the spraying point to collect any spillage.
Small areas	<ul style="list-style-type: none"> - For relatively small applications, such as the preparation for injection or removal of AIB tiles, use hand-pressurised and operated spraying equipment, such as those used in gardening (Figure 23).
Large areas	<ul style="list-style-type: none"> - For larger areas use a low-pressure spraying machine (less than 50 psi). Multi-point tubes can be used to cover a wider area (Figure 24).

TABLE 24: Application methods for different types of asbestos materials

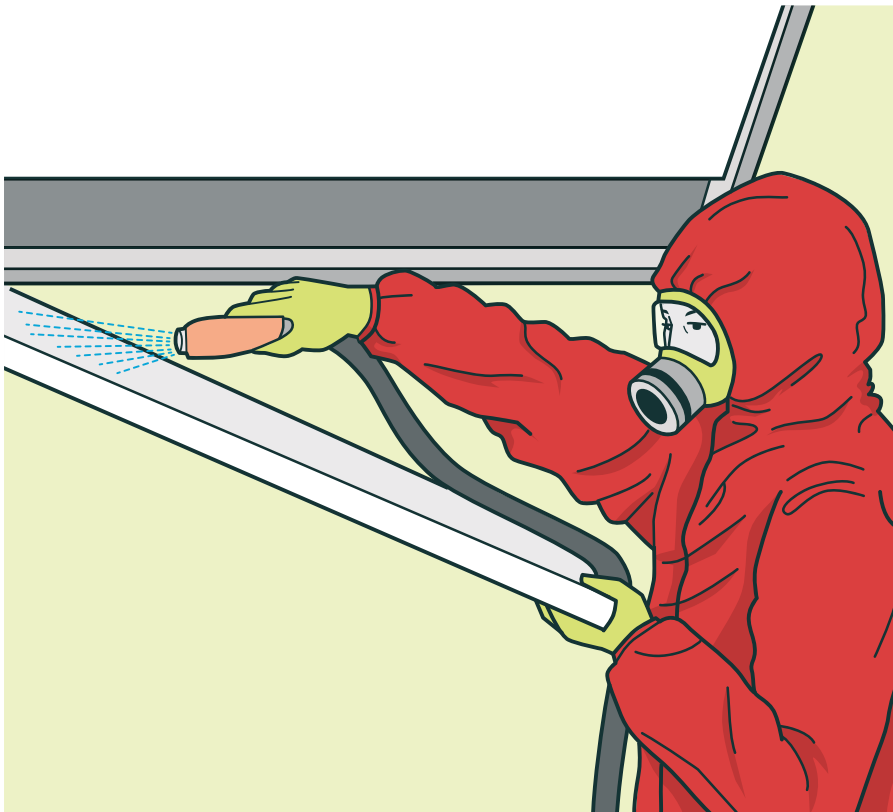


FIGURE 23:
Spraying AIB
ceiling tiles

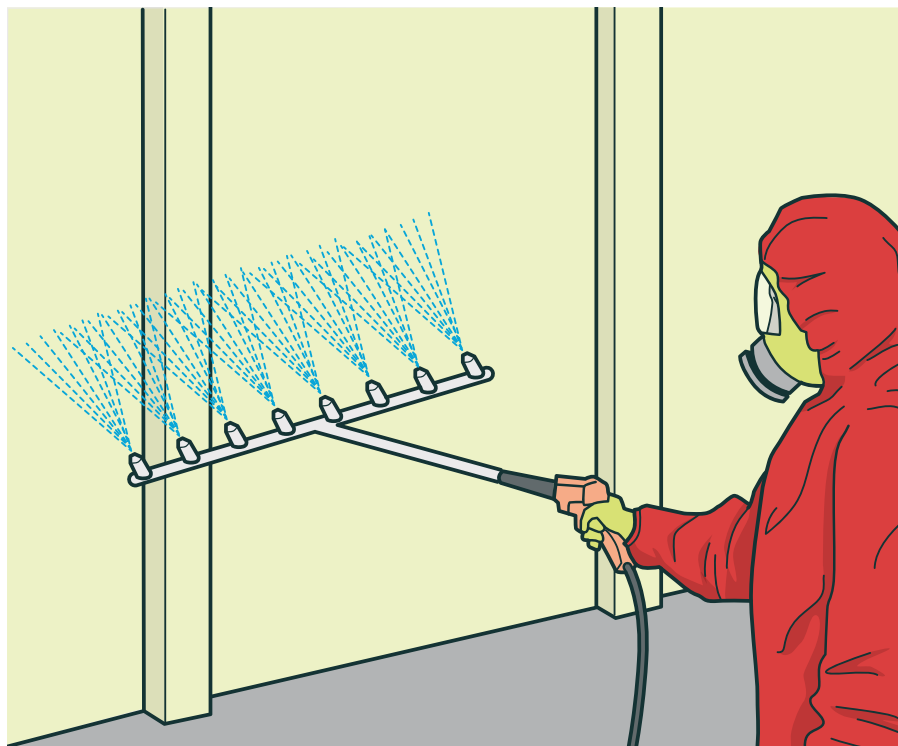


FIGURE 24:
Multi-point
spray system

Troubleshooting wet stripping techniques

There are situations where the use of wetting agents can cause other risks or problems. Control measures must be put in place to address these.

Table 25 shows control measures to address the risks of using wetting agents.

RISK	CONTROL MEASURE
Wetting agent may cause skin irritation	Workers should already be wearing full PPE when applying wetting agent. If workers are accidentally exposed to wetting agent directly on their skin check the manufacturer's safety data sheet and follow instructions on what precautions to take.
Wetting agents causing wet floor surfaces, creating slip hazards	Place drip trays or troughs under the area being treated. Where it is not possible to put down trays, put down non-slip flooring (this will have to be disposed of as asbestos waste afterwards). Any spills should be removed as soon as reasonably practicable.
Extreme temperature conditions affecting performance of wetting agent	In freezing weather conditions wetting agent may not spread properly. Wetting agents can be treated to allow for this. Liquids are also available that work at up to 240°C, although hot work should be avoided as much as reasonably practicable, see <i>Working near hot plant</i> in Section 11.7
Wetting agents staining building materials	Added dyes in wetting agents can lead to the discolouration of the fabric of the building. Use of polythene sheeting on susceptible surfaces to prevent this.

TABLE 25: Control measures for risks from wetting agents

11.5 Dry stripping with control at source

There may be some situations where it is not possible to use wet stripping techniques for safety reasons, for example, working directly by live electricians that cannot be isolated. In these circumstances, strict direct supervision and other methods should be used to control asbestos at source.

At source controls include:

- wrap and cut
- glove bags
- direct vacuuming
- enhanced air management.

Ventilated enclosures are not considered a control at source

Ventilated enclosures do not provide control at source. They do not regulate fibre release at the point of removal. Their primary purpose is to reduce the spread of asbestos.

Wrap-and-cut

Wrap-and-cut is where the asbestos is left in-situ on or in the object (such as a piece of plant or lagged pipework) and the entire object is wrapped up/sealed and removed.

Enclosures are usually still required when wrap-and-cut methods are being used. Always wear full PPE and RPE while wrap-and-cut methods are used.

Wrap-and-cut is only suitable in certain circumstances:

- The object is no longer needed or will be replaced.
- Any contents of the object have been removed.
- The object has been cleaned, where necessary, to remove any residual hazardous materials.

The object needs to be manageable in size:

- Ideally it should be small enough to be removed through the baglock and fit inside waste containers for transporting.
- It needs to be small enough that workers can handle it without causing injuries.
- If it is too big there is a greater chance of the polyethene sheeting ripping during handling.
- Some disposal facilities may have size limits for wrapped waste.

Wrapped items too large to pass through the baglock should remain in the work area until the four-stage clearance has been completed and the enclosure removed. These items will be subject to the four-stage clearance process.

For more information, see [Section 13.0: Clearance inspections](#)

Wrap-and-cut does not eliminate asbestos disturbance or release. For example, when lagging needs to be removed to allow cutting of the exposed pipework, or from disturbing damaged areas of lagging.

The following steps will help minimise disturbing asbestos when wrapping and cutting lagging:

- Treat lagging with a penetrating encapsulant which will bind the asbestos fibres together.
- Wet the lagging using injection or spraying with a wetting agent.
- For small areas of damage near the area to be wrapped and cut, seal with polythene sheeting and tape.
- Where there are several areas of damage along a length of pipework, the entire run can be dampened using sprays and wrapped in polythene sheeting.
- Glove bag systems can also be useful for stripping short sections of pipework (see *Glove bags* in [Section 11.5: Dry stripping with control at source](#))

Dividing pipework or plant into manageable sections

Long stretches of pipe work will have to be reduced before they can be removed:

- Look for breaks in the lagging where flanges could be unbolted or pipe hangers removed, or the bare pipe cut without disturbing the asbestos.
- Where such breaks do not occur naturally, or if they are not at convenient positions, short sections of lagging will have to be removed.
 - Make sure enough lagging is removed to allow cutting/burning to take place, without disturbing the remaining asbestos. At least 20–30cm of pipework should be exposed.
 - Wrap the lagging with heavy-duty polythene and seal the end sections securely with tape.
- Pipework can be cut using:
 - hacksaws for very small diameter pipes.
 - abrasive cut-off wheels and flame-cutting techniques for larger diameter pipework. Be careful to avoid damaging the wrapped ends of the lagging and use flame retardant sheeting.
- Support pipework while it is being worked on.
- Wrapped sections of pipework should be carefully supported during cutting and/or unbolting, such as using sheet metal bands at sling attachment points.
- Pipework sections should be transferred to the skip/disposal container as soon as reasonably practicable.

Glove bags

Glove bags are made of strong clear plastic materials that are designed to allow stripping activities inside the bag by an external worker using integrated plastic gloves. The top part of a glove bag fits around the item to be stripped while the bottom part acts as storage for tools and asbestos waste. A vacuum should be attached to create slight negative pressure.

Enclosures are usually still required even when glove bags are being used. This is because if the bag fails (for example, a failed or punctured seal) there would be no way to stop asbestos spreading.

Only use glove bags without an enclosure where the risk assessment shows minimal risks to others if the glove bag leaks or fails (where the site is remote and far away from people).



FIGURE 25:
Example of glove bag
setup with HEPA vacuum

Glove bags should:

- be made from a strong material that does not tear
- have shoulders wide enough to seal the bag properly to the pipe or vessel
- have internal zips to seal and isolate waste at the bottom, so the top can be purged once the work is done. This helps minimise fibre release when removing the bag
- have an entry port to insert a spray nozzle to wet the asbestos or a vacuum nozzle to create negative pressure and purge the top of the bag once work is done.

When using glove bags, make sure:

- workers have had specific training on the use of glove bags
- the operators wear suitable PPE and RPE
- the work area is well-defined, movable items such as furniture are removed, and ledges and other surfaces are covered in polythene sheeting
- the glove bag completely covers the section of pipe or other structure being worked on
- the glove bag fully seals in the work area - smoke-test using a smoke tube to confirm this before starting work
- where reasonably practicable, that the work is carried out with the glove bag under slight negative pressure
- wet stripping techniques are used where reasonably practicable (small spray bottles may be useful)
- the glove bag is only used once and not reused
- the glove bag is not moved - do not slide it along pipes
- the glove bag is not used for jobs requiring more than two glove bags, unless the assessment shows that this is safe for the job in hand
- the glove bag needs two operators to use it safely
- removed asbestos waste is fully sealed while still inside the glove bag
- contingency plans, and equipment for spillages and clean-up, are in place.

Have a safe system for using and removing the tools from the glove bag, without compromising the glove bag's integrity. For example:

1. Hold the tool in one hand within the glove of the glove bag.
2. Pull the tool out (keeping it within the glove sleeve).
3. Twist the lower end of the sleeve to enclose the tool in a pouch at the end.
4. Seal the twisted end at two points several centimetres apart.
5. Cut between the two points, this will leave the tool sealed in the glove and the elbow or shoulder of the glove sealed to prevent any escape of fibres.
6. The glove pouch can be placed in the next glove bag for use or in a container of water for cleaning later.

Direct vacuum removal

Direct vacuuming removal is removing and vacuuming asbestos at source using purpose-designed vacuum equipment. It can be used for removing loose asbestos (such as thermal or noise insulation), where wetting could cause it to bond to other surfaces.

Enclosures are still required when direct vacuum removal is being used.

Always wear full PPE and RPE.

When using direct vacuum removal consider the following:

- Vacuuming will not work properly on wet asbestos. Any wet asbestos will have to be removed using other techniques, with appropriate controls in place.
- The asbestos being removed will need to be transported, isolated, and bagged under controlled conditions. The bagging unit should be in a separate ventilated enclosure at negative pressure to prevent leaks.
- Exhaust air must be filtered to a high standard (HEPA filtration).
- Have plans and procedures in place for if something goes wrong. For example, if the vacuum ducting gets blocked or there is a leak in the system:
 - securely cap both ends, draw it into the enclosure, open and clear the ducting
 - seal any openings immediately
 - include these details in the ACMP.

Enhanced air management

Enhanced air movement is when air is introduced by a blower near the work area and extracted at a higher rate to maintain negative pressure. The blower, equipped with a manometer, automatically shuts off if the pressure drops too low.

Enhanced air management can be used for any type of stripping work when wetting or other controlled techniques cannot be used. It can also be used as an additional control alongside other controlled stripping methods.

Due to the high exposure risks when stripping dry, careful planning and close monitoring are essential. To effectively reduce exposure:

- correctly position the push-pull air system to avoid dispersing asbestos fibres
- the blower and extraction points should be positioned close to and opposite the work area to draw contaminated air away from workers
- reposition the blower and extraction points as work progresses to make sure they stay close to the work area
- workers should stay to the side of the blower unit.

This complex system requires constant monitoring and is mainly used when other techniques are not suitable.

11.6 Uncontrolled dry stripping

Uncontrolled dry stripping is prohibited.

Uncontrolled dry stripping refers to stripping ACM in its dry state inside an enclosure, without any direct controls in place to reduce exposure. Uncontrolled dry stripping can produce excessively high airborne asbestos fibre concentrations (up to 100–1000f/ml for sprayed coatings). Levels this high will result in significant asbestos exposure even when workers are wearing RPE. No RPE can provide adequate protection for these fibre levels. Air extraction within the enclosure will also not be able to control levels this high.

Some form of control must always be used, such as direct control at source (for example, wet stripping or shadow vacuuming) or other specialised techniques, such as glove bags or enhanced air management.

For more information, see Sections 11.3: Controlled wet stripping through to Section 11.5: Dry stripping with control at source

11.7 Managing other risks during asbestos removal work

In addition to the requirement to manage the risk of asbestos exposure, removalists must manage any other risks that may be present during asbestos removal work. For example:

- working in extreme temperatures. See [Working safely in extreme temperatures](#) and [Working on or near hot plant](#) below
- working at height. See [Working at height](#) and [Working at height](#) below
- working in confined spaces. See [Confined spaces: planning entry and working safely in a confined space](#) and [Working in confined spaces](#) below
- working near live electrical equipment or overhead lines. See [Working near low voltage overhead electric lines](#)
- presence of chemicals or other substances hazardous to health. See [Hazardous Substances](#)

Working on or near hot plant

Wherever possible, all plant that cannot be removed from the enclosure should not be operational while removal is taking place on or near it. Working on or near operational plant can create the following risks:

- Produce excessive heat within the enclosure, creating thermal risks for workers. For more information about the risks of working in extreme temperatures, see WorkSafe's webpage [Working safely in extreme temperatures](#)
- Produce combustion gases within the enclosure that will need to be vented without compromising the integrity of the enclosure.
- May be incompatible with wet stripping techniques. For example, wetting of ACM insulation on hot pipes may not stay wetted long enough.
- Temperatures may increase further as asbestos-containing insulation is removed from plant or pipework.
- Excessive heat may soften polythene sheeting and weaken joints and seams of the enclosure. If the enclosure fails, strong warm air currents can escape causing significant contamination of the surrounding area.

Plan with the commissioning PCBU to arrange for plant to be removed or turned off wherever possible. This may mean doing the asbestos removal work during hours when the plant is not required. This information should be included in the ACRP.

Where work arises at short notice through incidents or emergencies and plant cannot be turned off at short notice, consider temporary repairs or encapsulation until the plant can be shut down and work carried out with the plant cold.

If plant cannot be removed or turned off during removal work, and work cannot be delayed, put control measures in place to manage the risks.

Table 26 shows control measures to use when plant must stay operating during asbestos removal.

CONTROL MEASURE	DETAILS
Minimise heat sources	Operate equipment at minimum temperatures. For example: switch one boiler off, run the other at the lowest setting, and then reverse the arrangement.
Minimise heat spread	Use temporary insulation to cover exposed hot surfaces. Shield radiant surfaces with radiant heat barriers.
Make sure air is effectively managed inside the enclosure	Increase ventilation rates: <ul style="list-style-type: none"> - remove air at higher levels - make sure supply and extract vents provide a positive rate of air change at the working position - draw make-up air from outside the heat-affected area where the air is cooler - use air conditioning units to maintain cooler conditions.
Minimise the effects of excessive heat on workers	<ul style="list-style-type: none"> - Rotate workers frequently - Provide cooler rest areas - Supply cool water - Provide personal cooling vests <p>For more information, see WorkSafe's webpage Working safely in extreme temperatures</p>

TABLE 26: Control measures when plant stays operating during asbestos removal

In addition, consider other sources or causes of excessive heat that may present a risk to workers while removing asbestos. For example:

- working in direct sunlight
- working in warmer/summer weather conditions
- working in confined places
- working while wearing heavy PPE/RPE
- physically demanding removal work that can cause internal body temperatures to rise.

For information on the effects of extreme heat on the body and suggested control measures, see [Working safely in extreme temperatures](#)

Working at height

Working at height means working in a place where a person could be injured if they fell from one level to another. This includes situations where there is a risk of falling from an elevated place, through an opening, or over an edge.

Preventing falls should be actively managed so that people working at height are kept safe.

For more information about managing risks of while working at height see [Working at height](#)

Working in confined spaces

A confined space is an enclosed or partially enclosed space that not intended or designed primarily for human occupancy.

Confined spaces may present a risk from one or more of the following at any time:

- unsafe concentration of harmful airborne contaminants (other substances as well as asbestos)
- unsafe concentration of flammable substances
- poor levels of oxygen
- substances that can cause engulfment.

Examples include: storage tanks, tank cars, process vessels, boilers, silos, pits, pipes, sewers, shafts, ducts and shipboard spaces.

Any removal work in a confined space must have the associated risks managed.

For more information about managing risks of working in confined spaces see [Confined spaces: planning entry and working safely in a confined space](#)

11.8 Removing asbestos waste from the enclosure

Sealed waste bags and wrapped items must be decontaminated before they are removed from the enclosure. Decontamination should be done in the baglock as follows:

- **Inner stage of the baglock:** wipe down the bagged or wrapped waste. The bag/wrapped item should be clearly marked as containing asbestos waste. Once wiped down it can be moved to the middle stage of the baglock.
- **Middle stage of the baglock:** the bag should be placed in a second bag (usually transparent), sealed, and wiped down. The waste can then be taken to the outer stage of the baglock
- **Outer stage of the baglock:** the waste should be collected from the outer stage by an outside worker and transferred to the waste skip.

If there is no worker available for this, then the person putting the waste through the baglock will have to carry out preliminary decontamination before taking the waste to the skip or vehicle. For more information on personal decontamination, see [Section 15.0: Personal decontamination](#)

Where there is not enough space for a dedicated three-stage baglock, the decontamination should be carried out in an alternative baglock arrangement. For more information, see *Airlocks and baglocks* in [Section 9.7 Enclosure access](#)

Once the decontaminated waste package is outside the baglock it should not be left unattended:

- Have a worker based on the outside of the enclosure take the waste to the skip or vehicle being used for disposal. Make sure this worker is wearing appropriate PPE.
- This worker should always remain on the outside of the enclosure to avoid having to decontaminate.

For information about the next steps in disposing of asbestos waste, see [Section 14.0: Containment and disposal of asbestos waste](#)

11.9 Site cleaning and preparation for four-stage clearance

Use work methods and equipment which will prevent or minimise the build-up of asbestos debris and waste in the work area. This will make cleaning up easier.

- Remove all asbestos waste from the work area without creating additional risks of spreading it.
- ACM should be placed directly into waste bags as it is removed.
- Where wet removal techniques have been used - place waste into bags before it starts to dry out (or keep residue damp until it can be bagged).
- Clean throughout the work period and make sure the area is clean at the end of each shift.

Cleaning methods

Cleaning methods should not create dust.

- Do not use brushes or brooms.
 - Pieces of debris can be cleaned up using rakes and shovels. Damp cloths and wipes should be used for additional cleaning of surfaces.
 - Dust and debris should be dampened down as necessary before cleaning.
 - Use Type H vacuum cleaners which are designed for asbestos (Figure 24).
 - Type H vacuum cleaners are fitted with HEPA filters and are designed for dust-free disposal.
 - Do not use domestic or general-purpose vacuum cleaners (even those with HEPA filters)
 - Do not use type H vacuum cleaners on very wet material. Excessive liquid will damage the HEPA filter. Instead use vacuum cleaners suitable for wet surfaces. The vacuum cleaner will need immediate cleaning and decontamination after use, including removing and disposing of the filter.
- For more information see [Section 12.5 Industrial vacuum cleaners](#)

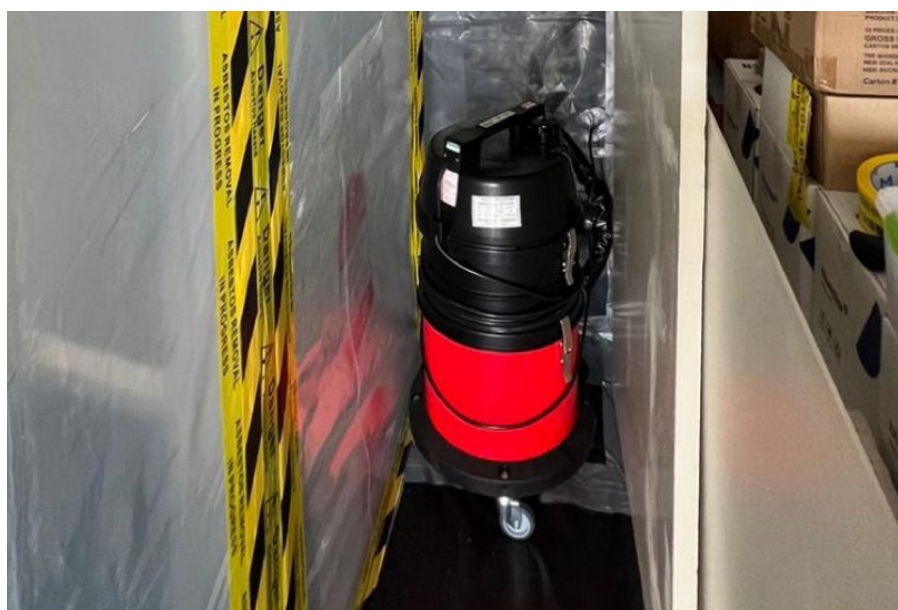


FIGURE 26:
Type H vacuum cleaner

Cleaning stages

Clear the enclosure (including airlocks and baglocks) of all asbestos waste and other non-essential items (such as tools and equipment). The only remaining items should be:

- any wrapped waste that could not be removed through the baglock system
- a type H vacuum cleaner, wipes, and waste bags which may be needed for any additional cleaning as directed by the assessor
- any equipment the assessor may need to perform the four-stage clearance procedure (such as a ladder)
- a type H vacuum cleaner and buckets for decontamination, which should be left in or near the airlock.

Once the area is cleared, it can be cleaned one last time to prepare for the four-stage clearance procedure. Final cleaning should include the following steps:

- Replace pre-filters on the air extraction equipment with new filters.
- Thoroughly clean the whole work area including all surfaces and items using dustless methods, including:
 - floors
 - walls
 - all sides of sheeted items
 - high-level surfaces
 - pipes
 - ductwork
 - cables
 - undersides of items (pipes, ledges)
 - behind and below plant
 - equipment and other furnishings and fittings.
- Use a type H vacuum cleaner for the initial clean.
- Surfaces should then be wiped as necessary with damp cloths or wipes to make sure all fine settled dust has been removed.
- Remove sheeting or boarding which has been used to protect any equipment, plant, items, or other surfaces (including sacrificial flooring)
- Consider spraying sheeting with an adhesive sealant, such as PVA, before removal to reduce the potential for release of residual fine settled dust. But make sure sealant does not spread onto other surfaces which would inhibit the issuing of the clearance certificate. PVA should have be a 1:5 solution mixed with water.
- After protective sheeting has been removed, check the underlying surfaces for any dust or debris which may have penetrated or settled on to them. Clean these as appropriate.
- Allow enough time for the work area to completely dry out before the four-stage clearance procedure is carried out.
- Finally, carry out a thorough visual and fingertip inspection to make sure that there has been complete removal of the ACM as planned and that the work area has been properly cleaned of visible debris and fine settled dust.

The removalist should complete a handover document to confirm the area has been checked and is clean. See [Appendix 5: Asbestos removal area handover form](#)

If the handover document is missing, incomplete, or there is any doubt about the site cleanliness, the assessor can refuse to start the clearance inspection.

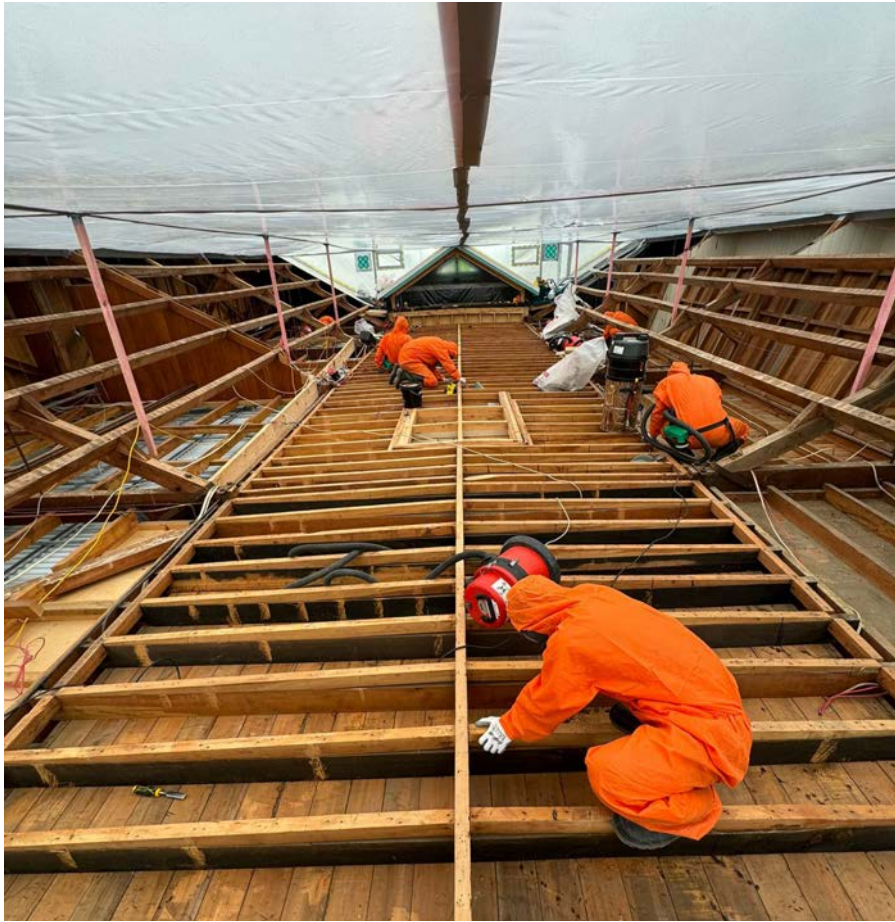


FIGURE 27:
Final cleaning before
Class A clearance

11.10 Approval of methods for managing risks associated with asbestos

WorkSafe-approved methods can allow for work involving asbestos to be carried out that would otherwise be prohibited by the asbestos regulations.

This can apply to situations where existing approved methods for managing asbestos (including its removal) cannot be followed. PCBUs cannot use an alternative method until it has been approved by WorkSafe.

For more information on the criteria and how to apply for an approved method, see WorkSafe's webpages:

- [Asbestos approved methods](#)
- [How we approve methods for working with asbestos](#)

12.0

Tools and equipment

IN THIS SECTION:

- 12.1 Selecting the right tools and equipment
- 12.2 Prohibited tools and equipment
- 12.3 Controlled tools and equipment
- 12.4 Equipment inspection and maintenance
- 12.5 Industrial vacuum cleaners
- 12.6 Vacuum cleaner filters
- 12.7 Maintaining vacuum cleaners
- 12.8 Transporting vacuum cleaners

Select the appropriate tools and equipment to minimise airborne asbestos fibres.

12.1 Selecting the right tools and equipment

It is important to select the correct tools and equipment for any work on asbestos material.

Some tools and equipment are prohibited for use on asbestos material because they increase the chances of asbestos fibres becoming airborne.

Certain tools and equipment that generate dust can be used under strict controls. These are called controlled tools and equipment.

12.2 Prohibited tools and equipment

The following equipment must not be used on asbestos or ACM, and a PCBU must not direct or allow a worker to use it.

High-pressure water spray

This means water pressurised by positive displacement pumps that have an output capability of more than 350kPa.

Using high-pressure water spray on asbestos, ACM, or asbestos-contaminated dust is prohibited because it increases the chances of asbestos fibres becoming airborne.

High-pressure water spray and compressed air **must not be used** on asbestos material, except in the following situations:

- for fire-fighting or fire prevention purposes
- water jetting to clear or prevent blockages in wastewater or water pipe networks
- specific instances of the use of a relevant method for managing risk associated with asbestos that is approved.

Compressed air

Using compressed air on asbestos material is prohibited because it significantly increases the risk of asbestos fibres becoming airborne.

12.3 Controlled tools and equipment

Power tools and other equipment (including angle grinders, sanders, saws, drills, brushes, and brooms) may be used only under controlled conditions.

For example, if the equipment is:

- enclosed while being used (such as within an enclosure with mechanical ventilation operating)
- designed to capture or suppress airborne asbestos and is used according to its design

- used in a way designed to capture or suppress airborne asbestos safely, such as through engineering control measures like dust suppression or extraction ventilation
- a combination of the above.

Use manually-operated (non-powered) hand tools wherever possible. If this is not possible, use low-speed, battery-powered tools that can be used with wet methods for dust control.

Fit battery-powered tools with local exhaust ventilation (LEV) dust control hoods wherever possible. If LEV cannot be attached and other dust control methods are unsuitable, the asbestos worker should use shadow vacuuming techniques ([Section 11.3: Controlled wetting by injection](#)).

When using power tools with dust suppression or extraction, air monitoring should be carried out to ensure the controls in place are effective in reducing the release of fibres.

For more information, see [Section 10.0: Air monitoring](#)

12.4 Equipment inspection and maintenance

Inspect all equipment used for removing asbestos:

- before work involving asbestos starts
- after any repairs
- at least once every seven days when it is continually used.

PCBUs should keep records with details of these inspections, the state of the equipment and any repairs made.

Never take anything that could have asbestos on it out of the work area - not even during the job. Tools must be either:

- decontaminated after finishing work involving asbestos. The PCBU must not allow anything to leave the enclosure if it is likely to be contaminated.
- sealed in a container. Before removing the container, decontaminate the outside and label it to show it contains asbestos.

See [Section 16: Decontamination of tools, vehicles, machinery or mobile plant](#) for more information.

12.5 Industrial vacuum cleaners

Vacuum cleaners used for hazardous dusts, such as asbestos, must be fit for purpose to make sure the dust is safely captured and contained.

Domestic or standard commercial vacuums are **not** suitable for this purpose, regardless of the filter used.

Industrial vacuums rated for use with hazardous dusts are classified as L, M, or H, which refer to the hazard rating: light, medium, or high hazard.

Asbestos is classified as a high-risk material, so only H-class industrial vacuums should be used with for work involving asbestos material (including asbestos-contaminated dust).

High-efficiency particulate air (HEPA) **does not** mean H-class.

12.6 Vacuum cleaner filters

Filters used in vacuum cleaners for hazardous dusts must:

- be designed to fit the specific model of the vacuum cleaner being used
- achieve the same or higher filtration efficiency that the vacuum cleaner is rated for.

Class H vacuum cleaners used for asbestos work should not be used on wet materials or surfaces unless designed for that type of work.

For more information on selecting the right industrial vacuum or filter or maintaining a vacuum, see WorkSafe's webpage [Industrial vacuums and portable extractors for hazardous dust](#)

12.7 Maintaining vacuum cleaners

When vacuum cleaners have been used with asbestos, removal and disposal of the contents must be performed by a competent person. Vacuum cleaners should be maintained according to the manufacturer's guidance.

Competent person

A competent person is someone who has the appropriate skills, training, knowledge, and experience to perform the task or role.

The competent person should:

- wear personal protective equipment (PPE), including appropriate respiratory protective equipment (RPE) - which has been fit-tested
- seal or cordon off an appropriate area to prevent unnecessary dust exposure to others or carry out the operation in an enclosure
- make sure the dust bag has been removed and disposed of first
- use a damp cloth to clean the dust off the outside of the vacuum, and any inside parts that are accessible
- dispose of dust and containment bags and contaminated damp cloths as asbestos waste in tightly sealed and labelled bags or containers
- only dispose of asbestos waste at authorised asbestos disposal sites.

For a more thorough clean, use another industrial vacuum cleaner. Only use this method if the other vacuum cleaner is rated at the same class, or higher.

Dry brushing or using compressed air should never be used to clean vacuums. These methods cause the hazardous dust to spread and become airborne. Compressed air can also damage the filters, making them ineffective.

12.8 Transporting vacuum cleaners

Vacuum cleaners used for asbestos work must be treated as asbestos waste during transportation. This means double bagging the vacuum cleaners and any hoses and attachments in suitable asbestos waste bags, clearly identified as containing asbestos.

For more information, see [Section 14.0: Containment and disposal of asbestos waste](#)

13.0

Clearance inspections

IN THIS SECTION:

- 13.1 What are clearance inspections and who can do them?
- 13.2 How to find a licensed asbestos assessor
- 13.3 What does the inspection process involve?
- 13.4 Surface testing
- 13.5 Air monitoring
- 13.6 Wet enclosures or work areas
- 13.7 Using sealant
- 13.8 Clearance certificates

Clearance inspection is carried out after licensed asbestos removal work to make sure the premises are safe to reoccupy.

This section provides information on clearance inspections relevant to asbestos removalists. More detailed information about the clearance process is covered in the [Asbestos assessments – good practice guidelines](#)

13.1 What are clearance inspections and who can do them?

A clearance certificate is required before the area can be reoccupied for demolition, work, or normal use.

The person who commissioned the asbestos removal work at a workplace must make sure a clearance inspection of the asbestos removal area is completed, and a clearance certificate is issued. For removal work in residential homes the removalist must make sure the clearance inspection is completed.

Unauthorised people must not enter the asbestos area before the clearance certificate is issued. Signage and barriers must remain in place until then.

Clearance inspections can be carried out by certain people, as shown in Table 27.

CLASS A ASBESTOS REMOVAL WORK	CLASS B AND UNLICENSED ASBESTOS REMOVAL WORK
<ul style="list-style-type: none"> - an independent licensed asbestos assessor 	<ul style="list-style-type: none"> - an independent licensed asbestos assessor - an independent competent person

TABLE 27: Who can carry out clearance inspections

For detailed information on what makes an assessor or a competent person independent, see [Section 2.4: Independence and conflicts of interest in the Asbestos assessments – good practice guidelines](#)

A **competent person** is a person who has relevant industry experience, skills, and knowledge. They must also hold either of the following qualifications:

- a certificate from a training course, specified by WorkSafe for asbestos assessor work
- a tertiary qualification in occupational health and safety, occupational hygiene, science, or environmental health.

For more detailed information see [Section 6.0: Asbestos assessments – good practice guidelines](#)

13.2 How to find a licensed asbestos assessor

The register of licensed asbestos assessors is on the WorkSafe website [Licence holder register](#)

13.3 What does the inspection process involve?

There are four stages to the clearance inspection process. The assessor and removalist have actions to take at each step.

Table 28 summarises these steps.

STAGE	THE ASSESSOR WILL	THE REMOVALIST WILL
Stage 1: Preliminary check of site condition and job completeness	<ul style="list-style-type: none"> - Inspect the removal control plan - Check the decontamination facilities are still intact, operational and clean - Check for signs of contamination, leaks, burst waste bags or debris - Check the enclosure's integrity - Check transit and waste routes 	<ul style="list-style-type: none"> - Fix any breaches - Clean and remove any debris found by the assessor
Stage 2: Visual inspection inside the enclosure or work area	<ul style="list-style-type: none"> - Check asbestos/ACM removal including underlying surfaces - Check for any visible ACD left inside the enclosure, airlocks, or work area - Check for any fine settled dust 	<ul style="list-style-type: none"> - Make sure the removal area has been cleaned and dried before the inspection - Accompany the assessor to correct minor problems - Clear any debris or dust if they are found during the inspection
Stage 3: Air sampling	<p>Class A removal: Conduct surface testing by surface disturbance, then conduct air sampling immediately after.</p> <p>Class B removal: conduct air sampling and/or surface testing by surface disturbance, if the results of the visual inspection determine it is necessary</p>	Make sure NPUs are turned off and capped while clearance air sampling is being undertaken
Stage 4: Final assessment of work area and any transiting area after enclosure dismantling	<ul style="list-style-type: none"> - Check for any residual contamination following dismantling of the enclosure - Check transit and waste routes 	<ul style="list-style-type: none"> - Dismantle the enclosure when the enclosure or work area has passed the visual inspection and/or air monitoring

TABLE 28: Actions for each step of the four-stage inspection clearance process

13.4 Surface testing

Surface testing is a planned and controlled disturbance of enclosure surfaces immediately prior to clearance air monitoring.

Surface testing is mandatory for **Class A** asbestos clearance inspections and optional for **Class B** asbestos clearance inspections undertaken following completion of the asbestos removal work.

Surface testing by surface disturbance followed by air monitoring is carried out during Stage 3 of the clearance inspection by the assessor.

Data from surface testing by surface disturbance and air monitoring helps assessors decide whether the area is safe to reoccupy.

For more information on surface testing, see the [Asbestos assessments – good practice guidelines](#)

13.5 Air sampling

Air sampling during clearance inspections is mandatory for **Class A** asbestos removal work (unless there was no enclosure used and the licensed assessor determines it is not feasible), and optional for **Class B** asbestos removal work. For more information, see the [Asbestos assessments – good practice guidelines](#)



FIGURE 28:
Air sampling during clearance (viewed through a vision panel)

13.6 Wet enclosures or work areas

Where practicable, the enclosure or work area should be clean and dry before the inspection begins. It may be hazardous for the assessor to conduct their inspections in a wet environment. It is also harder to inspect for the presence of fine dust.

13.7 Using sealant

Sealants, including PVA, may be used in limited circumstances. For example, where the enclosure also contains significant amounts of non-asbestos (for example, brick or wood) dust that may interfere with the air monitoring readings. Where PVA is used, it should be mixed 1:5 with water.

It should not be used to replace the need for thoroughly cleaning the enclosure.

Sealants should not be applied inside the enclosure before the visual inspection begins.

If an assessor finds a sealant-sprayed enclosure, the asbestos removalist may be instructed to clean and dry the enclosure before the visual inspection starts.

If the removalist is considering applying sealant before the visual inspection stage begins, they should seek advice from the assessor first.

If the removalist has used a sealant in the asbestos removal area, it should notify the client and advise them that the sealant may break down over time.

13.8 Clearance certificates

A clearance certificate will be issued if the asbestos assessor's testing confirms that the asbestos removal area no longer poses a risk to health and safety from asbestos exposure.

The area must not be reoccupied until the PCBU who commissioned the work, or the removalist (when the work is at a residential home) has obtained a clearance certificate for the asbestos removal area. This includes reoccupation for demolition, other work activities or normal use.

The clearance certificate must be issued by the assessor electronically or in a hard copy. It must contain the following:

- the assessor's name, qualifications, and contact details
- the address and location of the asbestos removal area
- the date and time of the inspection
- confirmation that no visible asbestos residue remains
- if applicable, confirmation that air monitoring results are below trace level.

The commissioning PCBU, or the removalist (when the work is at a residential home) must not accept an assessor's verbal confirmation, text message or email confirming clearance inspection completion instead of the clearance certificate.

A PCBU must make sure, so far as is reasonably practicable, that only people involved in the asbestos removal work or authorised people, can enter the asbestos removal area before the clearance certificate is issued. Signs and barriers must remain in place until the clearance certificate is issued.

For more detailed information about the clearance process, see [Section 7.0: Decontamination of the Asbestos assessments – good practice guidelines](#)

14.0

Containment and disposal of asbestos waste

IN THIS SECTION:

- 14.1 Proper handling, containment, transport, and disposal of asbestos waste
- 14.2 Double bagging asbestos waste
- 14.3 Polythene sheeting
- 14.4 Asbestos waste drums or bins
- 14.5 Asbestos skips, vehicle trays, and similar containers
- 14.6 Removing asbestos waste from the asbestos removal area
- 14.7 Storing asbestos waste
- 14.8 Asbestos waste removal plan
- 14.9 Transporting asbestos waste

Correctly containing and disposing of asbestos waste reduces the risk of asbestos fibre exposure.

14.1 Proper handling, containment, transport, and disposal of asbestos waste

Proper handling, containment, transport, and disposal of asbestos waste can help to minimise the risk of workers and others being exposed to asbestos fibres.

As well as all the asbestos material removed during the removal process, the following items should also be treated as asbestos waste:

- all enclosure building materials (such as timber and sheeting)
- any items that have been present (and unprotected) inside contaminated areas that cannot or will not be cleaned (including tools and equipment)
- all disposable PPE used in the enclosure, transit and waste routes and in the DCU.
- any disposable or discarded items used in cleaning and decontamination such as cloths, wipes and towels.

Wastewater from buckets in airlocks should be disposed of through the filtered drainage system in the shower of the DCU.

The asbestos removalist must:

- make sure asbestos waste is properly **contained and marked clearly** to indicate the presence of asbestos, before removing it from the work area
- make sure asbestos waste awaiting disposal is stored in sealed containers such as drums with removable lids, or a sealed skip (lockable to prevent any tampering)
- dispose of waste as soon as is reasonably practicable.

Asbestos removed as unlicensed removal of non-friable asbestos under 10m² should still be wrapped and disposed of as explained in this section.

14.2 Double bagging asbestos waste

Double bag friable asbestos and small pieces of non-friable asbestos in new, clearly labelled heavy-duty, robust and tear resilient/high tensile strength plastic bags to minimise the risk of release of asbestos fibres.

Consider using a coloured internal bag (such as red) and a clear/see-through bag for the outer bag. This makes it easy to see that the waste has been double bagged.

To double bag asbestos waste:

- only fill the bag halfway with waste to minimise the risk of tearing or splitting and to leave a long neck on the bag
- lightly spray the contents of the bag with a water and detergent mix
- gently squeeze any excess air out
- twist the neck of the bag tightly, and seal with duct tape close to the base of the neck to fully enclose the contents
- clean the external surface of the bag with a wet wipe to remove any potential contamination
- place the used wet wipe in the upper neck of the bag (creating a pouch) then seal the neck of the bag above the wet wipe pouch
- fold the neck over and seal it again near the base of the neck – trapping the pouch in the middle (creating a ‘goose-neck twist’). See Figure 29
- place the bag inside a second (outer) bag and seal it with a ‘goose-neck’ twist
- clearly mark the outer bag with **Caution: Asbestos – Do not open or damage bag.**

See [Disposing of asbestos waste and PPE safely](#) for a video that demonstrates sealing a waste bag with a goose-neck twist.



FIGURE 29:
Asbestos waste double bagged and sealed with a goose-neck twist

14.3 Polythene sheeting

Large items that do not fit into asbestos waste bags, such as asbestos sheeting, asbestos-lagged pipes and similar long or large items should be double-wrapped in heavy-duty (minimum thickness of 200–500µm) polythene sheeting.

- Avoid using recycled polythene sheeting, as it may have rips or flaws.
- Apply adhesive tape to the entire length of every overlap to minimise the risk of tearing or splitting.
- Clean the external surface of the sheeting to remove any dust before removing it from the asbestos work area.
- Clearly mark the outer wrapping with **Caution: Asbestos – Do not open or damage bag. Do not inhale dust.**

14.4 Asbestos waste drums or bins

Drums or bins used for storing and disposing of wrapped asbestos waste should be well-maintained, with lids and rims in good working order.

Drums or bins used to store or dispose of asbestos waste should:

- be placed in or near the asbestos work area before starting work
- be lined with heavy-duty polythene
- be clearly marked to indicate the presence of asbestos
- be wetted down while being filled to minimise the release of asbestos fibres into the air
- have rims sealed and outer surfaces cleaned before removal from the work area.

Store asbestos waste drums or bins in a secure location when not in use.

Use trolleys or drum lifters to move them manually once filled.

If a drum or bin is to be reused, pack and seal the existing asbestos waste to minimise the risk of residual contamination. Inspect each drum or bin after use to make sure it is free of asbestos residue.

Purpose-made heavy-duty asbestos waste bags can also be used. They usually contain a zippered top, ensuring a tighter seal and are available in various sizes. Make sure they meet relevant New Zealand standards, follow the manufacturer's instructions before using and make sure the waste is double bagged or wrapped in polythene before loading it into heavy duty asbestos waste bags.



FIGURE 30:
Examples of asbestos waste being removed

14.5 Asbestos skips, vehicle trays, and similar containers

If asbestos waste is too large for bags, drums or bins, use skips, vehicle trays or similar containers. Make sure they are in good condition.

If using a skip, vehicle tray, or another similar container to dispose of asbestos waste, make sure to:

- line the container with polythene before loading with waste
- locate the container as close as possible to the enclosure to reduce the risk of the spread of contamination and the potential for musculoskeletal injuries while carrying heavy bags or wrapped items
- keep the container well away from sensitive areas, such as in the middle of a school playground or near the entrance to a public building
- mark out the transit route to be taken from the enclosure to the container and make sure waste is only taken along this route. This route will need to be checked during the clearance process

- double wrap asbestos waste in heavy-duty plastic sheeting (or double bag the waste) before placing it in the container (see [Section 14.2: Double bagging asbestos waste](#) and [Section 14.3: Polythene sheeting](#))
- carefully place bagged or wrapped items into the container. Do not throw items into the container
- seal the contents of the container completely with plastic sheeting when it is full and have a procedure to prevent the plastic sheeting from tearing when the container is emptied
- secure the contents of the container to prevent unauthorised access until the waste is disposed of (for example, using a lockable lid or placing the container in a secure area)

All drums and bins containing asbestos must be sealed and clearly marked to indicate the presence of asbestos before removal from the asbestos work area.

14.6 Removing asbestos waste from the asbestos removal area

Once waste has been removed from the asbestos work area, it needs to either be:

- placed in an appropriate container for secure storage and eventual disposal
- immediately removed from the site for transport to the disposal site.

14.7 Storing asbestos waste

Asbestos waste can only be stored under the following circumstances:

- on site in a secured skip or locked vehicle
- at a waste management facility.

For small amounts of waste (within unlicensed removal limits) it is acceptable to place correctly bagged waste in a well labelled and lockable bin. The waste can then be disposed of it once enough has accumulated for economical disposal.

Waste should not remain stored for extended periods unnecessarily.

14.8 Asbestos waste removal plan

The ARCP should include an asbestos waste removal plan. It should describe how to transport and dispose of asbestos waste, and detail:

- the name of the asbestos waste transporter
- how asbestos waste will be contained
- the quantity (amount and dimensions) of asbestos waste
- where the asbestos waste will be stored onsite before disposal
- how the asbestos waste will be transported
- approval requirements from the local council, such as permits and paperwork
- local council requirements, such as the quantity of asbestos and container dimensions
- the destination of the asbestos waste
- how correct disposal will be verified, such as through tip dockets.

14.9 Transporting asbestos waste

While asbestos is not considered hazardous waste under the New Zealand road rules, it is recommended that PCBUs transporting asbestos waste should, where relevant, follow the rules for transporting hazardous waste.

All loads must be made secure.

It is recommended that:

- drivers hold a dangerous goods licence
- skips are well sealed prior to transport to prevent fibre release during transport
- sideboards are used to help keep loads secure
- waste vehicles have GPS tracking
- drivers have completed an asbestos awareness course
- there is an emergency response plan in place in case of a crash or incident including:
 - letting first responders know as soon as possible if there is a risk of spilled asbestos waste
 - having an emergency plan for containing spilled asbestos waste.

If a package or bag bursts during transit, the vehicle, container or skip it was being carried in will need to be cleaned out and visibly inspected before it can be reused. A vehicle may also require a disturbed air test.

For further information on transporting and disposal of low-level asbestos contaminated soil see WasteMINZ guidance [Waste Industry Guidelines for the Disposal of low-level asbestos-contaminated soil at a landfill \(2024\)](#)

Waste: Key points

Make sure that waste is properly bagged and/or wrapped with the appropriate approved markings.

Waste bags or packages should be removed through the baglock.

Position the skip, container or vehicle as close to the enclosure as possible.

Ensure that no sharp objects can burst bags or packages during transit.

Ensure that the skip, container or vehicle is kept locked or secured.

All waste should be taken to a licensed or permitted waste management facility.

Asbestos waste can only be stored on site in a secured skip, container or vehicle, or at a waste transfer station.

Make sure there are emergency procedures for clearing up any burst bags or packages.

15.0

Personal decontamination

IN THIS SECTION:

- 15.1 Personal decontamination helps prevent the spread of asbestos
- 15.2 Entering an enclosure or work area
- 15.3 Three stages of personal decontamination for licenced removal work
- 15.4 Preliminary decontamination (Stage 2)
- 15.5 Set-up requirements for three-stage airlocks
- 15.6 Final decontamination in a DCU (Stage 3)
- 15.7 Set-up requirements for DCUs
- 15.8 Connecting DCUs to services
- 15.9 DCU signage
- 15.10 Inspection and cleaning of DCUs
- 15.11 Maintenance of DCUs
- 15.12 Equipment testing
- 15.13 Training in decontamination procedures
- 15.14 Monitoring of the decontamination process
- 15.15 Emergency procedures for DCU failure

Personal decontamination after leaving an enclosure or removal area helps control the spread of asbestos fibres.

15.1 Personal decontamination helps prevent the spread of asbestos

Personal decontamination is necessary to make sure workers, their PPE, and RPE are free of asbestos fibres before leaving the enclosure or work area. It helps prevent the spread of asbestos outside the enclosure.

Personal decontamination is also important for preventing others who come into contact with asbestos workers, equipment, or waste from getting secondary contamination. Family members can be exposed to asbestos if contaminated clothing is taken home.

Personal decontamination is required for all licensed asbestos removal work, whether or not an enclosure is used.

There are three stages of personal decontamination (see [Section 15.3: Three stages of personal decontamination](#)). The following section provides information on the second and third steps of personal decontamination:

- preliminary decontamination and
- final decontamination through a decontamination unit (DCU).

This section also covers set-up, cleaning, and maintenance requirements for DCUs.

For information on Stage 1 personal decontamination procedures, see [Section 11: Controlled removal and repair techniques](#)

Note: For more information on layout configurations for airlocks, baglocks, enclosures and DCUs see [Section 9: Asbestos removal enclosures](#)

15.2 Entering an enclosure or work area

Workers enter enclosures and work areas through the airlock or designated entry/exit area. They should wear appropriate layers of PPE to allow for correct decontamination when leaving.

Place domestic items such as clothes and towels, at the clean end of the DCU for use after decontamination. If the DCU is not connected directly to the airlock, make sure blue transiting overalls are available in the second stage of the airlock for transiting procedures.

Removal work often involves crawling, kneeling, stretching, and climbing. These actions can tear or rip coveralls and contaminate underclothes. Workers should not wear any domestic clothes inside the enclosure.

Before entering the enclosure or work area, while in the clean end of the 3-stage airlock or DCU, workers should:

- remove all domestic clothes
- put on any necessary disposable underclothes and overshoes
- put on red or orange coveralls
- make sure any equipment taken into the enclosure is clean
- Put on required RPE and use a mirror to perform a seal check.

See [Appendix 4](#) for more detailed instructions for entering enclosures based on different scenarios.

15.3 Three stages of personal decontamination for licenced removal work

Personal decontamination consists of three stages, as shown here.

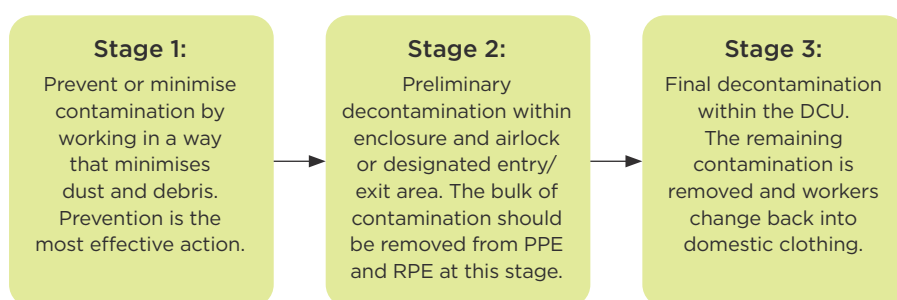


FIGURE 31:
Three stages of personal decontamination

This three-stage structured approach to personal decontamination allows the process to be conducted systematically and consistently. Workers should follow the same series of steps every time they leave an enclosure or work area.

It is not acceptable to use airlocks as DCU facilities. They should be treated as two separate areas with two specific and different functions.

For information on Stage 1 procedures, see Section 11: Controlled removal and repair techniques

15.4 Preliminary decontamination (Stage 2)

Preliminary decontamination procedures will be different depending on if:

- the DCU is directly attached to an enclosure (non-transiting)
- the DCU is separate from the enclosure (transiting)
- there is no enclosure present.

Where possible, when enclosures are in use, non-transiting set ups should be used unless it is not reasonably practicable to do so, such as when there is limited space, restricted access, or multi-storey work.

Transiting set-ups increase the risk of spreading contamination along the transit route. The transit route will form part of the four-stage clearance test at the end of the job.

Workers must keep their RPE on during preliminary decontamination.

Procedures for accessing a DCU directly connected to the enclosure (non-transiting)

In this set-up the DCU is connected to the enclosure through a short intervening space or tunnel and a one-stage airlock constructed of polythene sheeting (Figure 32).

The procedure relevant for this type of setup is also described in Appendix 4.

Before entering this space, while still in the enclosure, but near the exit to the airlock, the worker should use a vacuum to make sure the bulk of contaminants are removed from their PPE, RPE, and footwear.

They can then proceed to the one stage airlock to clean their RPE (while still wearing it) and footwear then go directly to the DCU for full decontamination (see [Section 15.6](#)).

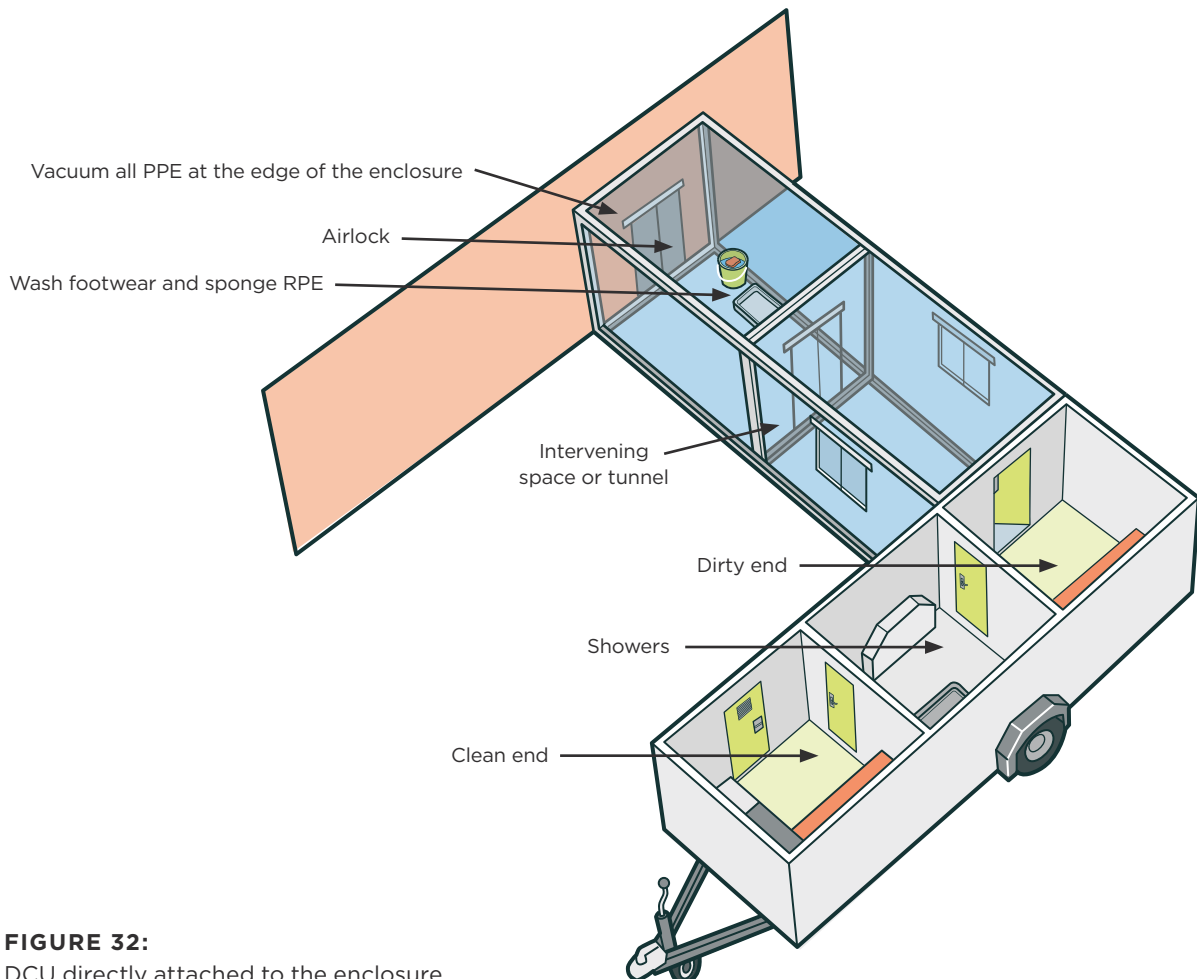


FIGURE 32:
DCU directly attached to the enclosure

Procedures for accessing a DCU separate from the enclosure (transiting)

Where it is not possible to attach the DCU directly to the enclosure, take additional steps to make sure that asbestos fibres are not spread while the worker is walking to the DCU.

These steps involve the use of a three-stage airlock block (Figure 33) where the worker carries out preliminary decontamination before walking to the DCU for full decontamination.

Note: The transit route will form part of the four-stage clearance test at the end of the job.

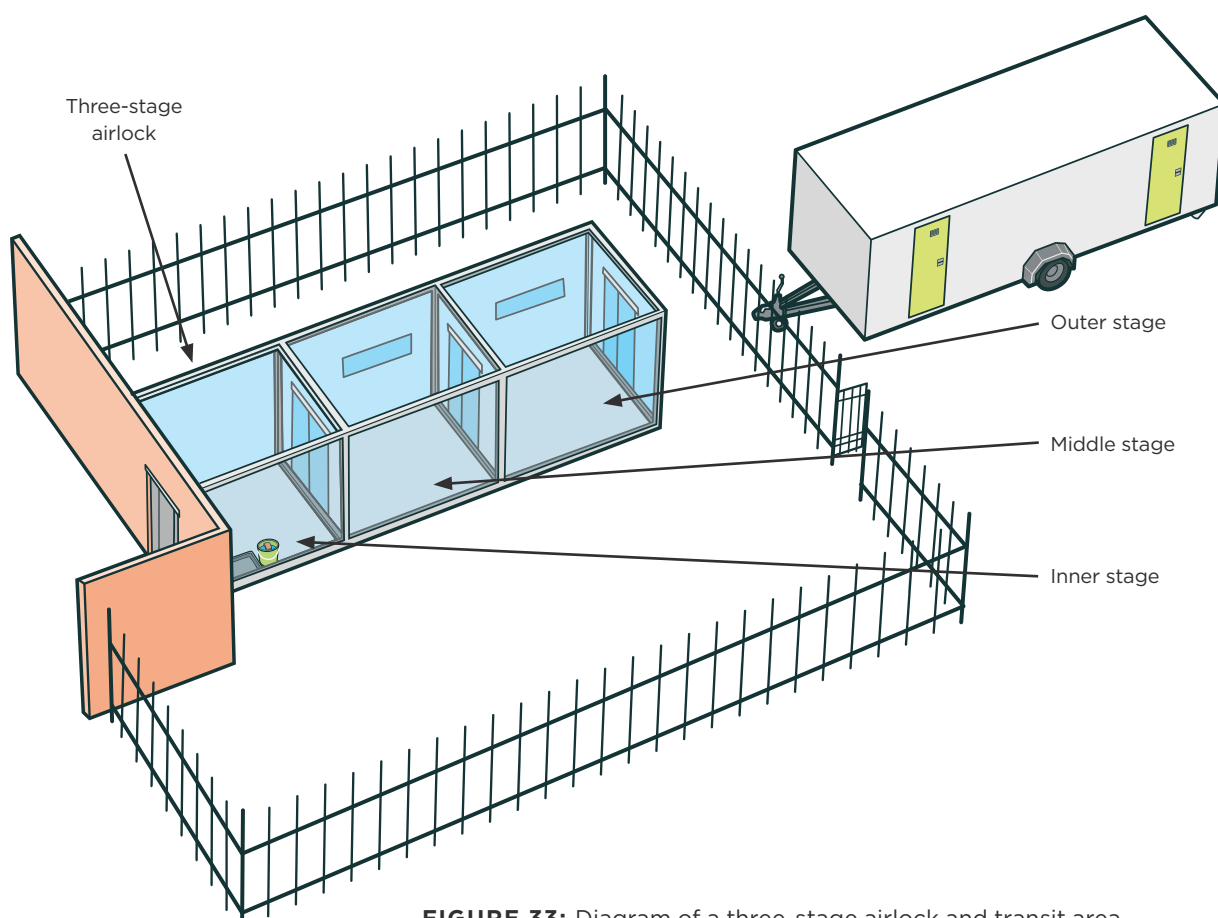


FIGURE 33: Diagram of a three-stage airlock and transit area

Procedures for using the three-stage airlock

The decontamination procedure relevant to this type of setup is also described in [Appendix 4: Decontamination processes](#)

Enclosure edge

1. Before entering the airlock (while still in the enclosure near the exit to the airlock) vacuum PPE, RPE, and footwear to remove the bulk of contaminants.

First (inner) stage of airlock

2. Keep RPE on.
3. Wipe or dampen RPE with a wet sponge or wipe.
4. Use a brush to clean footwear in the bucket.

Middle stage for airlock

5. Keep RPE on.
6. Remove red/orange coverall. Keep it for re-entry or place it in a hazardous waste bag if damaged or if re-entry is not needed.
7. Remove shoes or overshoes worn inside the enclosure.
8. Put on blue transiting coverall.
9. Use wet wipes to clean the outside of smooth surfaces or equipment such as phones, to remove any attached fibres. Dispose used wipes as hazardous waste.
10. Place decontaminated items in a labelled bag or container.

Third (outer) stage of airlock

11. Keep RPE on.
12. Put on transiting footwear.
13. Exit the airlock and walk to the DCU.

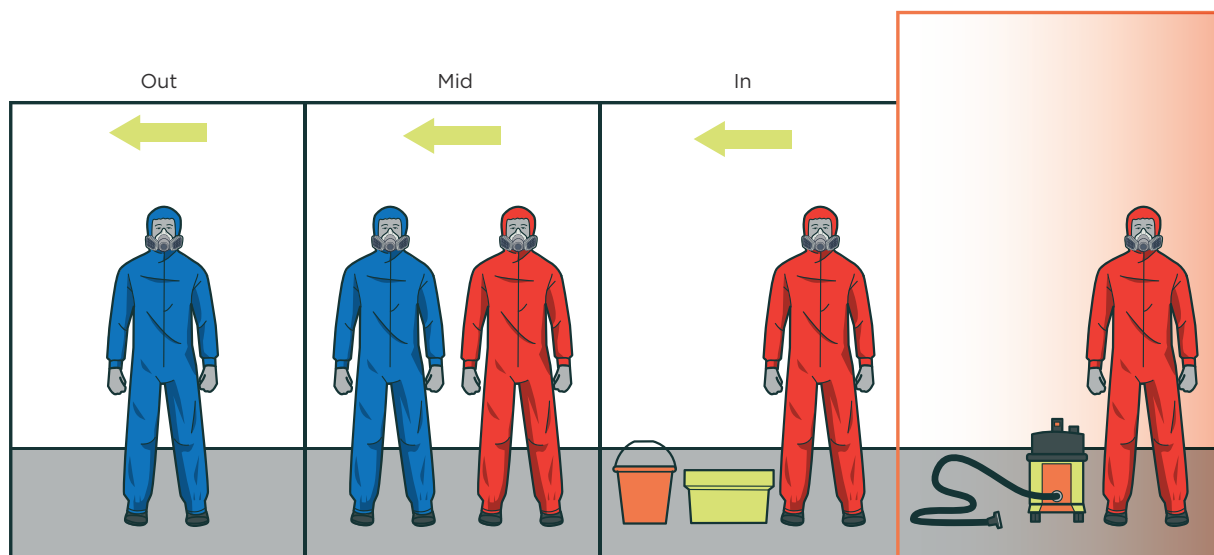


FIGURE 34: Preliminary decontamination - exiting the enclosure (right to left)

All transit routes should be marked to make sure other workers or members of the public keep away from this route. The transit route will form part of the four-stage clearance test at the end of the job.



FIGURE 35:
Inside view of three stage airlock with preliminary decontamination materials

Procedure for personal decontamination when no enclosure present

Where no enclosure has been used a designated area at the edge of the work area should be set up with all the same materials that are provided for preliminary decontamination within a three-stage or airlock. See Table 29.

The same steps should be taken inside this area as would be taken if using a three-stage airlock. Workers may wish to wear two layers of coveralls so they can remove the outer layer more freely in the designated area.

After preliminary decontamination, the worker should walk to the DCU. This area between the work area and the DCU (the transiting route) will form part of the area requiring clearance. It should be clearly marked, the same as for transit routes from enclosures to DCUs.



FIGURE 36:
Example of preliminary decontamination area when no enclosure present

15.5 Set-up requirements for three-stage airlocks

Three-stage airlocks should be specially constructed and made of polythene sheeting. They should be attached to the enclosure and should comprise three compartments separated by weighted sheets to minimise the spread of dust between the compartments.

The three-stage airlock should be as big as possible to enable the workers to change and decontaminate. The absolute minimum dimensions for each compartment should be 1m x 1m x 2m.

The three stages should have certain facilities within them, as shown in Table 29.

STAGE	FACILITIES
Outer stage	Facilities to store transit coveralls and footwear, such as hooks and/or shoe-holders.
Middle stage	Facilities to store coveralls and footwear worn in the enclosure, such as hooks and/or shoe-holders.
Inner stage	Footbath and brush, water bucket and sponge or wipes for RPE. (Type H vacuum cleaner is usually located at the edge of the enclosure).

TABLE 29:
Three stages of a transit facility, or three-stage airlock

Remember: Do not use airlocks as DCU facilities. They should be treated as two separate areas with two specific and different functions.

15.6 Final decontamination in a DCU (Stage 3)

Stage 3 is where the remaining contamination is removed, workers shower and change back into domestic clothing. Purpose-built DCUs that are divided into three zones should be used for final decontamination.

For an example of a DCU layout, see Figure 37.

DCUs also allow workers to prepare for work before entering an enclosure or work area (changing from their personal clothing into their PPE and RPE).

Provide enough DCUs for the number of workers expected to use them. If many workers are finishing work at the same time, multiple DCUs may be required.

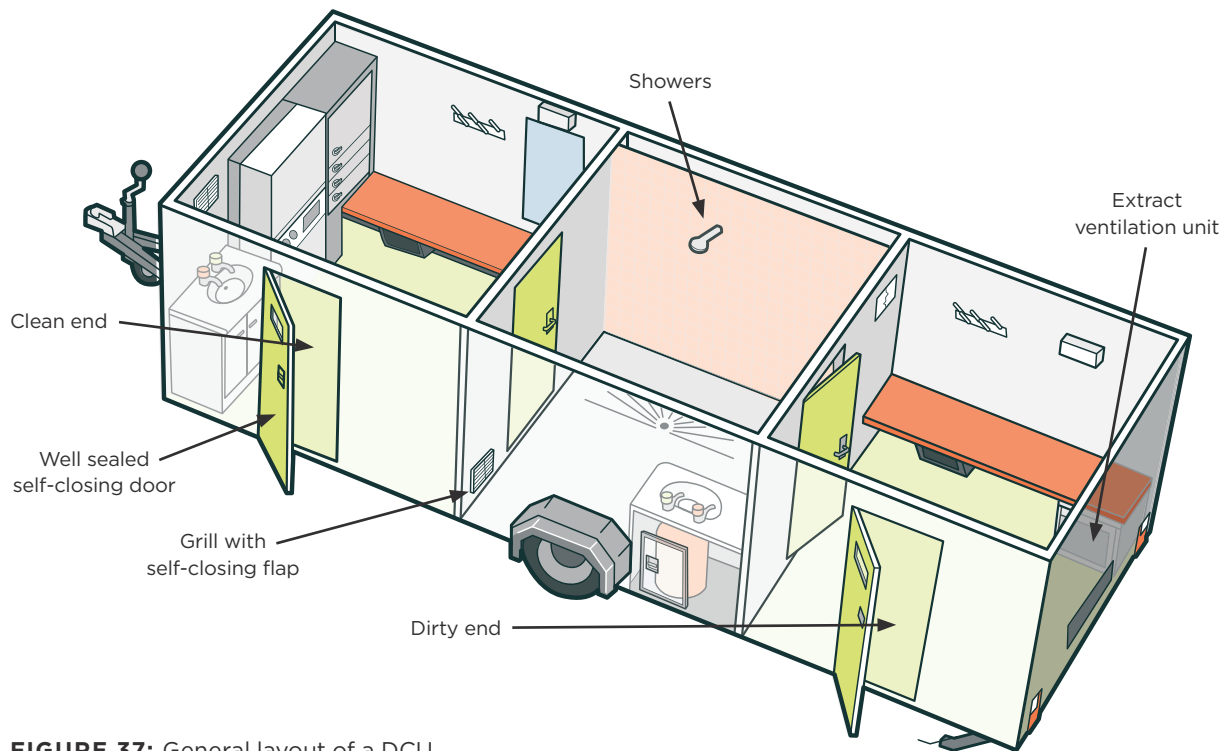


FIGURE 37: General layout of a DCU

Zone one – the dirty end

1. In the first stage (the dirty end), take off all footwear, coveralls and underwear and place in storage or disposal bags. Do not remove RPE.

Zone two – the shower

2. Move to the shower area (with RPE still on) and use a sponge to clean RPE without allowing water onto filter ports. Remove or cap used filters and place in waste bag for disposal if appropriate.
3. Once RPE has been cleaned, remove it and start showering:
 - take thorough showers (a minimum of five minutes)
 - thoroughly wash hair
 - thoroughly scrub fingernails
4. Use disposable towels to dry.
 - If choosing to dry in the shower cubicle, treat the towel used in the shower cubicle as contaminated and dispose of it as asbestos waste.

Zone three – the clean end

5. Step into the clean end of the DCU and if not already dry, use a fresh disposable towel to dry completely. If the towel has never progressed beyond the clean end of the DCU, it can be treated as uncontaminated non-asbestos waste.
6. Get dressed.

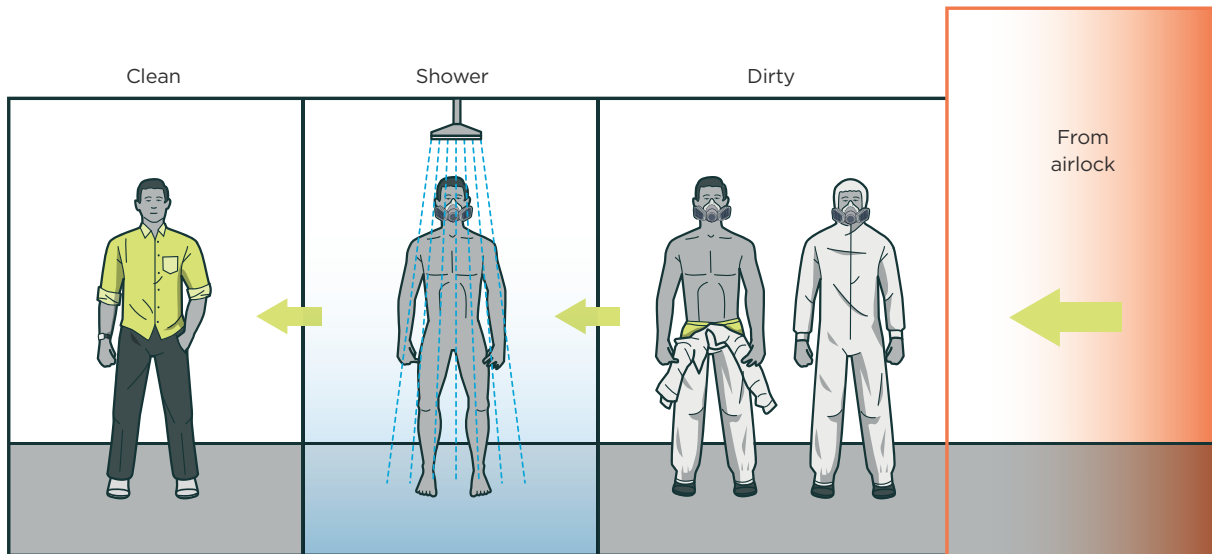


FIGURE 38: Full decontamination in the DCU – exiting the enclosure (right to left)

15.7 Set-up requirements for DCUs

DCUs should be purpose-built and should only be used for the decontamination of asbestos workers. They need to meet the minimum design criteria and specifications set out in Appendix 3.

There are two main types of DCUs:

- mobile DCUs (includes vehicle-based units)
- modular DCUs.

Using pop-up shower pods or makeshift set-ups is not recommended.

DCUs should be on site and functional from the very start of the job. They should be available during early activities such as:

- during pre-clean work
- while the enclosure is being built
- when scaffolding is being erected – especially if there is a risk of the scaffolding disturbing asbestos.

Waste should never be taken through the DCU as it could lead to cross contamination within the unit. Waste (and equipment) should be removed from the enclosure through a separate baglock (see [Section 9.7: Enclosure access](#)).

Mobile units

A mobile unit is a caravan-style or relocatable self-contained unit that can be towed to the site. This type of unit should be used in preference to modular units, as generally they are larger and provide more space and comfort for thorough decontamination.

Mobile units are usually available in several sizes to accommodate 2–8 people.

Mobile DCUs should arrive on site clean. The unit should contain a copy of the clearance certificate from the most recent asbestos removal job. Attach the certificate in a visible place in the clean end.

Mobile units must remain on site for the duration of the work activity, including during clearance. Mobile units should not be taken away until after clearance has been issued.



FIGURE 39:
Example of mobile DCU facilities

Modular decontamination units

Modular DCUs are panel-based systems which enable construction of the facilities on site. Some modular units can be assembled in different configurations (for example, straight line or L-shape) or be extended to more than three compartments.

The air extraction unit, the water management system and the electrical/sockets system are usually positioned outside the DCU.

Modular units can often be directly attached to enclosures, avoiding the need for transiting.

There are potential disadvantages with modular units, particularly size, integrity, and the effectiveness of the water management systems. Modular units need to meet the design criteria described in [Appendix 3](#)

15.8 Connecting DCUs to services

All service connections must meet all relevant regulatory requirements and standards. Table 30 shows what is required.

ELECTRICAL CONNECTIONS	GAS APPLIANCES	WATER AND WASTEWATER
<p>DCUs must comply with the Electricity (Safety) Regulations 2010 and the relevant standards depending on the type of connection:</p> <ul style="list-style-type: none"> - DCUs connected by a plug and lead need an electrical warrant of fitness which must be renewed every four years – see <i>AS/NZS 3001</i> - DCUs that use a detachable connection complying with IEC 60309 (round pin) with a minimum rating of 16 A (such as ‘caravan type plugs), must comply with <i>AS/NZS 3001</i> - DCUs connecting to a generator must comply with <i>AS/NZS 3010</i> - DCUs with fixed connections must follow the wiring rules for electrical installations – <i>AS/NZS 3000</i> - DCUs connected at construction sites must follow specific requirements related to construction site connections – <i>AS/NZS 3012</i>. 	<p>The gas system needs to be checked regularly to make sure it is operating safely:</p> <ul style="list-style-type: none"> - Gas pipework connections and boilers can be damaged during transportation so should be inspected daily and before the next use of the DCU. - Gas bottles (LPG bottles) must be regularly serviced and checked for any leaks each time they are refilled. 	<ul style="list-style-type: none"> - Make sure the water and wastewater supplies are insulated against frost damage. - All piping should have flexible jointing to prevent rupture. - Wastewater needs to be filtered through a high efficiency filter (specification less than 5 microns). - Check there is sufficient water pressure and hot water for the duration of the job. - Filtered wastewater can be disposed of with normal wastewater.

TABLE 30: Requirements for service connections

For more information, see Section 15.12: Equipment testing

15.9 DCU signage

Notices should be posted at each entrance door, clearly indicating which is the clean end and which is the dirty end and prohibiting unauthorised entry (Figure 40). Drainage pipes and electrical connections should also be labelled.

CLEAN



FIGURE 40:
Example of notice
on DCU

DCUs should have self-closing doors and be lockable between sections so workers can prevent unauthorised entry by others to ensure privacy especially while they are changing clothes and washing.

15.10 Inspection and cleaning of DCUs

DCUs should be kept clean and deep cleaned at the end of each working day.

When cleaning DCUs:

- cleaners should wear protective clothing and RPE
- work from the clean end towards the dirty end
- waste bags from the shower and dirty end (properly cleaned, labelled and double bagged) should be removed through the dirty end
- water systems should be drained, traps in the shower and washbasin should be emptied and residues placed in a plastic bag for disposal as asbestos waste.

Any transit route and the area where the facility has been parked should be inspected and cleaned to make sure that there is no residual asbestos waste.

At the end of the asbestos job, the DCU should be thoroughly cleaned and subject to a clearance test. A clearance certificate should be posted in the clean end of the unit before it is used for the next job.

Where the DCU is removed from site at the end of the working day for security reasons, it should be locked and treated as being contaminated. It should be returned as close to the previous location as possible.

15.11 Maintenance of DCUs

The DCU should be maintained in good working order and according to any manufacturer's instructions.

If there are any problems with the shower, heating, or extraction facilities, the unit should not be used until the problem is fixed.

Table 31 shows a suggested daily and weekly checklist for supervisors.

CHECKLIST FOR DCUs

Before DCU use	Do a visual check of all electrical equipment and confirm: <ul style="list-style-type: none"> - it is compatible with the electrical power sources - the earth fault loop impedance test is complete - the voltage and plug pins are compatible - the earth bonding works correctly (for modular DCUs installed on site).
Daily (before each shift)	Daily operational checks should be carried out by a suitably trained supervisor to confirm: <ul style="list-style-type: none"> - water, gas, and electricity supplies are working and sufficient - the shower has good pressure and the right temperature - the heating system works - the NPU works (check the pressure gauge or warning device to make sure the HEPA filter is not saturated) - battery chargers work - there are enough waste bags, towels (one in the shower and one in the clean end), filters, and PPE - the unit, transit routes, and facilities are clean - the vacuum cleaner works, and there are enough sponges and water baths in any transit airlock - airlocks are intact - there are no environmental issues affecting the DCU, such as frozen pipes - RCDs work.
Weekly	Visual check of electrical equipment for damage, wear, overheating etc.

TABLE 31: Daily and weekly checklist for DCUs

15.12 Equipment testing

Equipment should be examined and tested by an appropriate competent person and records kept.

Table 32 shows what should be checked, by who, and how often.

EQUIPMENT	CHECKING REQUIREMENTS	WHO SHOULD CHECK AND HOW OFTEN
Air extraction system	<ul style="list-style-type: none"> - DOP or sodium chloride tests on the HEPA filter - Volumetric flow rates 	<ul style="list-style-type: none"> - Qualified technician/competent person - Every six months
Gas appliances	<ul style="list-style-type: none"> - Service and maintain in accordance with the manufacturer's recommendations 	<ul style="list-style-type: none"> - Qualified gas technician - As required for the appliance warrant of fitness
Electrical systems	<ul style="list-style-type: none"> - Look for evidence of breakages, wear, or deterioration - Look for signs of overheating - Check for missing parts (such as screws or covers) - Make sure switchgear is accessible (not obstructed) - Check for loose fittings - Make sure there is no access to live conductive parts - Check the equipment is working properly – lighting, heating, shower unit, RDCs (using test button*), sockets, and switchgear (where reasonable). 	<ul style="list-style-type: none"> - A competent person should do these routine checks every week and a formal documented check every month. - The competent person doing the checks does not need to be an electrician, but they should be trained in what to look for and be trusted to do the job properly. - *Test the RCDs that provide automatic disconnection on the distribution circuits every day.

TABLE 32: DCU equipment that should be checked, by who, and how often.

Record-keeping of equipment tests and checks

Records should be kept of site inspections as well as equipment tests and checks. Records should be kept for five years and copies of the most recent checks should be available for inspection on site.

15.13 Training in decontamination procedures

Workers should receive practical training on decontamination procedures so they can decontaminate properly. Training should involve practicing how to decontaminate in a simulated environment.

It is particularly important for workers to recognise the need for primary decontamination during transit procedures.

For more information, see [Section 5.0 Training and instruction](#)

15.14 Monitoring of the decontamination process

Supervisors should monitor and regularly check that workers are consistently following decontamination procedures. For example:

- make sure that workers do not develop poor practices or become complacent
- make sure that no inappropriate items are taken into the DCU (such as filled waste bags, drink bottles)
- check that decontamination is carried out regardless of the time spent inside the enclosure.

Where workers are found not following the decontamination procedures, consider retraining for those workers.

15.15 Emergency procedures for DCU failure

Have a plan for what to do if there is a loss of services to the DCU. Plans should be developed for alternative basic decontamination procedures, to use other facilities on site, or by organising the services of another DCU.

These alternative arrangements should be clearly documented, and workers and supervisors should be aware of what actions to take.

16.0

Decontamination of tools, vehicles, machinery or mobile plant

IN THIS SECTION:

- 16.1** Decontamination of equipment helps prevent the spread of asbestos
- 16.2** Decontaminating tools
- 16.3** Decontaminating vehicles, machinery or mobile plant

All equipment used in asbestos removal must be decontaminated or appropriately sealed before leaving the work area

16.1 Decontamination of equipment helps prevent the spread of asbestos

Nothing that is likely to be contaminated with asbestos should be removed from the asbestos removal area unless it:

- is decontaminated before being removed
- is sealed in a container that has been decontaminated on the exterior and clearly labelled to show it may contain asbestos.

16.2 Decontaminating tools

All tools used during asbestos work need to be fully dismantled (where possible), cleaned under controlled conditions and decontaminated using within the baglock (or airlock if there was no space for baglock erection), or designated entry and exit area.

If tools cannot be decontaminated, they must be placed in a sealed container and marked clearly to indicate the presence of asbestos. The outside surfaces of the container must be wiped clean

The containers of tools must remain sealed until decontamination or the start of the next asbestos task, when the equipment can be taken into the asbestos enclosure or work area and re-used under controlled conditions.

Workers should wear PPE and RPE when opening containers to clean or re-use the equipment or tools stored inside.

In some circumstances it may be better to dispose of contaminated tools and equipment, depending on the level of contamination and the ease of replacement. If tools and equipment are disposable, they should be disposed of and not re-used.

16.3 Decontaminating vehicles, machinery or mobile plant

Avoid exposing vehicles, machinery or mobile plant to asbestos contamination.

Where this is unavoidable, a decontamination unit large enough to accommodate the vehicle, machinery or mobile plant will have to be built:

- Locate the unit away from the personal decontamination unit but next to the asbestos enclosure or work area. It can be purpose-built with suitable heavy-duty timbers and plywood. It should be lined internally and externally with heavy-duty plastic sheeting (200µm thickness).
- The unit should be watertight to prevent excess water run-off during wash-down procedures. Make sure all wastewater is collected for filtration or disposal.
- Use spring-loaded doors on either side of the unit to provide an airlock when the vehicle, machine, or mobile plant passes through the unit. Only open one set of doors at a time during entry and exit to prevent airborne fibres from escaping the enclosure.
- Once the decontamination unit is dismantled, dispose of the materials used in building the unit as asbestos waste.

To decontaminate vehicles, machinery or mobile plant inside the decontamination unit:

1. thoroughly wash down the vehicle, machinery or mobile plant using low-pressure water spray
2. make sure the cab, tracks or tyres, undercarriage, boom and body are thoroughly doused with water to remove any asbestos dust
3. leave the vehicle, machinery or mobile plant in the unit and wash down the inside walls and floor of the unit
4. have another worker in clean PPE and RPE enter the unit from the clean side to take the machine from the unit to the clean area.

Note: Workers should not exit the asbestos working area through the vehicle decontamination unit.

Managing wastewater

If not using filtration, collect the water from the decontamination process in a sump and dispose of it as contaminated waste.

Do not dump unfiltered water in council catchments. Talk to the local council or territorial authority about their wastewater requirements.

17.0

Personal protective equipment (PPE)

IN THIS SECTION:

- 17.1 PPE and RPE is essential for asbestos removal work
- 17.2 General PPE information
- 17.3 Coveralls
- 17.4 Gloves
- 17.5 Protective footwear
- 17.6 Respiratory protective equipment (RPE)

PPE is essential to help minimise the risk of exposure to asbestos fibres. PPE should also be considered when minimising risks from other workplace hazards.

17.1 PPE and RPE is essential for asbestos removal work

PCBUs must eliminate the risk of airborne asbestos fibres during removal work so far as is reasonably practicable. In addition, PCBUs must provide suitable PPE (including RPE) to workers to manage any remaining risk from exposure to airborne asbestos during removal work.

The PCBU must make sure that PPE is:

- suitable for work with asbestos
- a suitable size and fit, and reasonably comfortable
- is compatible with other PPE used
- supported by training so workers know how to wear, use, and store it properly
- maintained, repaired, or replaced so it continues to minimise the risk
- kept clean, hygienic and in good working order.

17.2 General PPE information

Who provides PPE

The PCBU directing the work must provide PPE unless it is provided by another PCBU.

Potentially there may be more than one PCBU with a duty to provide the PPE. If this is the case, the PCBUs need to consult with each other to make sure suitable arrangements are made.

The PCBU must pay for the cost of PPE (unless a worker chooses to provide their own). If a worker does choose to provide their own, the PCBU must still make sure it meets the requirements for working with asbestos and decontamination.

Workers can change their mind at any time and choose that the PCBU provide it instead. Workers must give the PCBU reasonable notice of this change.

PPE for asbestos removal work

Suitable PPE is required for any work where there is a risk of exposure to asbestos fibres. The types of PPE that are commonly used when working on or near asbestos are shown in Table 33.

TYPE OF PPE	EXAMPLE	PURPOSE
Protective clothing	Coveralls	Protective clothing helps to prevent contamination of workers' clothing with asbestos fibres. This helps to minimise the risk of spreading asbestos fibres (for example, into workers' homes).
Respiratory protective equipment (RPE)	Respirator with filter	Respiratory protective equipment helps to minimise the risk of workers breathing in asbestos fibres.
Foot protection	Gumboots and shoe coverings	Foot protection that is easy to clean helps to prevent the spread of asbestos fibres away from the work site.
Hand protection	Single-use gloves	Minimises the risk of asbestos fibres getting stuck under workers' fingernails or getting into cuts and grazes.
Eye protection	Safety goggles	Protects the eyes from dust and other particles.

TABLE 33: Types of PPE commonly used when working on or near asbestos

More detailed information on the above types of PPE is provided later in this section.

PPE for managing non-asbestos-related risks

Workers may need other types of PPE in addition to PPE for working with asbestos.

If the removal work involves other hazardous substances, the PCBU should take these risks into consideration when conducting the risk assessment.

When other hazardous substances are involved, the PCBU should refer to safety data sheets (SDS) for information on the appropriate PPE to use and any other precautions to take.

Note: The manufacturer, importer or seller of a hazardous substance must supply a New Zealand-specific SDS on request. For more information see [Safety data sheets](#)

PPE for other people at the removal site

PCBUs must make sure other people at the site, such as visitors, wear PPE if their health and safety may be affected.

Other people, such as visitors, are likely to require instruction or training on how to wear PPE correctly. This should be provided by either:

- the PCBU responsible for providing PPE and making sure visitors use it, or
- the licensed asbestos removalist.

Other people visiting the work area must follow the reasonable instructions of the PCBU who has control of the work area regarding wearing or using PPE.

Training in correct PPE use

Workers must receive training from the PCBU on the correct use of PPE and RPE.

Workers must use and wear PPE in accordance with any information, training or reasonable instruction given.

This training should be completed **before** work with asbestos commences and on regular occasions afterwards.

Training in the use of PPE should include:

- correct use, including safe removal
- inspection, care, and maintenance
- repair and replacement
- emergency procedures
- correct storage.

Safe removal of PPE

Removal of contaminated PPE should be carried out using strict control measures.

For information on proper decontamination procedures, see [Section 15.0: Personal decontamination](#)

Storing reusable PPE

After each use, reusable PPE must be stored correctly:

- reusable PPE must be stored in a sealed container until it is reused
- RPE must be stored in airtight, sealed containers
- reusable footwear such as gumboots should be stored upside down after wiping down the outside surface with disposable wipes
- when using sealed containers, the outside of the containers must be wiped down and the container labelled as containing asbestos (for example, there may be asbestos fibres still trapped in the capped filter of a respirator).

Note: Never store used, disposable PPE. This must be disposed of as asbestos waste.

Workers should never take asbestos-contaminated PPE home.

Providing replacement PPE

PPE must be clean, hygienic, and in good working order. Make sure that PPE is maintained, repaired, or replaced so that it continues to minimise risk to the worker that uses it.

Replace PPE whenever it becomes worn out, no longer provides adequate protection, or is past its use-by date. Replacing PPE should be assessed based on need.

Disposing of used PPE

Place contaminated PPE, as well as wipes used for decontamination, into a heavy-duty 200µm polythene plastic bags or double wrap them in polythene sheets for disposal. The bag should be tied securely with a goose-neck tie and be clearly labelled as containing asbestos.

If a vacuum cleaner has been used to vacuum down clothing, the vacuum cleaner bag is also considered asbestos waste, and will need to be decontaminated and quarantined.

Asbestos waste can only be disposed of at authorised disposal sites. Check with the relevant local authority where these are, and the requirements they have.

For more information on asbestos waste disposal, see [Section 14.0: Containment and disposal of asbestos waste](#)

Training workers to use PPE

Workers must be trained on how to properly wear or use PPE, and how to store and maintain it. Training should be delivered by a competent person.

Train workers before they start work. Training should include:

- what risks workers might be exposed to
- how each item of PPE works
- why workers should wear PPE
- when workers should wear PPE
- how to correctly put on and remove PPE
- how to make sure PPE fits properly
- how to clean, store, and maintain PPE
- how to dispose of PPE
- what to do if there is a problem with a worker's PPE.

New or inexperienced workers should be supervised in putting on and using PPE until they have shown they are competent to do so unsupervised.

Experienced workers may also need to be supervised in putting on and using PPE if changes are made to the PPE being used, or if they have not used the PPE recently.

Review worker training regularly.

17.3 Coveralls

Coveralls are a type of protective clothing used to reduce the risk of asbestos fibre exposure when working with or near asbestos. They provide a barrier between a worker's body and potential hazards (for example, dust, fibres, and other contaminants).

Disposable (or single use) coveralls should be used for removal work.

Colour coding coveralls can help workers and managers/supervisors stay aware of what level of contamination or exposure risk they are working at. For example:

- red/orange overalls can be used for removing/stripping
- blue can be used for transit and waste
- white for assessors and preliminary work.

Table 34 outlines examples of what to consider when choosing suitable coveralls for asbestos work.

WHAT TO CONSIDER	GOOD PRACTICE
Type	Disposable coveralls should meet the minimum requirements for chemical protective clothing resistant to penetration by airborne solid particles (as described in Standard BS EN ISO 13982-1). Get disposable coveralls (for example, Type 5 disposable coveralls) to meet this standard.
Quality	Disposable coveralls should be of a suitable quality to prevent tearing. Coveralls that are too thin are more likely to break at the seams.
Comfort	Disposable coveralls must be reasonably comfortable for workers to wear.

WHAT TO CONSIDER	GOOD PRACTICE
Fit	<p>Disposable coveralls should be:</p> <ul style="list-style-type: none"> - fitted with an elasticated hood and elasticated cuffs - one size bigger than the worker would normally wear to minimise the risk of tearing at the seams. <p>Disposal coveralls should be worn as follows:</p> <ul style="list-style-type: none"> - The fitted hood should be worn over the top of respirator straps and the arms of any eye protection. - Leg cuffs should be worn over footwear (not tucked into footwear). - Arm cuffs should be worn over the top of gloves. - Loose elasticated cuffs should be sealed up with tape.
Other considerations	<p>Disposable coveralls should not have external pockets, Velcro fastenings, or other features that are difficult to decontaminate.</p> <p>Waterproof disposable coveralls may be needed if the work is carried out outdoors.</p>

TABLE 34: What to consider when choosing suitable disposable coveralls



FIGURE 41:
Coveralls

Important

Workers should never take disposable coveralls home.

Used disposable coveralls must be disposed of as asbestos waste. They should never be reused.

17.4 Gloves

Gloves create a protective barrier between a worker's hands and potential contaminants, such as dust, fibres, and other harmful substances.

They help to minimise the risk of asbestos fibres getting stuck under fingernails or getting into cuts and grazes, which can be difficult and painful to decontaminate.

Single-use disposable gloves should be used for removal work. Gloves used during asbestos removal work must be disposed of as asbestos waste.

Table 35 outlines examples of what to consider when choosing suitable gloves for asbestos removal work.

WHAT TO CONSIDER	GOOD PRACTICE
Type	<p>Disposable gloves suitable for working on or near asbestos are usually made of latex, vinyl, or nitrile.</p> <p>Low protein (powder free) latex gloves may reduce the risk of workers developing a latex allergy or skin problems compared with standard latex gloves.</p> <p>Non-latex disposable gloves should always be provided to workers who have an allergy to latex.</p>
Quality	<p>Disposable gloves should be made of good quality material. Gloves that are too thin can be more likely to tear.</p>
Fit	<p>Disposable gloves should be reasonably easy to put on and take off. They should fit close to the hand.</p> <p>Arm cuffs of coveralls should be worn over the top of gloves, not tucked into the gloves.</p>
Comfort	<p>Gloves must be reasonably comfortable to wear – they should not be too tight.</p> <p>If they are too big, they can slip or make it hard to grip things.</p> <p>If they are too small, they can be uncomfortable to wear and could tear more easily.</p>

TABLE 35: What to consider when choosing suitable disposable gloves

Important

Workers should never take disposable gloves home.

Used disposable gloves must be disposed of as asbestos waste. They should never be reused.

17.5 Protective footwear

Protective footwear is used to:

- provide a barrier between a worker's feet and potential contaminants
- protect a worker's feet from impacts (for example, things being dropped)
- provide improved grip for walking on slippery or uneven surfaces.

Table 36 outlines examples of what to consider when choosing suitable foot protection for asbestos removal work.

WHAT TO CONSIDER	GOOD PRACTICE
Type	<p>Protective footwear that may be suitable for asbestos removal includes:</p> <ul style="list-style-type: none"> - gumboots - steel-capped shoes - rubber-soled shoes. <p>Gumboots are generally the best option because they do not have laces and can be easily decontaminated. Select the most appropriate safety footwear for the work that is being carried out.</p> <p>Protective footwear used for asbestos removal should not have laces or eyelets. Laces and eyelets can easily become contaminated with asbestos fibres and are difficult to decontaminate.</p>
Quality	<p>Protective footwear should be made of good quality, durable material. Good quality protective footwear is less likely to split, break down, or lose comfort over time.</p>
Fit	<p>Protective footwear should fit in much the same way that a worker's normal shoes do. They should not be too tight or too loose.</p> <p>Footwear should have some space to allow for normal swelling of the feet and layers of insulation when needed (for example, thicker socks in cold weather or an insole to improve comfort).</p> <p>Leg cuffs of coveralls should be worn over the top of protective footwear, not tucked into the top of the footwear.</p>
Comfort	<p>Protective footwear must be reasonably comfortable to wear.</p> <p>Footwear that does not provide enough support can cause pain, blisters, and other foot problems.</p> <p>Each worker should have their own pair of protective footwear to minimise the risk of foot infections being spread.</p>

TABLE 36: What to consider when choosing suitable protective footwear

Protective footwear should be stored upside down when not in use to minimise the risk of asbestos contaminating the inside of shoes and boots. Provide storage that allows footwear to be stored in this way.

Make sure protective footwear is maintained in good working order.

Disposable shoe covers

Disposable shoe covers are designed to fit over the top of shoes or boots to minimise contamination of shoes and boots (Figure 42). They should cover the whole shoe or boot, and should be secured above the ankle.

Disposable shoe covers should have an anti-slip sole design.



FIGURE 42:
Gumboots (left)
and disposable shoe
covers covering
gumboots (right)

Important

Workers should never take disposable shoe covers home.

Used disposable shoe covers must be disposed of as asbestos waste. They should never be reused.

Leg cuffs of coveralls should be worn over the top of shoe covers. They should not be tucked into the top of shoe covers.

Decontaminating reusable footwear

If it is not reasonably practicable to dispose of used footwear as asbestos waste, the footwear must be decontaminated in a decontamination area.

Decontaminating footwear should include:

- vacuuming using a Class H vacuum cleaner with a brush attachment, and
- wiping with wet rags or wet wipes.

The contents of the Class H vacuum cleaner and any used rags and wipes must be disposed of as asbestos waste.

Storing contaminated reusable footwear

If it is not reasonably practicable to dispose of contaminated reusable footwear, they must:

- be kept in a sealed container that does not allow asbestos fibres to escape
- be clearly marked as 'ASBESTOS CONTAMINATED CLOTHING'.
- be kept in the sealed container until they are reused for asbestos work.

17.6 Respiratory protective equipment (RPE)

RPE is a key control measure to prevent the inhalation of asbestos fibres while doing removal work. Workers should always wear RPE if respirable asbestos fibres are above trace levels.

The greater the risk of exposure to asbestos, the higher the level of protection the RPE should provide.

The information in the section below should be considered alongside advice from a suitably qualified and experienced health and safety professional (such as an occupational hygienist) who is knowledgeable of the working conditions and the limitations of RPE in relation to asbestos removal work.

Selecting the right type of RPE

RPE should be selected after doing a case-by-case risk assessment and consider the following:

- the individual characteristics of the worker. See *Selecting the most appropriate RPE for the worker, task, and environment* in [Protective clothing and equipment for working with or near asbestos](#)
- the type of removal work
- the removal techniques that will be used
- the duration the RPE will be worn for (for prolonged work, power-assisted RPE should be worn)
- the expected level of exposure ([Appendix 2: Asbestos levels associated with asbestos activities](#))

Results from previous air monitoring for similar work tasks can help with the risk assessment.

When selecting RPE, refer to the latest versions of:

- *AS/NZS 1715 Selection, use and maintenance of respiratory protective devices*, and
- *AS/NZS 1716 Respiratory protective devices*, or
- *SA/SNZ TS ISO 16975 Respiratory protective devices – Selection, use and maintenance*

Use information provided by RPE manufacturers or suppliers when selecting the correct type of respirator and filter.

Negative-pressure respirators

For lower-risk work, negative-pressure respirators may be appropriate.

Lower-risk work **may** include:

- work before removal has started
- work after removal has been completed and the area has been cleaned
- small-scale Class B removal
- unlicensed removal.

Negative-pressure respirators use one or more filters to purify the air that is breathed in. Inhaling creates negative pressure, which draws contaminated air through the filter. Examples of negative-pressure respirators are shown in Figure 43.



FIGURE 43:
Examples of respirators suitable for lower risk asbestos work

Positive-pressure respirators

For higher-risk work full-facepiece positive-pressure respirators must be used.

Higher risk work includes:

- All friable asbestos removal (Class A removal).
- Class B removal where there is expected to be elevated levels of airborne asbestos fibres. See [Appendix 2: Asbestos levels associated with asbestos activities](#) for more information.

If a proper seal cannot be achieved (for example, due to facial hair) individuals may need to use powered hoods or blouses.

Positive-pressure respirators use an independent supply of air that is suitable for breathing (for example, an air cylinder). They always maintain a positive pressure inside the facepiece. Examples of positive-pressure respirators are shown in Figure 44.

Positive-pressure respirators prevent contaminated air being inhaled even if there is a leak in the seal between the face and the facepiece (See Table 37). They are generally used where the risk of asbestos exposure is high.



FIGURE 44: Examples of respirators suitable for higher-risk asbestos work

TYPE	HOW THEY WORK
Powered air-purifying respirators (PAPRs)	PAPRs use a battery-powered blower to draw air through the filters or cartridges and push it into the facepiece.
Supplied-air respirators (SARs) or air-line respirators	SARs (or air-line respirators) supply clean air from a tank of compressed air or through an air-line.
Self-contained breathing apparatus (SCBA)	SCBAs have their own air supply supplied from a high-pressure tank that is carried by the user.

TABLE 37:
Types of positive-pressure respirators

WorkSafe must be notified of any work that involves a worker breathing compressed air, or anything other than air.

To notify WorkSafe of work that involves a worker breathing compressed air, use the Notification Tool ([Notify WorkSafe](#)) and select *Report Particular Hazardous Work*.

Air-line respirators

Air-line respirators are used when removing friable asbestos. The air-line should include a belt-mounted back-up filter when in use. If the air supply system fails, workers must leave the asbestos removal area using normal decontamination procedures. The back-up filter will provide enough protection during this process.

If too many workers are using air-line respirators inside an enclosure, the lines might get tangled. If this happens, the removalist should provide manifolds to prevent tangling and help workers move around.

The compressor must be able to supply enough air for all the air-lines in use, and its intake should draw in clean, uncontaminated air. The air must be filtered before it reaches the respirator.



FIGURE 45:
Full-face, positive-pressure demand air-line respirator

Filters

RPE must have an appropriate filter. Particle filters are classified into three groups (Table 38).

TYPE	DETAILS
P1	P1 filters are also known as low efficiency filters. They are not recommended for work on or near asbestos because they cannot effectively filter asbestos particles.
P2	P2 filters are also known as medium efficiency. They stop up to 94% of airborne particles from being inhaled if they are used correctly. P2 filters do not provide the maximum protection for working with or on asbestos material.
P3	P3 are also known as high efficiency filters. They stop up to 99.95% of airborne particles from being inhaled if they are used correctly. P3 filters provide the maximum protection for working with or on asbestos material. P3 filters should be used for licensed asbestos work.

TABLE 38: Classifications of RPE filters

Filters must provide suitable protection for the work being carried out and work effectively in the work conditions.

The length of time that a particulate filter can be used for work on or near asbestos depends on:

- the quality of the filter
- how well the filter is maintained
- how often the filter is being used
- the amount of particles the filter is filtering.

Make sure that workers replace filters if they are damaged, or if they notice a change in their ability to breathe easily.

There is no overall rule about when filters on respirators should be changed – each situation will be different. Ask the manufacturer or a competent person when and how filters should be changed.

Filters should be maintained according to the manufacturer's instructions.

Fit testing

RPE is only effective if it fits properly and is used according to the manufacturer's guidelines. This includes positive-pressure systems, for example, PAPR or SARs. Tight fitting masks need to be fit tested in negative pressure mode. RPE should form a tight seal to the wearer's skin.

Facial differences mean that one kind of RPE is unlikely to fit all. These differences can be significant between people of different genders and of different ethnicities.

Arrange for workers to have a fit test for RPE before they start removal work. Fit testing should be done in line with the recommendations set out in ISO 16975-3. Consider contacting a specialist or the supplier of the RPE to fit test workers.

There are two types of fit testing:

- A quantitative fit test uses an instrument to measure the amount of air that leaks around the seal of RPE. This produces a result called a fit factor, which is a measure of how well the RPE fits the user.
- A qualitative fit test uses a harmless substance (usually an aerosol) that the wearer can smell or taste. If the wearer can smell or taste the substance while wearing the RPE, this suggests that the RPE does not fit correctly and is letting unfiltered air in.

Only quantitative fit testing provides objective, accurate, and reliable results.

Fit testing should be repeated:

- at least every year
- if a worker loses or gains weight
- if a worker has a change to their facial features (for example, after dental work or facial surgery).

Seal checks

A seal check is a check to make sure that there is a good seal between the respirator and the face. Workers should do a seal check each time a respirator is put on. Always follow the manufacturer's instructions when carrying out a seal check.

Figures 46 and 47 show the seal check procedures for negative-pressure respirators and positive-pressure respirators.

Negative-pressure seal check

1. Block the filters with the palms of your hands.
2. Gently breath in and hold for about 10 seconds.
3. Check to see if the facepiece is collapsing slightly.
4. If the facepiece stays collapsed and there are no more leaks between the face and facepiece, the respirator is properly fitted.
5. If leaks are detected, the straps of the respirator should be adjusted, and the fit check should be repeated.



FIGURE 46:
Negative-pressure
seal check procedure

Positive-pressure seal check

1. Block the exhalation valve with the palm of your hand.
2. Gently breath out and hold for about 10 seconds.
3. Check to see if the facepiece is bulging slightly.
4. If the facepiece stays bulging and there are no more leaks between the face and facepiece, the respirator is properly fitted.
5. If leaks are detected, the straps of the respirator should be adjusted, and the seal check should be repeated.



FIGURE 47:
Positive-pressure
seal check procedure

Other pre-use checks for RPE

The RPE should be checked to make sure it is clean and in good condition before each use. The wearer should be trained to do this. Table 39 summarises the pre-use checks.

DISPOSABLE AND HALF-MASKS	FULL-PIECE POWERED RESPIRATORS (INCLUDING CHECKS FOR DISPOSABLE AND HALF-MASKS)
The facepiece is clean and in good physical condition with no damage or distortion to the face seal.	Visor, seals, gaskets, and 'O' rings are present and in good condition with components that can connect securely. All threaded connectors and seals are in good condition.
Head harness and anchorage points are undamaged and can hold the facepiece on the face correctly, securely, and comfortably	Battery charge/condition
All valves (especially exhale valves) are present, in good condition and correctly seated	Airflow rate for power-assisted and powered respirators has been checked and meets manufacturer's specification
Filters are correct, in good condition, in date and securely fitted	The RPE is complete and correctly assembled
Any additional tests in accordance with the manufacturer's instructions	

TABLE 39: Summary of pre-use checks when wearing RPE

Hygiene, cleaning and maintenance of RPE

Each worker should have their own RPE where practicable. Having individual RPE minimises the risk that respiratory infections (for example, COVID-19) will spread between workers.

RPE should be labelled so it is easy to tell who it belongs to. This minimises the risk that a worker uses someone else's RPE.

After each use, RPE should be cleaned and disinfected (if needed) and stored in a sealable container in safe place away from areas contaminated with asbestos. Follow the manufacturer's instructions for cleaning and storage.

Important

Never store clean RPE with contaminated RPE.

See [Section 15: Personal decontamination](#) for more information on decontamination

Follow the manufacturer's instructions to clean, maintain, and perform additional checks and tests. Filters will need close monitoring. For example:

- damaged filters should be replaced following the manufacturer's instructions.
- workers should replace filters if they are damaged or if breathing resistance increases.
- some filter brands may not be usable after exposure to conditions like a decontamination shower. The PCBU should check with the supplier about the filter's effectiveness after such exposure.

Keep a record of inspections, maintenance, and any defects fixed for five years. Only use manufacturer-approved spare parts.

Never modify RPE without the manufacturer's approval.

Medical conditions

If workers are likely to wear RPE regularly, encourage them to have a medical assessment. A medical assessment can help to determine if:

- a worker is fit to wear RPE long-term, and
- a worker is fit to wear RPE for long periods at a time.

Consider any medical conditions that workers may have when deciding on the most appropriate RPE.

Positive-pressure RPE may be more suitable for workers who have medical conditions that make negative-pressure RPE difficult to use.

Monitoring RPE use

Appoint a competent person to take responsibility for monitoring and recording all aspects of RPE use during removal work.

Records of RPE are sometimes called a respiratory protection programme.

A respiratory protection programme should be reviewed regularly to check that requirements are still being met. Keep track of any changes made as a result of reviews.

Monitoring should be documented in writing, and include:

- information about the risks workers may be exposed to
- the information that has been used to select RPE for workers
- records of RPE training for each worker
- records of fit testing for each worker
- information about fit testing procedures
- information about maintenance, cleaning, and decontamination processes
- information about replacement and repair processes
- information about how the monitoring process is audited.

Training workers to use RPE

Workers should be given clear training, information, and instructions on:

- why a particular type of RPE is selected, its limitations, and which filters to use
- how to fit and use the RPE properly
- the importance of wearing a tight-fitting facepiece correctly, the need for fit testing when selecting equipment, and how to check the face seal before each use
- the risk of taking off or setting down RPE in a contaminated area, and what to do in a medical emergency
- how to recognise airflow reduction (where relevant) and what to do if it happens
- how to check the RPE before each use
- the need for thorough examination and maintenance of the RPE
- how to clean and decontaminate RPE after use and store it properly for reuse.

Removal workers should get refresher training on how to use RPE at least once a year.

PCBUs should not assume workers will always use RPE properly just because they have worn it before.

For more guidance for businesses and workers and the respirator selector tool see WorkSafe's webpage [Respiratory Protective Equipment \(RPE\)](#)

18.0

Health monitoring

IN THIS SECTION:

- 18.1 Purpose of health monitoring
- 18.2 Who does health monitoring apply to?
- 18.3 Who is responsible for making sure health monitoring is conducted?
- 18.4 Informing workers about health monitoring
- 18.5 Components of health monitoring
- 18.6 When health monitoring occurs
- 18.7 The people who carry out health monitoring
- 18.8 Paying for health monitoring
- 18.9 Information for the occupational health practitioner
- 18.10 Health monitoring report details
- 18.11 Who is entitled to the health monitoring report?
- 18.12 Storing and sharing health monitoring reports

Health monitoring looks at whether a worker's health is being harmed because of what they are being exposed to while working.

18.1 Purpose of health monitoring

Health monitoring can be used to detect if workers are experiencing health effects from potential exposures.

Asbestos-related diseases take years to appear, but doctors can run tests to monitor the health of people who work with asbestos. However, do not use these tests to assess asbestos control measures. Use asbestos air monitoring, especially personal air monitoring, to check if control measures are working.

Working in hazardous conditions can adversely affect workers' health – in both the short (acute) and long term (chronic). This includes when the work involves substances that are harmful to people's health (substances hazardous to health).

18.2 Who does health monitoring apply to?

Workers must get health monitoring if they are at risk of asbestos exposure when doing any of the following:

- Class A licensed asbestos removal work
- Class B licensed asbestos removal work that lasts more than four weeks in any 12-month period
- any other ongoing asbestos-related work or unlicensed asbestos removal where there is a risk of airborne asbestos exposure.

Self-employed PCBUs should monitor their own health to comply with the Act.

18.3 Who is responsible for making sure health monitoring is conducted?

For asbestos removal work, it is the duty of the asbestos removalist (PCBU) to provide health monitoring for its removal workers.

PCBUs should monitor their worker participation rates in health monitoring at regular periods, to make sure that they are fulfilling their duty to provide it.

18.4 Informing workers about health monitoring

The PCBU must tell its workers about any asbestos-related health monitoring requirements before they start any work that may expose them to asbestos.

The PCBUs must give those workers the following information:

- that the PCBU has a duty to carry out health monitoring
- what health hazard triggered the requirements for the health monitoring (in this case, asbestos)
- what the health monitoring will consist of and how it will be done
- the information that has to be given to the occupational health practitioner
- that the PCBU has a duty to obtain a health monitoring report from the occupational health practitioner
- that the PCBU has a duty to notify the regulator and other relevant PCBUs
- how health monitoring reports will be kept, stored, and shared, including keeping confidentiality
- the reasons for health monitoring:
 - to help the PCBU reduce the risk of exposure to health hazards in the workplace
 - to enable the PCBU and other PCBUs in the workplace to take remedial action within the workplace to manage the health risk
 - to help with treating and protecting workers who are or were exposed to health hazards
- that they will inform WorkSafe if test results indicate a worker may have a disease, illness, or injury caused by the work that triggered the health monitoring. This helps WorkSafe carry out its functions under the Act.

18.5 Components of health monitoring

Health monitoring must include specific checks to monitor the health of workers at risk of asbestos exposure, unless a medical practitioner recommends otherwise. This is called a 'full asbestos medical'.

Table 40 shows the checks needed to monitor a worker's health in these situations.

HEALTH MONITORING REQUIREMENT	DETAILS
Physical examination	This should focus on the respiratory system and include a lung function test (FEV1 and FVC). Note: A chest x-ray (PA and lateral) is no longer needed unless recommended by a specialist.
Worker's history	Demographic, medical, and occupational history
Exposure records	Personal exposure to asbestos, including: <ul style="list-style-type: none"> - relevant risk assessment reports - air monitoring results - personal exposure monitoring results. Investigation reports if the airborne contamination standard for asbestos was exceeded.

TABLE 40: Components of a full asbestos medical for health monitoring

18.6 When health monitoring occurs

A full asbestos medical must be conducted every two years following the initial medical examination, which must occur within four weeks of the worker starting asbestos removal work

A full asbestos medical should be done every two years from when asbestos work starts, no matter when the worker started work with their current PCBU.

Table 41 shows the health monitoring calendar to use for licensed asbestos removal workers.

YEARS AFTER STARTING ASBESTOS REMOVAL WORK	PROCEDURE
Within four weeks of commencing work	Initial full asbestos medical
Two years	Full asbestos medical
Four years	Full asbestos medical
Every two years thereafter	Full asbestos medical

TABLE 41:
Health monitoring calendar for licensed asbestos removal workers

18.7 The people who carry out health monitoring

An occupational health practitioner experienced in health monitoring must conduct or supervise the health monitoring.

18.8 Paying for health monitoring

The PCBU must pay all health monitoring costs for their workers. If multiple PCBUs are responsible for a worker's health monitoring, they can agree that one PCBU will organise it. However, all PCBUs must share the costs equally unless they agree otherwise.

18.9 Information for the occupational health practitioner

The PCBU who commissions health monitoring must give the following information to the occupational health practitioner:

- the PCBU's name and address
- each worker's name and date of birth
- a description of the type of work the workers are doing that triggered the need for health monitoring
- if the workers have started the work involving asbestos, and how long have they been doing it.

18.10 Health monitoring report details

The PCBU who arranges health monitoring must take all reasonable steps to get a report from the occupational health practitioner as soon as possible after the monitoring is complete.

The health monitoring report must include:

- the worker's name and date of birth
- the name of the occupational health practitioner
- the name and address of the PCBU who commissioned the health monitoring
- the date the health monitoring took place
- any test results that indicate whether the worker was exposed to a health hazard

- any advice if test results suggest the worker may have a disease, illness, or injury from the work that required health monitoring
- any recommendation for action, including whether the worker can continue the work that required health monitoring.

18.11 Who is entitled to the health monitoring report?

After receiving the report from the occupational health practitioner, the PCBU who arranges health monitoring must give a copy to the relevant people as soon as possible.

Table 42 shows who to send the report to.

NEED	DETAILS
Who gets the health monitoring report	<ul style="list-style-type: none"> - the worker - all PCBUs responsible for the worker's health monitoring - anyone with a duty to provide health monitoring for that worker. <p>Note: All parties who receive the health monitoring report must keep it confidential and treat the information in accordance with the Privacy Act 2020</p>
When to give the report to the worker	Workers must get a copy of their health monitoring report as soon as possible after the PCBU receives it.
Who gets a copy if certain conditions apply	<p>WorkSafe must get the report if it includes:</p> <ul style="list-style-type: none"> - test results showing the worker may have a disease, injury, or illness from working with asbestos - recommended actions, including whether the worker can keep working with asbestos.

TABLE 42:
Recipients of the health monitoring report

PCBUs may use relevant anonymised health monitoring results to track worker harm rates as part of standard health and safety performance reporting.

18.12 Storing and sharing health monitoring reports

The PCBU must keep each workers' health monitoring reports for at least 40 years.

When a worker leaves the business or the PCBU stops trading, the worker must get a copy of their health monitoring records. A copy of the records may also be sent to the worker's general practitioner if the worker consents to this.

The PCBU must not disclose a workers health monitoring report without the worker's written consent, unless:

- the PCBU must give a copy of the report to a relevant PCBU (such as in a principal-contractor relationship)
- the PCBU must give a copy of the report to WorkSafe or another Regulator.

For more information, see WorkSafe's webpage [Exposure monitoring and health monitoring – guidance for businesses](#)

19.0

Exposure monitoring

IN THIS SECTION:

- 19.1** The purpose of exposure monitoring
- 19.2** When and how exposure monitoring should be done for removal work
- 19.3** Exposure monitoring for other health risks

Carry out exposure monitoring to assess health risks, check if controls are effective, and decide when to review or change them.

19.1 The purpose of exposure monitoring

PCBUs that undertake asbestos removal must make sure that appropriate exposure monitoring is done for their workers while carrying out removal work.

The Health and Safety at Work (General Risk and Workplace Management) Regulations provide general requirements for exposure monitoring.

Exposure monitoring can be used to:

- identify, assess and confirm health risks
- identify where new control measures are needed
- monitor how well current control measures are performing, and
- identify when control measures need to be reviewed, updated or removed.

19.2 When and how exposure monitoring should be done for removal work

The type of monitoring that may be needed depends on the kind of work being done. A suitably qualified and experienced professional (such as an occupational hygienist or licenced asbestos assessor) can advise further on what type of monitoring is appropriate.

Typically, exposure monitoring for removal workers is done using personal air sampling.

This can be set up by assessors as part of the air monitoring inside the enclosure if the assessor is suitably qualified and trained in personal exposure monitoring. Otherwise, a suitably qualified occupational hygienist must set up the personal exposure monitoring.

Any results from personal air monitoring will need to be reviewed by a suitably qualified occupational hygienist. Only a suitably qualified occupational hygienist can do an exposure assessment.

The frequency of exposure monitoring will need to be assessed case-by case by the suitably qualified and experienced professional, taking into consideration (for example):

- the type of asbestos being removed
- the removal methods being used
- the current level of knowledge about likely fibre release from those methods
- the current level of knowledge about the protective factors of the RPE being used
- the length of time the removal is expected to take.

For more information, see WorkSafe's webpage [Exposure monitoring and health monitoring – guidance for businesses](#)

19.3 Exposure monitoring for other health risks

In addition to measuring asbestos exposure. Exposure monitoring should be considered for helping assess the risk of other health hazards common in asbestos worksites. Examples of other risks that should be considered include:

- noise
- hand-arm vibration
- heat stress
- biological hazards
- or exposure to harmful solvents.

A suitably qualified and experienced health and safety professional (such as an occupational hygienist) can advise on what type of additional exposure monitoring is appropriate based on the nature of the work, and risks identified.

For more information, see WorkSafe's webpage [Exposure monitoring and health monitoring – guidance for businesses](#)

Appendices

IN THIS SECTION:

Appendix 1: Asbestos removal control plan template

Appendix 2: Asbestos levels associated with asbestos activities

Appendix 3: Design criteria for asbestos decontamination units (DCUs)

Appendix 4: Decontamination processes

Appendix 5: Asbestos removal area handover form

Appendix 6: Glossary

Appendix 1:

Asbestos removal control plan template

This template is designed to incorporate the elements of the Asbestos Regulations.

It has two parts:

- complete part A when planning the asbestos removal work
- complete part B after the asbestos has been removed and clearance has been obtained.

PART A: To be completed before removal starts

Prepared by:

Date: DD / MM / YEAR

Asbestos removal licence holder: (PCBU name)

Licence number:

Asbestos removal licence holder's contact details:

For ACM removal at: (address)

On behalf of PCBU who commissioned asbestos removal: (client)

Identification

Have asbestos records been reviewed?

Yes

No



Asbestos removal control plan template

Informing parties and people

The following people or parties will be informed about the upcoming asbestos removal and intended start date (keep consultation records).

ENTITY	NAME AND POSITION	ORGANISATION	ADDRESS	PHONE/EMAIL
Person who commissioned removal (client)	Humphrey Bogare, Store Manager	The Purple Shack of Sales Ltd	1 Troy Boulevard, Wellington	04 555 1234
Client's workers and representatives	Bort Renault, site delegate, worker	The Union for Workers at the Purple Shack of Sales Inc	c/- 1 Troy Boulevard, Wellington	025 852 963

People or parties who must be informed (where relevant) are:

- person who commissioned the removal (client)
- client's workers and/or representatives
- PCBU with management or control of the workplace
- PCBU's workers and/or representatives
- home owner
- home occupant
- neighbouring properties.

Asbestos removal control plan template

Emergency planning

Trained first aider(s) on site:

NAME	CONTACT PHONE

List of emergency contact details attached to plan: Yes No

All site workers are trained in emergency response: Yes No

Emergency response equipment is indicated on the site plan: Yes No

The following have been identified as potential emergency situations (attach further details if needed).


EMERGENCY	CONTROLS TO MANAGE THE EMERGENCY

Site plan

Define the area or draw a site map indicating the areas.

Include:

- asbestos removal area
- asbestos work site (including where enclosure is located)
- entrances and exits
- waste storage
- decontamination area(s)
- emergency equipment
- signage
- barriers or means to prevent unauthorised access
- monitoring points
- other information as needed.



Asbestos removal control plan template

Control of non-asbestos hazards

The following risks have been identified during the planning stages of the asbestos or ACM removal: (provide additional pages if necessary).

RISKS	CONTROLS TO MANAGE THE RISKS

Personal protective equipment (PPE and RPE)

The following PPE and RPE will be supplied and worn at all times throughout the asbestos removal process:

Workers have received appropriate training for PPE and RPE use:

Yes No

Workers have received information about the health risks of licensed asbestos removal work and health monitoring requirements:

Yes No

Removal

Removal method

Detail the planned methodology for removing the asbestos or ACM. This must comply with the Health and Safety at Work (Asbestos) Regulations 2016 and should comply with WorkSafe's good practice guidelines for asbestos removal. (Provide additional pages as necessary.)

Asbestos removal control plan template

Tools and equipment

Warning: High-speed abrasive power or pneumatic tools such as angle grinders, sanders, saws and high-speed drills must not be used when removing asbestos or ACM.

The following tools and equipment will be used when removing asbestos or ACM:

Hand tools: (list)

Powered equipment: (list)

Saturation equipment: (list)

Vacuum cleaner(s)

Make:

Model:

Last test date: DD / MM / YEAR

Make:

Model:

Last test date: DD / MM / YEAR

Equipment maintenance

All tools and equipment used in removing asbestos or ACM are inspected before all removal work:	<input type="radio"/> Yes <input type="radio"/> No
All tools and equipment used in removing asbestos or ACM are inspected and cleaned following all removal work:	<input type="radio"/> Yes <input type="radio"/> No
All tools and equipment used in removing asbestos or ACM are inspected and cleaned at least once every seven days when in continuous use:	<input type="radio"/> Yes <input type="radio"/> No

Enclosure

Complete enclosure of the work area will be required:	<input type="radio"/> Yes <input type="radio"/> No
Enclosed area is displayed on site map/the location is described:	<input type="radio"/> Yes <input type="radio"/> No
<p>The enclosure will be constructed as follows: provide an overview of the size, shape and construction method to be used for the enclosure. (Provide additional pages as necessary.)</p>	

The following NPUs will be used in conjunction with the enclosure:

Make:	Model:	Rating:
Make:	Model:	Rating:
Other details:		

Smoke testing should be conducted prior to use and at the following intervals to confirm the integrity of the enclosure. Keep records of these tests.

Frequency of testing:
Person(s) responsible for conducting and recording the tests:

Asbestos removal control plan template

Decontamination facilities

Describe the decontamination facilities that will be interconnected or used with the enclosure (include decontamination of tools, plant or equipment, reusable PPE, people, removal area, contained waste):

Other control measures

The following additional controls will be put in place to contain asbestos within the designated asbestos work area:

Management and disposal of asbestos waste

On-site containment of removed ACM

Removed (waste) asbestos or ACM will be held on-site for more than one working day:	<input type="radio"/> Yes <input type="radio"/> No
Person responsible for safe asbestos waste storage on site:	
If yes, detail how the ACM will be stored, including the type of storage containers to be used and the dedicated location for stored waste within the removal area:	
Asbestos waste will be stored in a labelled, sealed container before removing it from the site:	<input type="radio"/> Yes <input type="radio"/> No
All asbestos waste will be stored in the designated location for asbestos waste:	<input type="radio"/> Yes <input type="radio"/> No
Used, disposable PPE and RPE will be stored in a labelled, sealed container before removing it from the site:	<input type="radio"/> Yes <input type="radio"/> No
Used, reusable clothing (such as gumboots) will be stored in a labelled, sealed and decontaminated container before transporting or :	<input type="radio"/> N/A <input type="radio"/> Yes <input type="radio"/> No
stored in a labelled, sealed and decontaminated container before re-use in an asbestos work area:	<input type="radio"/> N/A <input type="radio"/> Yes <input type="radio"/> No

Air monitoring and clearance

Air monitoring programme

If **no** air monitoring will be required, provide reasons:

Asbestos removal control plan template

Details of the licensed asbestos assessor or competent person engaged to plan and conduct air monitoring and clearance:

Name:	
Assessor licence number: (if applicable)	
Contact details:	

The following air monitoring will be conducted:

Before removal: number and frequency of testing:	
During removal (control monitoring): number and frequency of testing:	
Monitoring points identified on site map:	<input type="radio"/> Yes <input type="radio"/> No
Air monitoring proposal attached to this control plan:	<input type="radio"/> Yes <input type="radio"/> No

Declaration and sign-off

<input type="radio"/> I declare the information contained in Part A of this plan is accurate to the best of my knowledge	
Signed by:	Date: DD / MM / YEAR

Upon completion of this section, provide a copy of the plan and related documents to:

PCBU who commissioned the removal:	<input type="radio"/> Yes <input type="radio"/> No
Other (state):	<input type="radio"/> Yes <input type="radio"/> No

The plan should be made available to the PCBU with management or control of the workplace, workers and their representatives, and home occupants (as applicable).

PART B: To be completed after removal and clearance

Timing of removal work

Start date: DD / MM / YEAR	Completion date: DD / MM / YEAR	Date of notification to WorkSafe: DD / MM / YEAR
----------------------------	---------------------------------	--

Copy of notification attached

Informing parties and people

In addition to the information recorded in Part A, the following people or parties were also informed about the asbestos removal and start date:

ENTITY	NAME AND POSITION	ORGANISATION	ADDRESS	PHONE/EMAIL

Asbestos removal control plan template

Respirators (RPE)

All workers wearing a negative-pressure respirator (RPE) were clean-shaven:	<input type="radio"/> Yes <input type="radio"/> No
(Where applicable): the following RPE was provided to workers who could not wear negative pressure RPE:	

Disposal of asbestos waste

PCBU engaged to transport waste:	
Disposal site was:	
Total quantity and dimensions of asbestos waste removed:	
Copies of waste disposal docket, permits or other paperwork received:	<input type="radio"/> Yes <input type="radio"/> No

Clearance

Did the asbestos removal area pass the clearance inspection:	<input type="radio"/> Yes <input type="radio"/> No
Copy of clearance certificate received, with test results:	<input type="radio"/> Yes <input type="radio"/> No

Declaration and sign-off

<input type="radio"/> I declare the information contained in Part B of this plan is accurate to the best of my knowledge	
Signed by:	Date: DD / MM / YEAR

Upon completion of this section, provide a copy of the plan and related documents to:

PCBU who commissioned the removal:	<input type="radio"/> Yes <input type="radio"/> No
Other (state):	<input type="radio"/> Yes <input type="radio"/> No

The plan should be made available to the PCBU with management or control of the workplace, workers and their representatives, and home occupants (as applicable).

Appendix 2: Asbestos levels associated with asbestos activities

The figures in the following tables are for guidance only and are expressed as respirable fibres per millilitre of air (fibrés/ml).

They may be useful for helping to determine RPE requirements for upcoming asbestos work.

Because the airborne fibre level cannot be accurately assessed in each case, and differences in operation may lead to higher levels than stated, always assess the level of required RPE on the high side or worst-case scenario.

PRODUCT GROUP		CONTROLLED WET REMOVAL/ GOOD PRACTICE (f/ml)	LIMITED CONTROLS/ DRY REMOVAL (f/ml)
ASBESTOS REMOVAL WORK	Controlled wet stripping of lagging and sprayed coatings using manual tools	Up to 1	1-100 (lagging) Up to 1,000 (coatings)
	Moulded plastics and battery cases	0.001	0.01
	Jointings (gaskets) and packing	0.05	0.2
	Asbestos cement sheeting	Up to 0.5	No information
	Flooring	0.01	0.05
	Fillers and reinforcements in a flexible matrix (including textured coatings)	0.02	0.08
	Spray and other insulation products	14.4	358
	Asbestos insulating board, including millboard	Up to 3	5-20

Respirable dust testing gives some indication about dust levels normally found in common industrial situations.

PRODUCT GROUP		TYPICAL (f/ml)	EXTREMES LIKELY (f/ml)
ASBESTOS-RELATED WORK	Cleaning asbestos cement vertical cladding	1-2 (wet wire brushing)	5-8 (dry wire brushing)
	Cleaning asbestos cement roofing	1-3 (wet wire brushing)	3 (dry wire brushing)
	Stacking asbestos cement sheets	Up to 0.5	No information
	Machine sawing with LEV	Up to 2	No information
	Abrasive disc cutting without LEV	15-25	No information
	Circular saw cutting without LEV	10-20	No information
	Drilling asbestos insulating board with shadow vacuuming or LEV	Up to 1	No information
	Drilling asbestos insulating board overhead without LEV	5-10	No information
	Drilling vertical columns without LEV	2-5	No information
	Using a jigsaw on asbestos insulating board	2-10 (with LEV)	5-20 (without LEV)
	Hand sawing asbestos insulating board	5-10	No information
	Ambient air below sprayed insulation	Usually 0.1	0.2-1
	Changing filter bags	10	No information

	PRODUCT GROUP	TYPICAL (f/ml)	EXTREMES LIKELY (f/ml)
ASBESTOS-RELATED WORK	Dry sweeping	0-2	No information
	Handling talc (may contain minor tremolite)	Up to 2	No information
	Handling/quarrying serpentine (with minor chrysotile)	Up to 2	Possibly up to 100 if conditions are very dusty
	Cutting ACM, etc dry with power tools	0-2	Up to 20
	Cutting ACM, etc wet with power tools	Up to 1	Up to 10
	Construction work (outside)	Up to 1	Up to 10
	Cutting ACM with hand tools	Up to 1	1
	Cutting, finishing, radius grinding, etc	Normally 1	No information
	Handling friction materials (pads, etc)	Up to 0.5	No information
	Cutting gaskets	Up to 2	No information
	Cutting greenstone (associated with tremolite)	Up to 2	No information

Appendix 3: Design criteria for asbestos decontamination units (DCUs)

The criteria listed here apply to mobile and modular units, unless otherwise stated. Mobile units offer more space to decontaminate properly. A modular unit should only be used where space does not permit the use of a mobile unit and where its use removes the need for transit procedures.

Design and general construction

DCUs units should:

- be weatherproof or only be used inside a weatherproof building
- be able to be made level on uneven ground
- be robust enough not to distort when moved (racks are available for the storage of modular unit panels)
- have fixings that are not easily damaged in transport or use or dismantling
- be roadworthy
- be of adequate size. Modular units should have minimum internal dimensions for each compartment of 1m x 1m x 2m (height). Modular units should only be used by a maximum of two people at any one time. Mobile units are expected to be larger than modular units
- have self-closing doors which should separate the three compartments (clean, shower, and dirty)
- have locks between each compartment so the occupant can maintain personal privacy while using each compartment
- have outward opening doors on the external access to the clean and dirty ends (self-closing at dirty end)
- have internal surfaces that are waterproof. Ledges and grooves should be avoided. The installation of windows should be avoided, but any windows provided should be non-opening, unbreakable, and fitted flush with the inner wall. Units should be capable of being cleaned on site so that a clearance certificate can be issued showing the next user that the unit has been cleaned
- be capable of being locked when not in use
- have enough water storage for thorough washing.

Heating and lighting

- Heating should be provided, and heating appliances should be easy to clean.
- Units designed to be used inside buildings should be fitted with electrical water heating systems to avoid the need to vent combustion gases from gas appliances to the open air.
- Where gas appliances are fitted, they should meet relevant New Zealand standards and be installed by a competent, qualified gas fitter
- LPG cylinders should be stored and transported in an external ventilated cupboard or rack that can be readily secured.
- Only room-sealed balanced flue-type gas heating appliances should be used.
- There should be adequate lighting for workers to see what they are doing and if they have sufficiently decontaminated themselves.
- Light fittings and other electrical appliances should be easy to clean and double insulated or permanently wired into the circuit and switched.

Services

- All electrical equipment must meet relevant electrical standards
- Connections to the water supply should have flexible joints. The supply should be protected against frost.
- Water filtration: wastewater should be filtered through a high efficiency filter (specification less than 5 microns).
- Hot water systems should be designed to avoid 'dead-legs' where legionella bacteria could grow.

Ventilation

DCUs should never be directly attached to the enclosure without the airlock because contaminated air may be drawn in from the enclosure into the dirty end of the DCU.

The intervening space is there to provide an air gap between the enclosure and the DCU and it must be fitted with a vent to the open air. The vent openings should be constructed in a similar manner to the enclosure's access openings (the slits with weighted flap). but should be smaller so they cannot be used for entry or exit.

- The unit should be ventilated. Air should be drawn in at the clean end, pass through the shower and be discharged at the dirty end (the NPU should be in the dirty end). A minimum of 30 air changes per hour should be achieved in the dirty end.
- Grilles should be a minimum of 15cm x 30cm and pressure/gravity-operated flaps a minimum of 20cm x 23cm.
- External vents should be located as near to a central position as possible or have two symmetrical intakes. They should be provided with dust caps for transit.
- Air should be discharged through a HEPA filter (H Class) and through a pre-filter.
- The extraction point should be placed low down in the dirty end (or placed externally on modular units), but leaving enough room to clean beneath it, and positioned so that cleaning water does not damage it.
- A visible or audible warning device (such as a pressure gauge or warning light) should alert users to failure of the NPU.

Facilities within compartments

SHOWER COMPARTMENT

Showers should have:

- locks on both doors which can be controlled from within the shower compartment
- a curtain rail (but no shower curtain) for workers to hang their RPE battery pack while showering
- regulated water pressure so that pressure does not drop when pumping water out of the unit or while using the wash-hand basin at the same time as one of the showers.
- a thermostat
- a shower rose
- a shower tray
- an outlet to the drain
- a holder for soap or shower gel (shower gel helps to prevent the wastewater filter getting blocked)
- shampoo and nail brush.

THE CLEAN END

The clean end needs to have the most space available for storage and dressing and undressing. Units can be designed to add on an extra unit or suitable changing area at this point to extend the facilities.

The clean end should have:

- locks on both doors which can be controlled from within the compartment
- hooks for hanging up clothing
- a locker for each worker to store valuables
- battery-charging facilities (unless provided separately with a modular unit)
- a mirror
- fixed seating.

THE DIRTY END


The dirty end should have:

- locks on both doors which can be controlled from within the compartment
- hooks for workers to hang RPE belts on while removing work or transit clothing
- hooks to hang up work or transit clothing
- sufficient space to hold bagged waste filters
- fixed bench-type seating
- a wash-hand basin with plug and drainage point for washing dirty hands.

Appendix 4: Decontamination processes


Decontamination process: DCU attached to enclosure

Entering enclosure

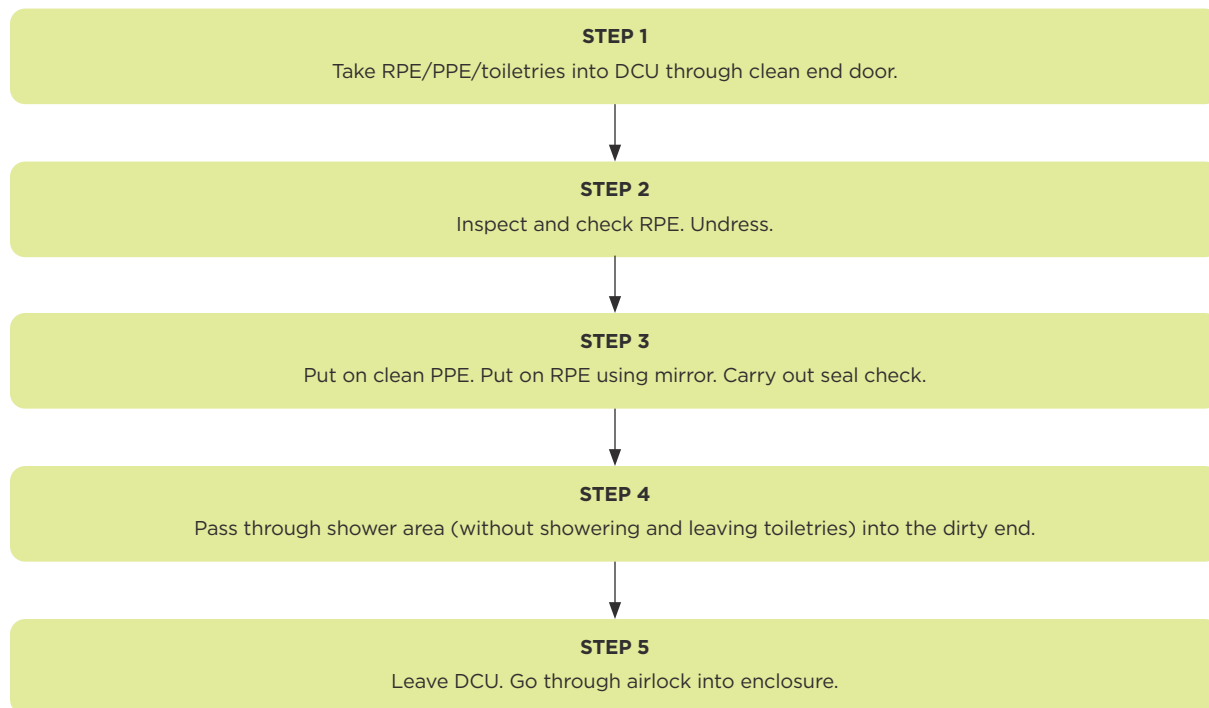


Decontamination process: DCU attached to enclosure

Leaving enclosure

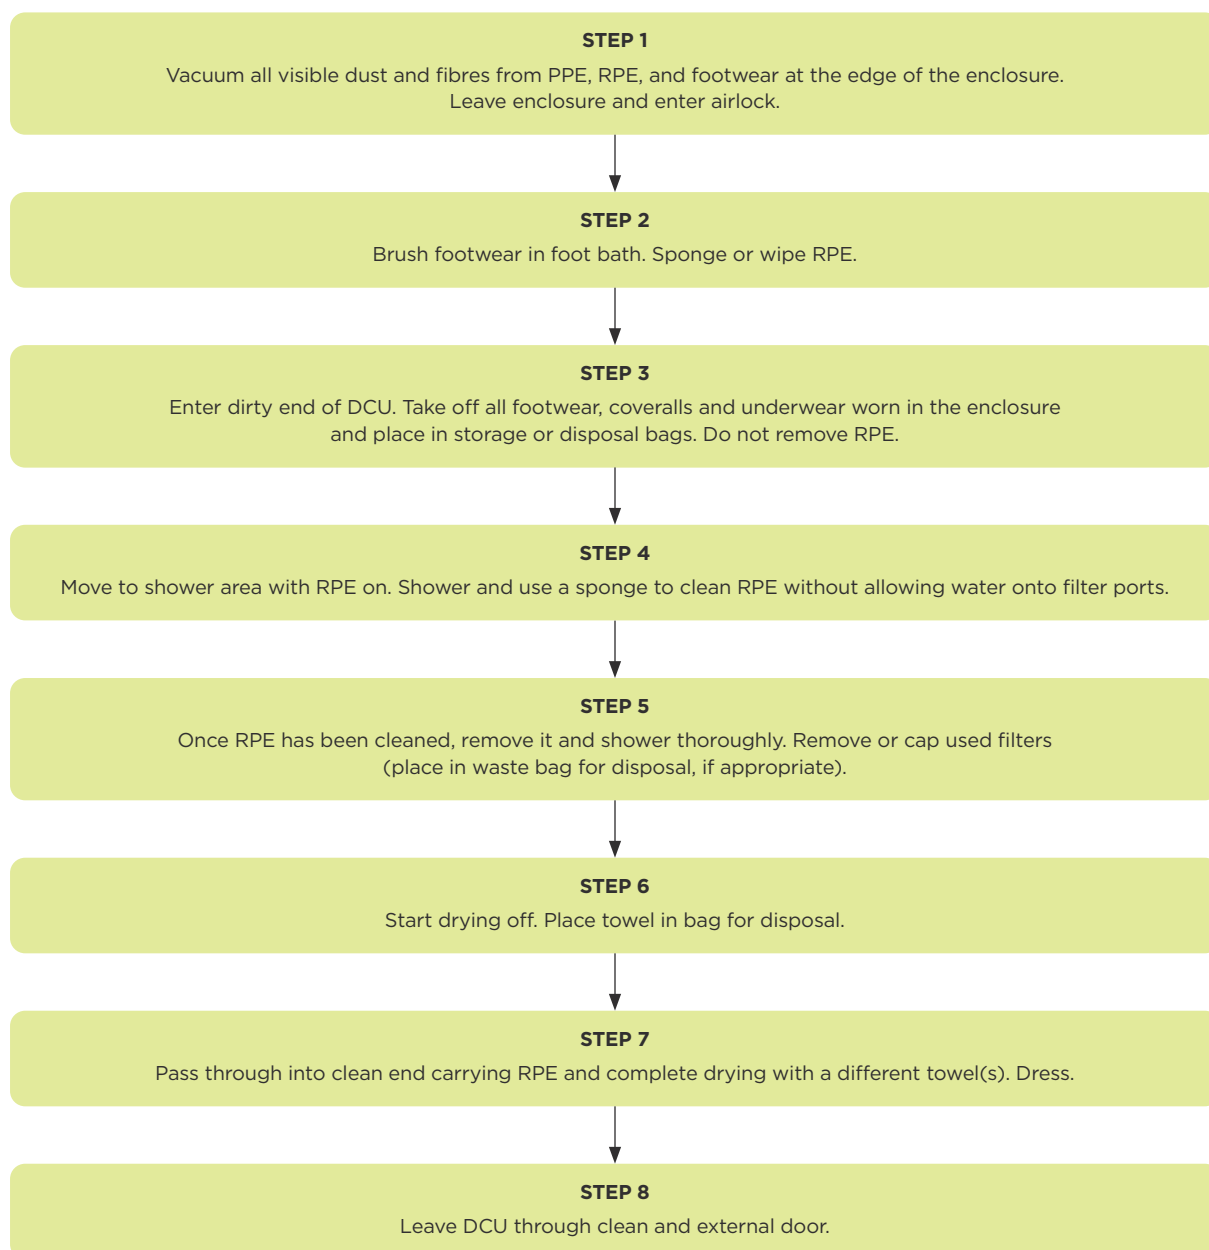


Decontamination process: Transiting procedure

Entering enclosure with new work coveralls

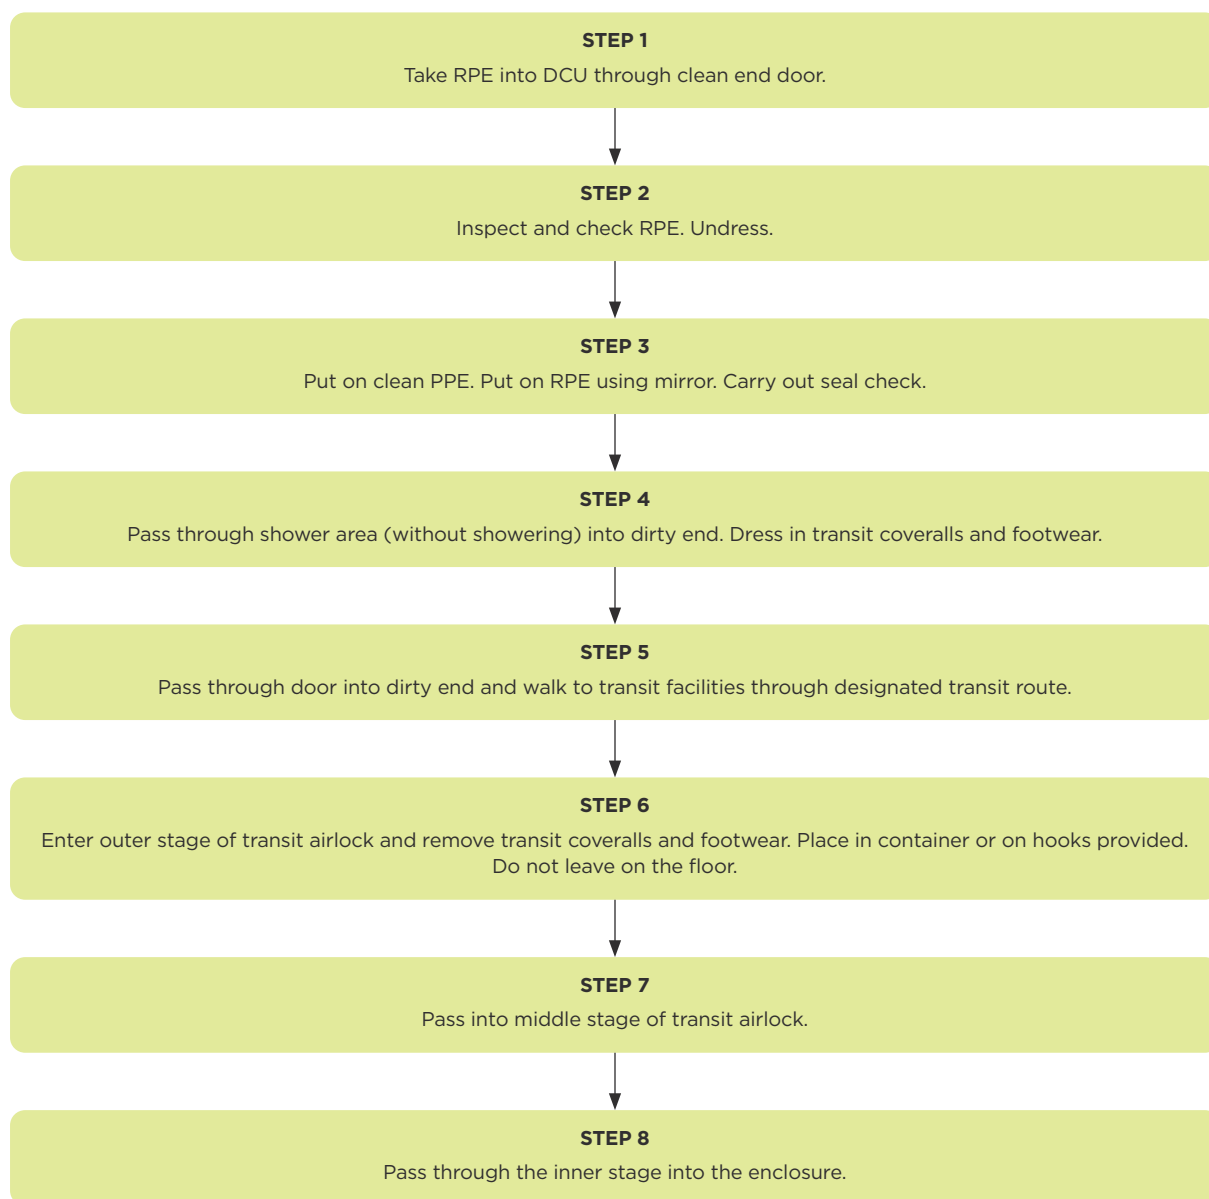


Decontamination process: Transiting procedure

Entering enclosure after break

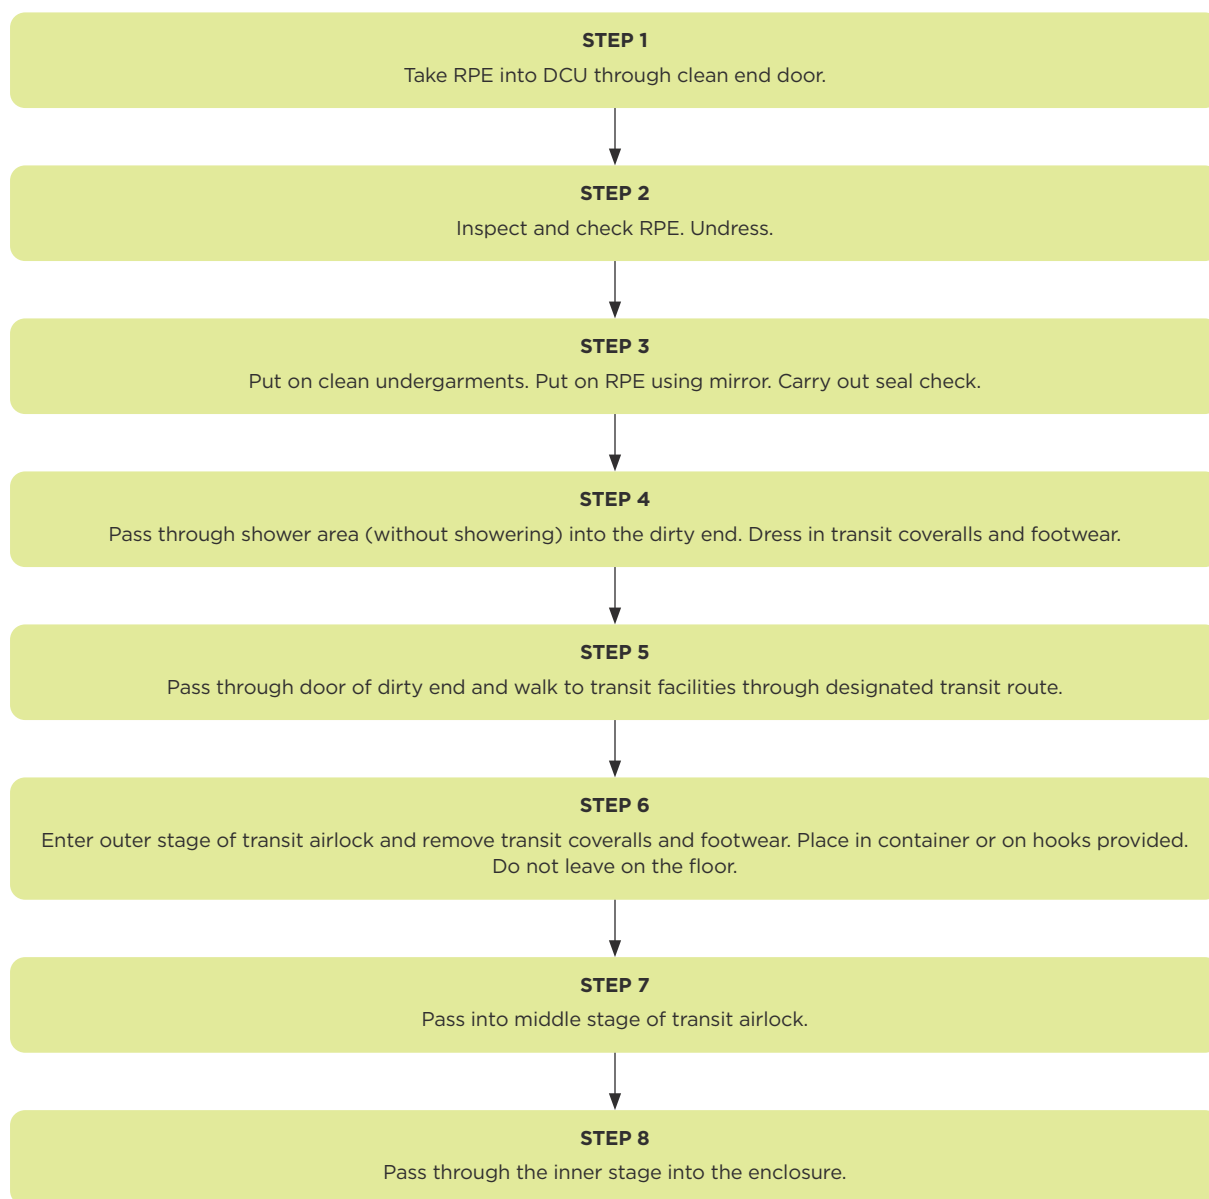

Decontamination process: Transiting procedure

Leaving enclosure

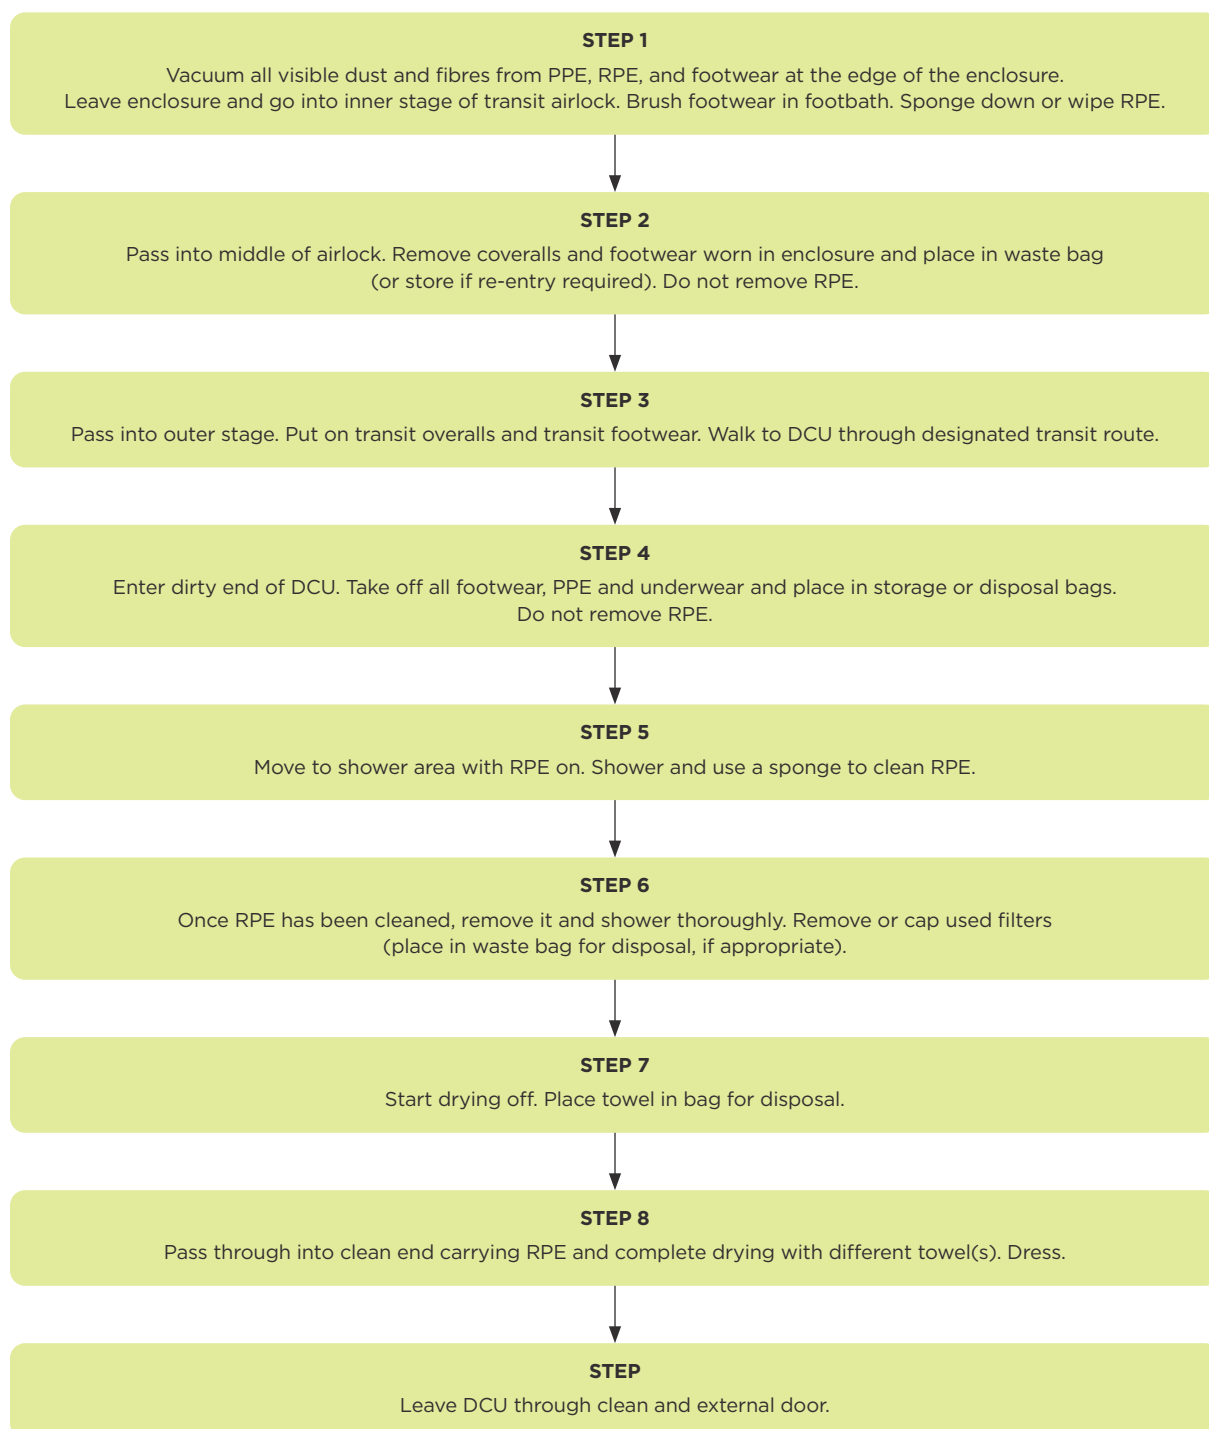

Appendix 5:

Asbestos removal area handover form

The removalist's visual inspection form must be given to the assessor before the four-stage clearance starts. The removalist must keep a copy.

Objective: Supervisor to carry out the thorough visual inspection of enclosure/work area to confirm the readiness for clearance inspection. Areas to be clean from visible debris and dust.

Site address:

Size of enclosure: (see ARCP) (L×W × H (metres))

If 'No' is selected, please explain.

Has a new NPU pre-filter been installed? Yes No

Have all ACM removal locations been checked and confirmed free from asbestos? Yes No

Have all floor surfaces, walls, and items been inspected and confirmed visually clean? Yes No

Have all ledges, sills, high surfaces, and voids been inspected and confirmed visually clean? Yes No

Have ACM removal locations been checked and confirmed visually clean? Yes No

Have all rooms been checked and confirmed visually clean? Yes No

Have all cables, wiring, and items staying in enclosure during the four-stage clearance been checked and confirmed visually clean? Yes No

How long did the supervisor's visual inspection take?

Start time: AM PM

Finish time: AM PM

Total time: (hours/minutes)

I confirm that I have carried out a thorough visual inspection of the enclosure or work area, and the area is visually clean and ready for the assessor for the independent four-stage clearance.

Supervisor's signature:

Date: DD / MM / YEAR Time: AM PM

Hand form to assessor before the four-stage clearance starts

Supervisor's signature:

Date: DD / MM / YEAR Time: AM PM

Appendix 6: Glossary

TERM	DEFINITION
Accredited laboratory	<p>A laboratory that is accredited by either:</p> <ul style="list-style-type: none"> - International Accreditation New Zealand (IANZ) - Another accreditation regime recognised by WorkSafe, such as National Association of Testing Authorities (NATA). <p>A laboratory may also be approved by WorkSafe to test samples for the presence of asbestos or asbestos-containing material (ACM) for up to 12 months while obtaining accreditation.</p>
Air monitoring	Measuring airborne asbestos fibre concentrations by sampling and analysing them.
Airborne contamination standard for asbestos	The average concentration of 0.1 respirable asbestos fibres per millilitre of air over any eight-hour period.
Asbestos	<p>A naturally occurring fibrous silicate mineral (rock-forming mineral), from the serpentine or amphibole groups.</p> <p>There are two groups of asbestos, and six common types:</p> <ul style="list-style-type: none"> - actinolite asbestos - anthophyllite asbestos - chrysotile asbestos (white) - crocidolite asbestos (blue) - grunerite (or amosite) (brown) - tremolite asbestos - a mix of one or more minerals from this list.
Asbestos assessors	<p>Asbestos assessors are authorised by WorkSafe to assess if asbestos removal work has been completed to the required standard and that the area where asbestos removal took place is safe for reoccupation.</p> <p>Only an independent licensed asbestos assessor can carry out regulated activities for Class A removal work. This includes:</p> <ul style="list-style-type: none"> - air monitoring - clearance inspection - issuing clearance certificates. <p>An independent licensed asbestos assessor may also carry out other activities as part of contractual obligations.</p> <p>For example, review a work plan made by an asbestos removalist prior to removal work to make sure it is safe and suitable before work starts.</p>
Asbestos-contaminated dust or debris (ACD)	Dust or debris that has settled within a workplace or home and is, or is assumed to be, contaminated with asbestos
Asbestos Management Plan (AMP)	<p>A document that sets out where any identified asbestos material is present and how it will be managed including:</p> <ul style="list-style-type: none"> - what to do if there is an incident or emergency involving asbestos or ACM at work - the roles and responsibilities of workers who do asbestos-related work, and details on their training and health checks.
Asbestos identification and management process	<p>A framework that can be followed which sets out how to manage asbestos material in a building or workplace.</p> <p>Its steps include how to:</p> <ul style="list-style-type: none"> - identify asbestos material in your building or workplace - prioritise and manage the risks of asbestos - keep up-to-date records of your asbestos management approach.
Asbestos management survey	<p>An assessment of a building or workplace undertaken by an asbestos surveyor to:</p> <ul style="list-style-type: none"> - identify and record the location, amount, and type of asbestos material readily accessible during normal occupancy of the building (including maintenance) - inspect and record information about the condition of asbestos material present - confirm whether material suspected to be asbestos material is asbestos material.

TERM	DEFINITION
Asbestos refurbishment or demolition survey	An assessment of a building undertaken by an asbestos surveyor when a building or workplace (or part of it) is going to be refurbished or demolished. The purpose of a refurbishment or demolition survey is to locate all the asbestos material in a building or workplace (or part of it) before refurbishment or demolition work starts.
Asbestos register	A document that lists all identified or presumed asbestos in a building or workplace.
Asbestos Regulations	The Health and Safety at Work (Asbestos) Regulations 2016.
Asbestos Removal Control Plan (ARCP)	A document prepared by a licensed asbestos removalist that includes information about: <ul style="list-style-type: none"> - how the asbestos removal will be carried out (including the method, tools, equipment, and PPE that will be used) - the asbestos material that will be removed (including its location, type, and condition) - the asbestos removal area for the work and any air monitoring points - how asbestos waste will be transported and disposed of.
Asbestos removal licence	A Class A or Class B asbestos removal licence.
Asbestos removal work	Work involving the removal of asbestos, asbestos-contaminated soil, or asbestos-containing material.
Asbestos removalist	A PCBU that carries out asbestos removal work.
Asbestos surveyor	A PCBU that carries out asbestos survey work.
Asbestos waste	Asbestos material, asbestos-contaminated soil, or asbestos-containing material that has been removed. Asbestos waste also includes items used when working with or around asbestos material (for example, plastic sheeting and disposable PPE) that need to be disposed of.
Asbestos-Containing Material (ACM)	Any material or thing that, as part of its design, contains asbestos.
Asbestos-Contaminated Dust or Debris (ACD)	ACD is dust or debris that has settled within a workplace, and is, or assumed to be, contaminated with asbestos. Examples of ACD include: <ul style="list-style-type: none"> - dust or debris that was accidentally dislodged from a wall or ceiling following a collision - dust or debris that has accumulated over time. For example: <ul style="list-style-type: none"> - in an ACM pipeline or conduit - surrounding an ACM cement flue - in an electrical switchboard with an ACM electrical mounting board or conduit box - on a horizontal surface covered by an ACM roof in the guttering from an ACM roof.
Asbestos-contaminated soil	Soil that is contaminated with asbestos material or ACM.
Asbestos-related work	Work involving asbestos other than asbestos removal work.
Business or undertaking	The usual meanings are: <ul style="list-style-type: none"> - business: an activity usually carried out with the intention of making a profit or gain - undertaking: an activity that is non-commercial in nature (for example, certain activities of a local authority or a not-for-profit group).
Certified (training)	A certificate obtained from a training provider for undergoing training for either Class A or Class B licensed asbestos removal work.
Class A asbestos removal licence	A licence that authorises the holder to carry out Class A asbestos removal work for any type or quantity of asbestos or ACM, including: <ul style="list-style-type: none"> - any amount of friable asbestos or ACM - any amount of ACD - any amount of non-friable asbestos or ACM.
Class A asbestos removal work	Asbestos removal work for which a Class A asbestos removal licence is required for friable asbestos.

TERM	DEFINITION
Class B asbestos removal licence	A licence that authorises the holder to carry out Class B asbestos removal work for: <ul style="list-style-type: none"> - any amount of non-friable asbestos or ACM - ACD associated with removing any amount of non-friable asbestos or ACM.
Class B asbestos removal work	Asbestos removal work for which a Class B asbestos removal licence is required for non-friable asbestos.
Clearance inspection	An inspection of an asbestos removal area after asbestos removal work has been completed to verify that the area is safe for normal use.
Clearance certificate	A formal document issued after asbestos removal, confirming that the area is safe for reoccupation.
Competent person	A competent person means a person who has the knowledge, experience, skills, and qualifications to carry out a particular task under these regulations, including any knowledge, experience, skills, and qualifications prescribed in a safe work instrument.
Control measure	A way of eliminating or minimising risks to health and safety.
Demolition	Demolishing or dismantling a structure, or part of a structure, or equipment that is loadbearing or otherwise related to the physical integrity of the structure. It excludes: <ul style="list-style-type: none"> - dismantling formwork, falsework, or other temporary structures used for support, access, or safety during construction - removing power, light, or phone poles.
Double-bagging	A method of sealing asbestos waste in two heavy-duty plastic bags to prevent contamination during disposal.
Duty	A legal obligation to act responsibly according to the law.
Duty holder	A person who has a duty under HSWA. There are four types of duty holders - PCBUs, officers, workers, and other persons at workplaces.
Eliminate	To remove the sources of harm (for example, equipment, substances, or work processes).
Emergency	An uncontrolled event that has caused, or could cause: <ul style="list-style-type: none"> - loss of life - injury - serious property damage. <p>It can include declarations of civil defence emergencies, fires, or other significant incidents. It does not include delays unless these are the result of one of the above situations.</p>
Enclosure	A sealed physical barrier used during asbestos removal to prevent fibre release into the surrounding environment.
Exposure monitoring	Exposure monitoring measures and evaluates what a worker is being exposed to while they are at work.
Friable	In a powder form, or can be crumbled, pulverised, or reduced to a powder by hand pressure when dry.
Good practice guidelines (GPG)	Describes current 'good practice' to help duty holders understand and apply their duties under HSWA.
GRWM Regulations	Health and Safety at Work (General Risk and Workplace Management) Regulations 2016.
Hazard	A potential source of harm. It could include an object, situation, or behaviour.
Hazardous substance	A substance, or product containing a substance, that is known or suspected to cause harm to health, including substances: <ul style="list-style-type: none"> - classified as having toxic or corrosive properties under the Hazardous Substances and New Organisms Act 1996 - for which a prescribed exposure standard exists - specified in a safe work instrument as requiring health monitoring.

TERM	DEFINITION
Health monitoring	Monitoring a person to identify any changes in their health status because of exposure to certain health hazards arising from the conduct of the business or undertaking. Health monitoring is a way to check if the health of workers is being harmed from exposure to hazards while carrying out work. It aims to detect early signs of ill-health or disease.
Homogeneous materials	Material that is like in colour and texture, and uniform in nature.
HSWA	Health and Safety at Work Act 2015. The key work health and safety legislation in New Zealand. HSWA applies to all work and workplaces unless specifically excluded. You can find the full text of the Act on the New Zealand Legislation website
Independent	In the context of asbestos removal and assessment, to be independent the asbestos assessor or competent person should be able to be objective and impartial when performing their role and not subject to any unmanaged conflict of interest that could influence their decisions.
IANZ	International Accreditation New Zealand.
Licensed asbestos assessor	A competent person licensed by WorkSafe to carry out clearance inspections for Class A asbestos removal work and Class A air monitoring.
Licensed asbestos removal work	Removal work for which a Class A or Class B asbestos removal licence is required.
Licensed asbestos removalist	A PCBU that holds a Class A or Class B asbestos removal licence.
Minimise	To take steps that protect the health and safety of people by reducing the likelihood of an event occurring, reducing the level of harm to people if it does occur, or both.
NATA	National Association of Testing Authorities.
Negative Pressure Unit (NPU)	Equipment that maintains negative air pressure in an enclosure to prevent the spread of airborne asbestos fibres.
Non-friable asbestos	In relation to asbestos or ACM, means not friable, and for this definition, asbestos and ACM include material containing asbestos fibres reinforced with a bonding compound.
Other persons at the workplace	Includes workplace visitors and casual volunteers (who are not volunteer workers). These people have their own health and safety duties to take reasonable care to keep themselves safe and to not harm others at a workplace.
Overlapping duties	When a PCBU shares duties with other PCBUs. When two or more PCBUs are working together at the same location or through a contracting chain, they must work together to fulfil their duties of care and manage risks. Where those duties overlap, the PCBUs must consult, cooperate and coordinate with each other to meet their health and safety responsibilities to workers and others.
PCBU	Person conducting a business or undertaking. In most cases a PCBU will be a business entity, such as a company. However, an individual carrying out business as a sole trader or self-employed person is also a PCBU. A PCBU does not include workers or officers of a PCBU, volunteer associations with no employees, or home occupiers that employ or engage a tradesperson to carry out residential work.
Plant	Includes: <ul style="list-style-type: none"> - any machinery, vehicle, vessel, aircraft, equipment (including personal protective equipment), appliance, container, implement, or tool - any component of any of those things - anything fitted or connected to any of those things.
Policy clarification	Aims to clear things up by clarifying WorkSafe's approach on a specific issue.
Position	Outlines how WorkSafe interprets key concepts in law.

TERM	DEFINITION
PPE	<p>Personal protective equipment.</p> <p>Anything used or worn by a person (including clothing) to minimise risks to the person's health and safety.</p> <p>This may include, but is not limited to:</p> <ul style="list-style-type: none"> - respiratory protective equipment - protective helmets - protective eyewear - protective boots - protective gloves - hearing protection - high-vis clothing - sunhats - sunscreen and lip protection - safety harness systems.
Primary duty of care	<p>A PCBU must make sure, so far as is reasonably practicable, the health and safety of workers, and that other persons are not put at risk by its work. This is called the 'primary duty of care'.</p>
Readily accessible	<p>The document can be accessed without difficulty in hard copy, electronic form, or any other form.</p>
Reasonably practicable	<p>What is, or was, reasonably able to be done to ensure health and safety, taking into account and weighing up relevant matters including:</p> <ul style="list-style-type: none"> - the likelihood of the risk concerned occurring or workers being exposed to the hazard - the degree of harm that might result - what the person concerned knows, or ought reasonably to know, about: <ul style="list-style-type: none"> - the hazard or risk - ways of eliminating or minimising the risk. - the availability and suitability of ways to eliminate or minimise the risk - after assessing the extent of the risk and the available ways of eliminating or minimising the risk, the cost associated with available ways of eliminating or minimising the risk, including whether the cost is grossly disproportionate to the risk. <p>For more information, see WorkSafe's fact sheet Reasonably practicable</p>
Refurbishment	<p>Carrying out work in a building or structure with an emphasis on changing or upgrading it.</p>
Risk	<p>Risks arise from people being exposed to a hazard (a source of harm).</p>
Safe work instrument (SWI)	<p>A type of subordinate instrument (sometimes called tertiary legislation) under HSWA. SWIs can be used for almost any purpose, however, they only have legal effect where specifically referred to in relevant regulations.</p> <p>SWIs can be used to:</p> <ul style="list-style-type: none"> - prescribe detailed or technical matters or standards that change relatively frequently and will often be industry-specific - set additional or modified control measures for hazardous substances approved or reassessed by the Environmental Protection Authority - provide an alternative means of complying with regulations - support the effective operation of the health and safety regulatory framework, for instance by setting exposure monitoring standards or stipulating requirements for training, competence, or safety management systems.
Safety data sheet (SDS)	<p>Describes the properties and uses of a substance, that is, its identity, chemical and physical properties, health hazard information, precautions for use, and safe handling information.</p>
Sample analysis	<p>Methods used to identify and quantify asbestos in materials or soils.</p>
Shadow vacuuming	<p>Holding a vacuum cleaner nozzle close to the task being performed and sucking the dust and debris away as it is created.</p> <p>In work involving asbestos, this should be using an H-Type vacuum that has been recently DOP tested, otherwise there is a risk of mobilising asbestos fibres and creating a contamination scenario.</p>

TERM	DEFINITION
Surface testing	Planned and controlled disturbance of enclosure surfaces immediately prior to clearance air monitoring.
Trace level	An average concentration of less than 0.01 respirable asbestos fibres per millilitre of air.
WEPR Regulations	Health and Safety at Work (Worker Engagement, Participation, and Representation) Regulations 2016.
Worker	<p>An individual who carries out work in any capacity for a PCBU. A worker may be:</p> <ul style="list-style-type: none"> - an employee - a contractor or subcontractor - an employee of a contractor or subcontractor - an employee of a labour hire company - an outworker (including a homeworker) - an apprentice or a trainee, a person gaining work experience or on a work trial - a volunteer worker. <p>Workers can be at any level (for example, managers are workers too).</p> <p>A PCBU is also a worker if the PCBU is an individual who carries out work in that business or undertaking.</p>
Workplace	<p>Any place where a worker goes or is likely to be while at work, or where work is being carried out or is customarily carried out.</p> <p>Most duties under HSWA relate to the conduct of work. However, some duties are linked to workplaces.</p>
WorkSafe/ WorkSafe New Zealand	<p>The government agency that is the primary work health and safety regulator.</p> <p>Other government agencies can be designated to carry out certain health and safety functions, for example, Maritime New Zealand and the Civil Aviation Authority.</p> <p>Previous work health and safety regulators include OSH, Department of Labour, and MBIE.</p>

Disclaimer

This publication provides general guidance. It is not possible for WorkSafe to address every situation that could occur in every workplace. This means that you will need to think about this guidance and how to apply it to your particular circumstances.

WorkSafe regularly reviews and revises guidance to ensure that it is up-to-date. If you are reading a printed copy of this guidance, please check worksafe.govt.nz to confirm that your copy is the current version.

ISBN 978-1-99-105749-5 (online)

Published: April 2026

PO Box 165, Wellington 6140, New Zealand

worksafe.govt.nz



Except for the logos of WorkSafe, this copyright work is licensed under a Creative Commons Attribution-Non-commercial 3.0 NZ licence.

To view a copy of this licence, visit <http://creativecommons.org/licenses/by-nc/3.0/nz>

In essence, you are free to copy, communicate and adapt the work for non-commercial purposes, as long as you attribute the work to WorkSafe and abide by the other licence terms.

